



Department of Energy

Bonneville Power Administration
P.O. Box 3621
Portland, Oregon 97208-3621

PUBLIC AFFAIRS

January 13, 2010

In reply refer to: DK-7

Bricklin & Newman, LLP
Attn: David Bricklin
1011 Fourth Avenue, Suite 3303
Seattle, WA 98154

FOIA BPA #2010-00496-F

Dear Mr. Bricklin:

This letter is your final response to your request for information that you made to the Bonneville Power Administration (BPA) under the Freedom of Information Act (FOIA), 5 U.S.C. 552.

You requested the following:

All documents concerning the Teanaway Solar Reserve Project.

Response:

BPA has located the enclosed documents that are responsive to your request. Some documents are provided to you in their entirety while others have deletions made pursuant to Exemption 6 of the FOIA, 5 U.S.C. 552 (b)(6). There is no charge for your request.

Exemption 6 protects from disclosure "personnel and medical files and similar files the disclosure of which would constitute a clearly unwarranted invasion of personal privacy." In applying Exemption 6, BPA considered (1) whether a significant privacy interest would be invaded; (2) whether release of the information would further the public interest by shedding light on the operations or activities of the Government; and (3) whether in balancing the privacy interest against the public interest, disclosure would constitute a clearly unwarranted invasion of personal privacy.

The personal banking information, email address and cell phone number of an individual has been deleted from certain documents. The withheld information is of a highly personal nature and the individual to whom it pertains has an expectation that it will remain private. Disclosure of this information could subject the individual to whom it pertains to unwanted communications that would intrude into his personal life.

The personal information protected by Exemption 6 is not the type of information ordinarily considered for discretionary FOIA disclosure. The reasonably expected consequence of disclosure would be harmful to an important interest protected by the exemptions, the protection

of a viable privacy interest of the individuals. This is especially true in cases such as this one, when no public interest relative to the core purpose of the FOIA would be served by disclosure.

If you are dissatisfied with this determination, you may make an appeal within thirty (30) days of receipt of this letter to the Director of Office of Hearings and Appeals, Department of Energy, 1000 Independence Avenue SW, Washington, DC 20585. Both the envelope and the letter must be clearly marked "Freedom of Information Act Appeal."

I appreciate the opportunity to assist you with this matter. If you have any questions about this letter, please contact Laura M. Atterbury, FOIA/Privacy Act Specialist, at 503-230-7305.

Sincerely,

/s/ Christina J. Brannon

Christina J. Brannon
Freedom of Information Act/Privacy Act Officer

Enclosures: Responsive Documents

Received at BPA
November 12, 2009
at 9:30 a.m.
[Signature]

**APPENDIX 1 to LGIP
INTERCONNECTION REQUEST FOR A
LARGE GENERATING FACILITY**

1. The undersigned Interconnection Customer submits this request to interconnect its Large Generating Facility with Transmission Provider's Transmission System pursuant to a Tariff.
2. This Interconnection Request is for (check one):
 A proposed new Large Generating Facility.
 An increase in the generating capacity or a Material Modification of an existing Generating Facility.
3. The type of interconnection service requested (check one):
 Energy Resource Interconnection Service
 Network Resource Interconnection Service
4. Check here only if Interconnection Customer requesting Network Resource Interconnection Service also seeks to have its Generating Facility studied for Energy Resource Interconnection Service
5. Interconnection Customer provides the following information:
 - a. Address or location of the proposed new Large Generating Facility site (to the extent known) or, in the case of an existing Generating Facility, the name and specific location of the existing Generating Facility;

Project located in Kittitas County, Washington, Project Location: Five tax parcels, located northeast of the city of Cle Elum off of Highway 970 via County and private roads. All of Section 22; the North Half of the Northeast Quarter, the Northwest Quarter and the North Half of the Southwest Quarter of Section 23, and Parcel 2 of that certain Survey as recorded May 6, 2003 in Book 28 of Surveys, pages 234, 235 and 236, under Auditor's File No. 200305060025, records of Kittitas County, Washington, being a portion of the Northeast Quarter of Section 27; All in Township 20 North, Range 16 East, W.M.; Kittitas County parcel map numbers 20-16-22000-0001, 20-16-23000-0002, 20-16-22000-0002, 20-16-27000-0009, and 20-16-22000-00025.
 - b. Maximum summer at N/A degrees C and winter at N/A degrees C megawatt electrical output of the proposed new Large Generating

Facility or the amount of megawatt increase in the generating capacity of an existing Generating Facility;

75 MW Teanaway Solar Reserve, LLC Project

- c. General description of the equipment configuration;

The collector substation will consist of a 230/345 to 35 KV Dual voltage step up transformer, and three 34.5 kV feeders connected to the 34.5 kV bus. There will be shunt capacitors for reactive requirements. See attached diagram.

- d. Commercial Operation Date (Day, Month, and Year);

15 -12-2010

- e. Name, address, telephone number, and e-mail address of Interconnection Customer's contact person;

Howard Trott
Teanaway Solar Reserve, LLC
418 E. 1st, Suite B
Cle Elum, WA 98922
(206) 972-3800

- f. Approximate location of the proposed Point of Interconnection (optional);
and

Project will interconnect with BPA's Rocky Reach to Maple Valley 345-kV line near the town of Cle Elum, WA.

- g. Interconnection Customer Data (set forth in Attachment A)

6. Applicable deposit amount as specified in the LGIP.

\$10,000

7. Evidence of Site Control as specified in the LGIP (check one)

Is attached to this Interconnection Request

2/11/09
EJP

_____ Will be provided at a later date in accordance with this LGIP

8. This Interconnection Request shall be submitted to the representative indicated below:

Angela DeClerck
Bonneville Power Administration
Transmission Sales – TSE/TPP2
7500 NE 41st Street, Suite 130
Vancouver, WA 98662

Fax: 360-619-6940

9. Representative of Interconnection Customer to contact:


Technical Advisor
Michael Raschio
Elcon Associates, Inc.

EX 6

10. This Interconnection Request is submitted by:

Name of Interconnection Customer: Teanaway Solar Reserve, LLC

By (signature): _____




Name (type or print): Howard Trott

Title: Managing Member

Date: 11-11 2009_

4/17/09

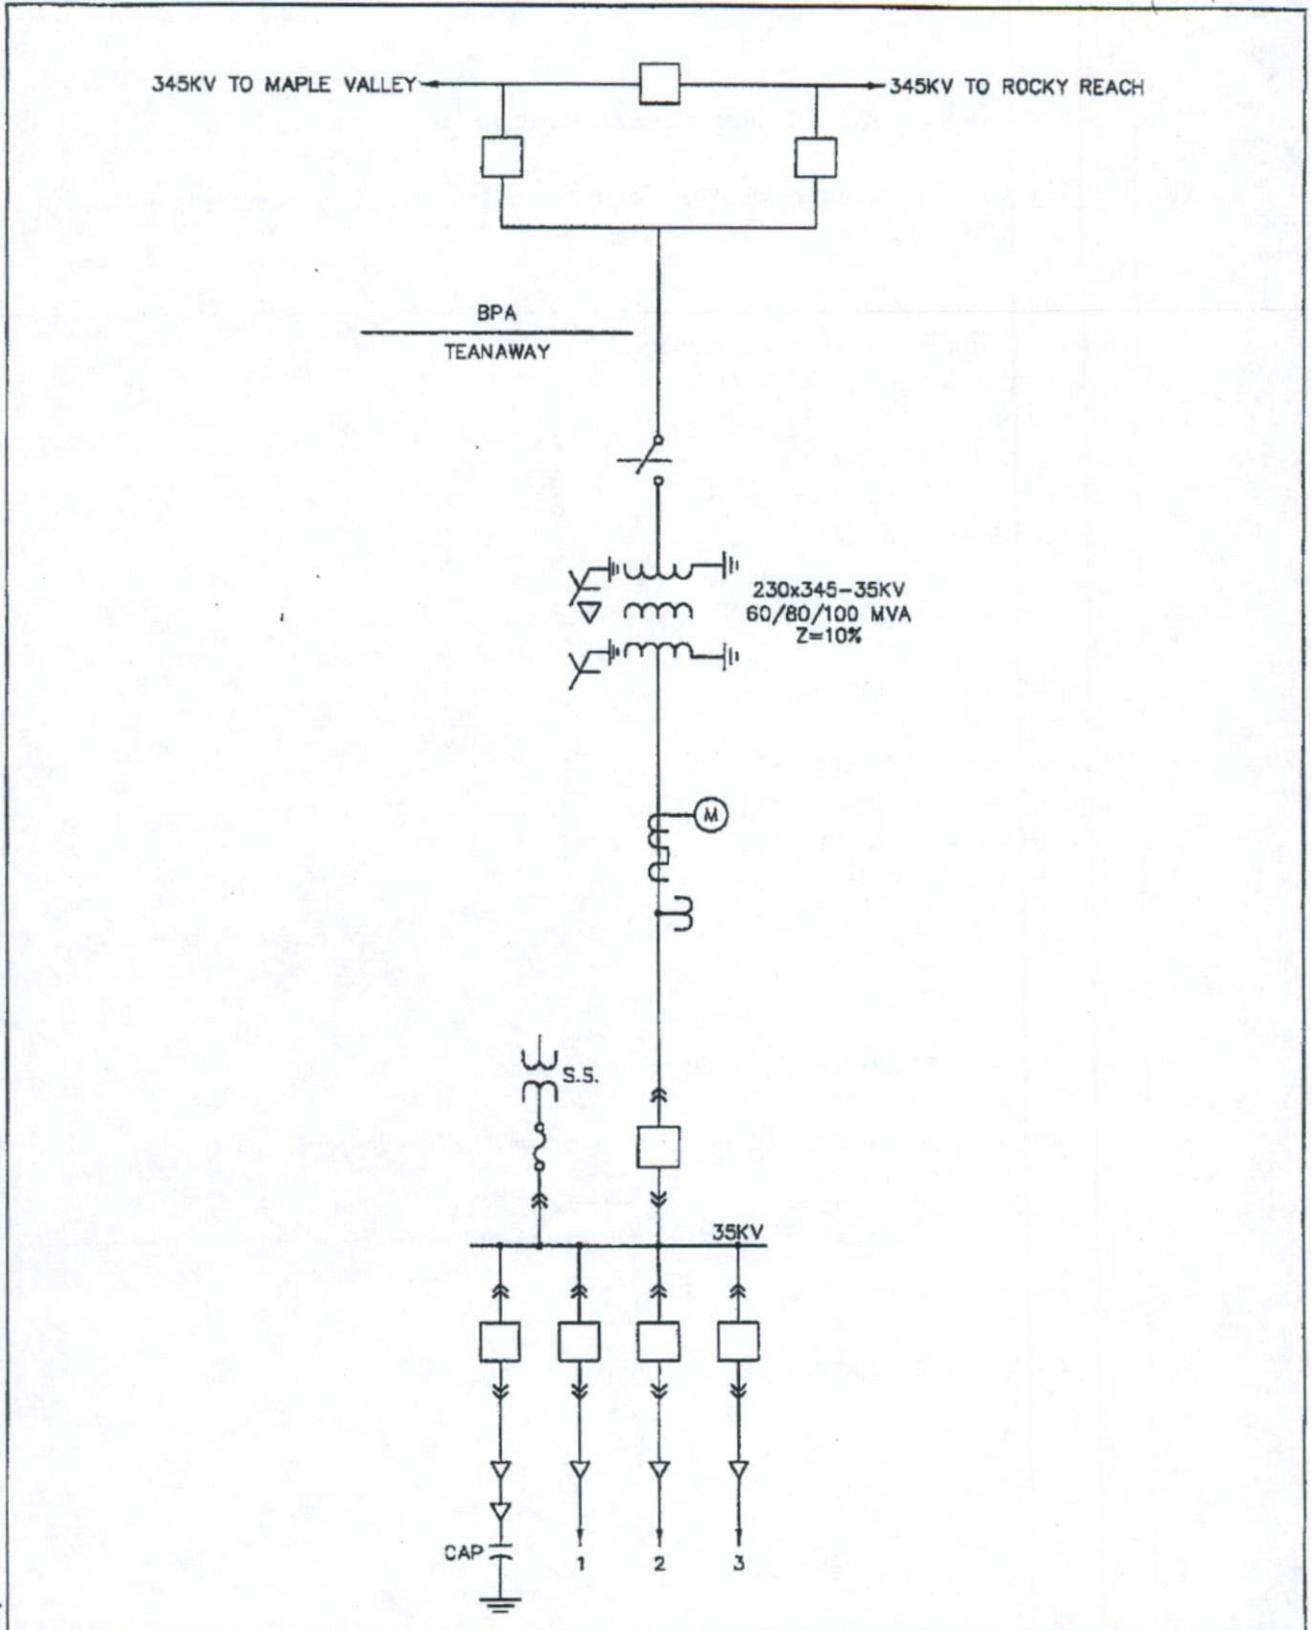

P:\1012-00100\TEANAWAY.dwg


ELCON ASSOCIATES, INC.
ENGINEERS - CONSULTANTS

TEANAWAY SOLAR PROJECT, 80MW
SUBSTATION ONE LINE DIAGRAM

DATE: 9-25-09

DWG. NO.

4/17/09

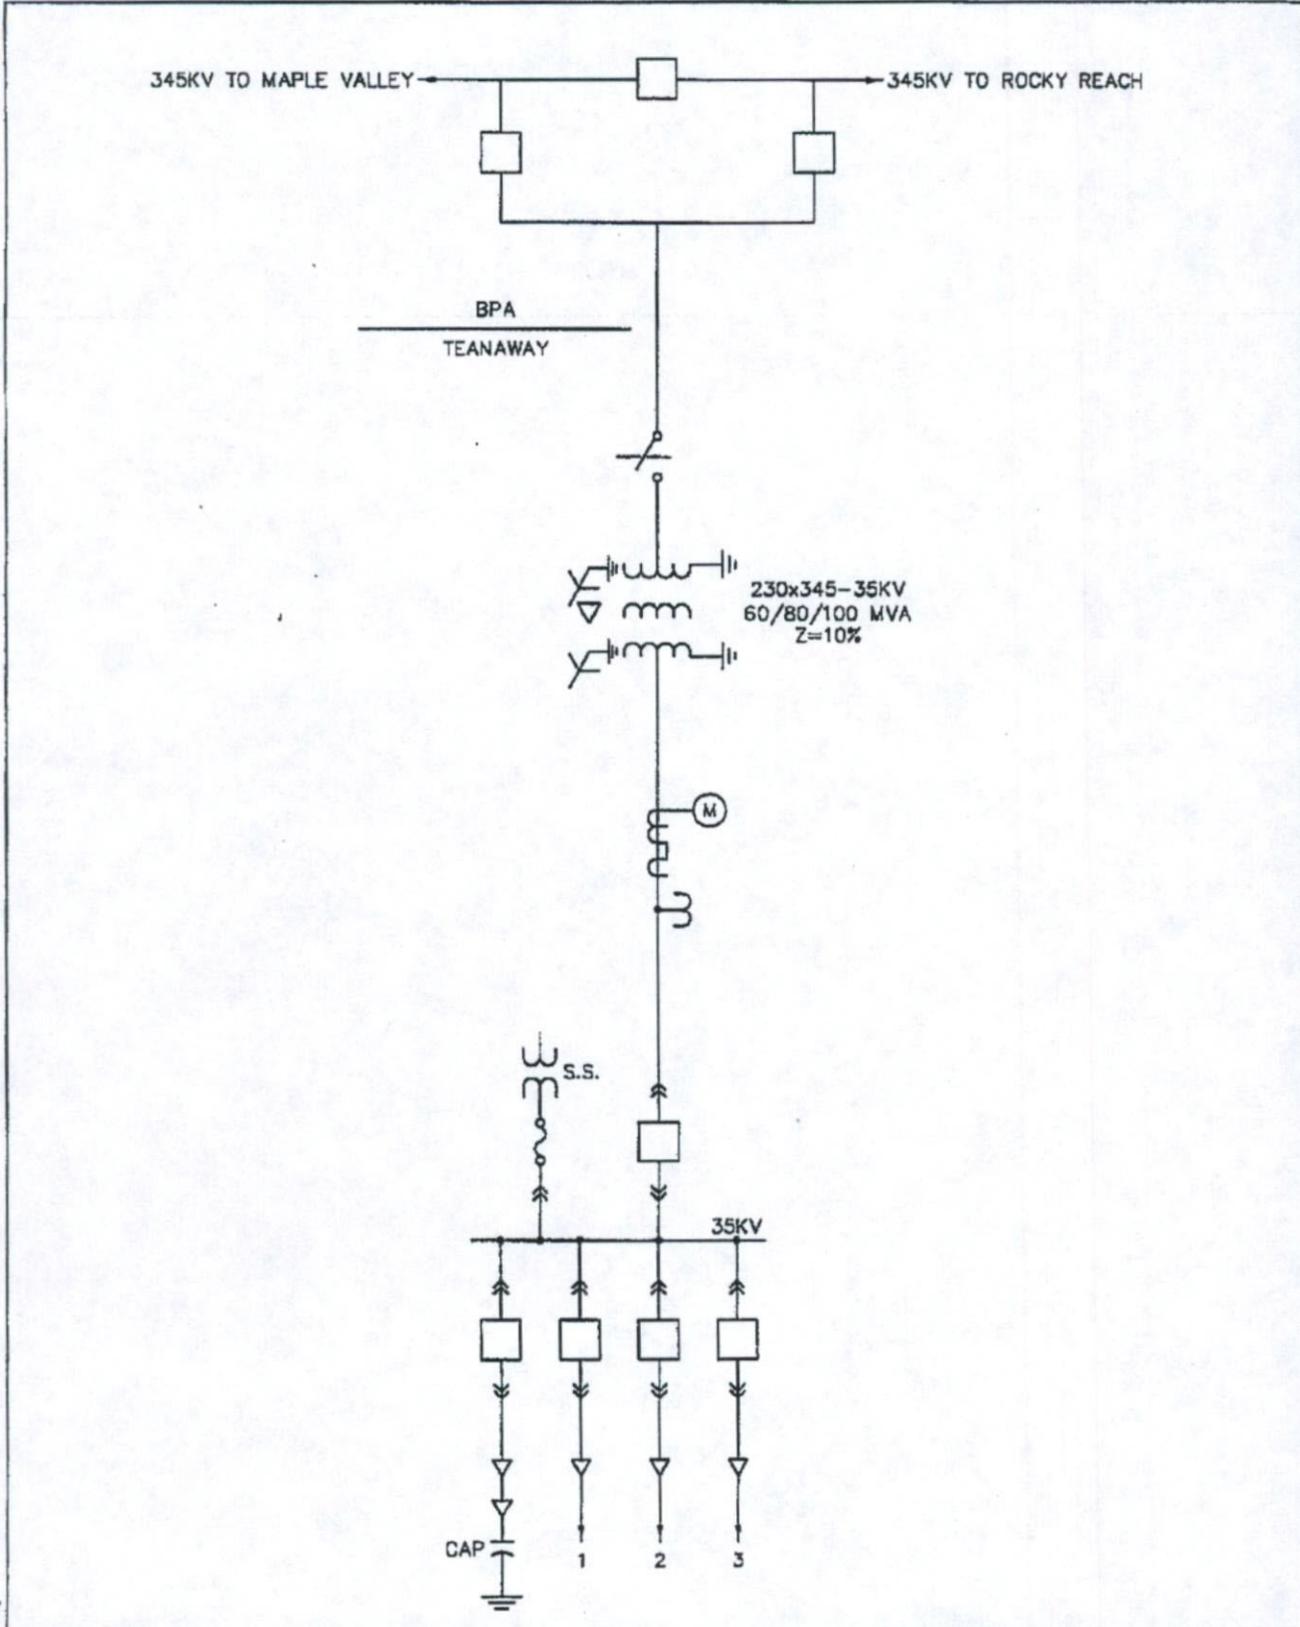

F:\1012-00100\TEANAWAY.dwg

ELCON ASSOCIATES, INC.
ENGINEERS - CONSULTANTS

TEANAWAY SOLAR PROJECT, 80MW
SUBSTATION ONE LINE DIAGRAM

DATE: 9-25-09 DWG. NO.

Fiedler, Paul A - TPC-TPP-4

From: Peck, Nick - TPC-TPP-4
Sent: Monday, November 23, 2009 10:20 AM
To: Van Cleave, Tonya M - TPC-TPP-4
Subject: RE: G0393 deposit

k. I've lost track of who has done what to whom, so if I duplicate.....bear with me!

Nick Peck

LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Van Cleave, Tonya M - TPC-TPP-4
Sent: Monday, November 23, 2009 10:18 AM
To: Peck, Nick - TPC-TPP-4
Subject: RE: G0393 deposit

Yes, I have already logged this in my payment log, but thanks.

From: Peck, Nick - TPC-TPP-4
Sent: Monday, November 23, 2009 10:10 AM
To: Van Cleave, Tonya M - TPC-TPP-4
Subject: G0393 deposit

Tonya,

This is the deposit for G0393; I have not yet got the paperwork for them.

CHK DT: 11/11/2009, ABA#
EX 6 CHECK# 00002017
(INVOICES: 0)

LBX 11/18/2009 TEAWAY SOLAR RESERVE LLC
00

Nick Peck

LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

Fiedler, Paul A - TPC-TPP-4

From: Peck, Nick - TPC-TPP-4
Sent: Monday, November 23, 2009 10:10 AM
To: Van Cleave, Tonya M - TPC-TPP-4
Subject: G0393 deposit

Tonya,

This is the deposit for G0393; I have not yet got the paperwork for them.

CHK DT: 11/11/2009, ABA#

EX 6

(INVOICES: 0)

LBX 11/18/2009 TEAWAY SOLAR RESERVE LLC
00

Nick Peck

LGIP Administrator
TPC/TPP-4

Tel: (360) 619-6419

Fax: (360) 619-6070

Cell: (360) 980-2183

Text: 3609802183@vtext.com

Fiedler,Paul A - TPC-TPP-4

From: Peck,Nick - TPC-TPP-4
Sent: Wednesday, November 18, 2009 10:14 AM
To: DeClerck,Angela - TSE-TPP-2
Subject: RE: G0393: Teanaway Solar project FW: do you know

Lucky you. I figured, since you had the initial impetus from on high.

Nick Peck

LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: DeClerck,Angela - TSE-TPP-2
Sent: Wednesday, November 18, 2009 10:12 AM
To: Peck,Nick - TPC-TPP-4
Subject: RE: G0393: Teanaway Solar project FW: do you know

And yes this is my assignemnt for the time being

From: Peck,Nick - TPC-TPP-4
Sent: Tuesday, November 17, 2009 1:48 PM
To: Fiedler,Paul A - TPC-TPP-4; DeClerck,Angela - TSE-TPP-2
Cc: Johnson,Kelly G - TPC-TPP-4; Cosola,Anna M - TPC-TPP-4; Ream,John R - TPC-TPP-4; Gilliland,Kimberly D - TSES-TPP-2
Subject: G0393: Teanaway Solar project FW: do you know

Paul and Angela:

Anna and John shared this link (see end of email) from the Seattle Times (originally Yakima Herald story) from a couple of weeks ago – and thanks, both, for sharing! The request coincidentally arrived today.

The key element in this is the over-the-top PR spiel coming from both Trott (the principal) and Aldrich, the consulting advisor for politics, policy and PR. Just this line (“For Trott to make a planned construction start date of April next year he's going to need commitments from buyers - namely big utility companies”) sends warning shivers down my spine. It gets better: “Renewable energy advocates around the state are rooting for the Cle Elum project, including Sen. Maria Cantwell, D-Wash., and Rep. Jay Inslee, D-Bainbridge Island.” If you have not already done so, a couple of minutes exploring <http://www.strategies360.com/> will help develop an understanding of the advice and support Mr. Trott is buying; it will likely outperform CEP many-fold.

Once I get the request processed and acknowledged, I'll suggest we should be targeting a Scoping Meeting as early in December as we can make it, with a view to getting reality restored by the start of the year.

Anyway, a heads-up we have a high-visibility project on our hands that may rapidly escalate to public controversy at a high level.

Nick

Nick Peck

LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Cosola,Anna M - TPC-TPP-4
Sent: Tuesday, November 17, 2009 1:23 PM
To: Peck,Nick - TPC-TPP-4
Cc: Ream,John R - TPC-TPP-4

Subject: RE: do you know

That's pretty interesting... I'm gonna ask Nick.

Nick...have you seen or heard anything about this?

From: Ream,John R - TPC-TPP-4

Sent: Tuesday, November 17, 2009 1:15 PM

To: Cosola,Anna M - TPC-TPP-4

Subject: do you know

Is BPA involved in this project at all?

http://seattletimes.nwsourc.com/html/localnews/2010182322_apwasolarpower.html?syndication=rss

Fiedler,Paul A - TPC-TPP-4

From: DeClerck,Angela - TSE-TPP-2
Sent: Wednesday, November 18, 2009 10:12 AM
To: Peck,Nick - TPC-TPP-4
Subject: RE: G0393: Teanaway Solar project FW: do you know

And yes this is my assignemnt for the time being

From: Peck,Nick - TPC-TPP-4
Sent: Tuesday, November 17, 2009 1:48 PM
To: Fiedler,Paul A - TPC-TPP-4; DeClerck,Angela - TSE-TPP-2
Cc: Johnson,Kelly G - TPC-TPP-4; Cosola,Anna M - TPC-TPP-4; Ream,John R - TPC-TPP-4; Gilliland,Kimberly D - TSES-TPP-2
Subject: G0393: Teanaway Solar project FW: do you know

Paul and Angela:

Anna and John shared this link (see end of email) from the Seattle Times (originally Yakima Herald story) from a couple of weeks ago – and thanks, both, for sharing! The request coincidentally arrived today.

The key element in this is the over-the-top PR spiel coming from both Trott (the principal) and Aldrich, the consulting advisor for politics, policy and PR. Just this line (“For Trott to make a planned construction start date of April next year he's going to need commitments from buyers - namely big utility companies”) sends warning shivers down my spine. It gets better: “Renewable energy advocates around the state are rooting for the Cle Elum project, including Sen. Maria Cantwell, D-Wash., and Rep. Jay Inslee, D-Bainbridge Island.” If you have not already done so, a couple of minutes exploring <http://www.strategies360.com/> will help develop an understanding of the advice and support Mr. Trott is buying; it will likely outperform CEP many-fold.

Once I get the request processed and acknowledged, I'll suggest we should be targeting a Scoping Meeting as early in December as we can make it, with a view to getting reality restored by the start of the year.

Anyway, a heads-up we have a high-visibility project on our hands that may rapidly escalate to public controversy at a high level.

Nick

Nick Peck

LGIP Administrator

TPC/TPP-4

Tel: (360) 619-6419

Fax: (360) 619-6070

Cell: (360) 980-2183

Text: 3609802183@vtext.com

From: Cosola,Anna M - TPC-TPP-4
Sent: Tuesday, November 17, 2009 1:23 PM
To: Peck,Nick - TPC-TPP-4
Cc: Ream,John R - TPC-TPP-4
Subject: RE: do you know

That's pretty interesting... I'm gonna ask Nick.

Nick...have you seen or heard anything about this?

From: Ream,John R - TPC-TPP-4
Sent: Tuesday, November 17, 2009 1:15 PM
To: Cosola,Anna M - TPC-TPP-4
Subject: do you know

Is BPA involved in this project at all?

Fiedler,Paul A - TPC-TPP-4

From: DeClerck,Angela - TSE-TPP-2
Sent: Wednesday, November 18, 2009 10:12 AM
To: Peck,Nick - TPC-TPP-4; Fiedler,Paul A - TPC-TPP-4
Cc: Johnson,Kelly G - TPC-TPP-4; Cosola,Anna M - TPC-TPP-4; Ream,John R - TPC-TPP-4; Gilliland,Kimberly D - TSES-TPP-2
Subject: RE: G0393: Teanaway Solar project FW: do you know

Thanks

From: Peck,Nick - TPC-TPP-4
Sent: Tuesday, November 17, 2009 1:48 PM
To: Fiedler,Paul A - TPC-TPP-4; DeClerck,Angela - TSE-TPP-2
Cc: Johnson,Kelly G - TPC-TPP-4; Cosola,Anna M - TPC-TPP-4; Ream,John R - TPC-TPP-4; Gilliland,Kimberly D - TSES-TPP-2
Subject: G0393: Teanaway Solar project FW: do you know

Paul and Angela:

Anna and John shared this link (see end of email) from the Seattle Times (originally Yakima Herald story) from a couple of weeks ago – and thanks, both, for sharing! The request coincidentally arrived today.

The key element in this is the over-the-top PR spiel coming from both Trott (the principal) and Aldrich, the consulting advisor for politics, policy and PR. Just this line (“For Trott to make a planned construction start date of April next year he's going to need commitments from buyers - namely big utility companies”) sends warning shivers down my spine. It gets better: “Renewable energy advocates around the state are rooting for the Cle Elum project, including Sen. Maria Cantwell, D-Wash., and Rep. Jay Inslee, D-Bainbridge Island.” If you have not already done so, a couple of minutes exploring <http://www.strategies360.com/> will help develop an understanding of the advice and support Mr. Trott is buying; it will likely outperform CEP many-fold.

Once I get the request processed and acknowledged, I'll suggest we should be targeting a Scoping Meeting as early in December as we can make it, with a view to getting reality restored by the start of the year.

Anyway, a heads-up we have a high-visibility project on our hands that may rapidly escalate to public controversy at a high level.

Nick

Nick Peck

LGIP Administrator

TPC/TPP-4

Tel: (360) 619-6419

Fax: (360) 619-6070

Cell: (360) 980-2183

Text: 3609802183@vtext.com

From: Cosola,Anna M - TPC-TPP-4
Sent: Tuesday, November 17, 2009 1:23 PM
To: Peck,Nick - TPC-TPP-4
Cc: Ream,John R - TPC-TPP-4
Subject: RE: do you know

That's pretty interesting... I'm gonna ask Nick.

Nick...have you seen or heard anything about this?

From: Ream,John R - TPC-TPP-4
Sent: Tuesday, November 17, 2009 1:15 PM
To: Cosola,Anna M - TPC-TPP-4
Subject: do you know

Fiedler, Paul A - TPC-TPP-4

From: Peck, Nick - TPC-TPP-4
Sent: Tuesday, November 17, 2009 2:39 PM
To: Bingaman, Claire D - KEC-4
Subject: RE: G0393: Teanaway Solar project FW: do you know

☺

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Bingaman, Claire D - KEC-4
Sent: Tuesday, November 17, 2009 2:37 PM
To: Peck, Nick - TPC-TPP-4
Subject: RE: G0393: Teanaway Solar project FW: do you know

Haha...well, you might be right.

Claire Bingaman
office: 503.230.5922 | fax: 503.230.5699

From: Peck, Nick - TPC-TPP-4
Sent: Tuesday, November 17, 2009 2:35 PM
To: Bingaman, Claire D - KEC-4
Subject: RE: G0393: Teanaway Solar project FW: do you know

In the ancient Chinese sense, yes!

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Bingaman, Claire D - KEC-4
Sent: Tuesday, November 17, 2009 2:35 PM
To: Peck, Nick - TPC-TPP-4
Subject: RE: G0393: Teanaway Solar project FW: do you know

Wow, sounds like it could be interesting!

Claire Bingaman
office: 503.230.5922 | fax: 503.230.5699

From: Peck, Nick - TPC-TPP-4
Sent: Tuesday, November 17, 2009 1:50 PM
To: Bingaman, Claire D - KEC-4

Subject: FW: G0393: Teanaway Solar project FW: do you know

Just fyi, some of the background. I've known about this since July when I read Clearing Up; I contacted them almost immediately and it took until now to get the request in.

Nick Peck

LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Peck,Nick - TPC-TPP-4

Sent: Tuesday, November 17, 2009 1:48 PM

To: Fiedler,Paul A - TPC-TPP-4; DeClerck,Angela - TSE-TPP-2

Cc: Johnson,Kelly G - TPC-TPP-4; Cosola,Anna M - TPC-TPP-4; Ream,John R - TPC-TPP-4; Gilliland,Kimberly D - TSES-TPP-2

Subject: G0393: Teanaway Solar project FW: do you know

Paul and Angela:

Anna and John shared this link (see end of email) from the Seattle Times (originally Yakima Herald story) from a couple of weeks ago – and thanks, both, for sharing! The request coincidentally arrived today.

The key element in this is the over-the-top PR spiel coming from both Trott (the principal) and Aldrich, the consulting advisor for politics, policy and PR. Just this line (“For Trott to make a planned construction start date of April next year he's going to need commitments from buyers - namely big utility companies”) sends warning shivers down my spine. It gets better: “Renewable energy advocates around the state are rooting for the Cle Elum project, including Sen. Maria Cantwell, D-Wash., and Rep. Jay Inslee, D-Bainbridge Island.” If you have not already done so, a couple of minutes exploring <http://www.strategies360.com/> will help develop an understanding of the advice and support Mr. Trott is buying; it will likely outperform CEP many-fold.

Once I get the request processed and acknowledged, I'll suggest we should be targeting a Scoping Meeting as early in December as we can make it, with a view to getting reality restored by the start of the year.

Anyway, a heads-up we have a high-visibility project on our hands that may rapidly escalate to public controversy at a high level.

Nick

Nick Peck

LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Cosola,Anna M - TPC-TPP-4

Sent: Tuesday, November 17, 2009 1:23 PM

To: Peck,Nick - TPC-TPP-4

Cc: Ream,John R - TPC-TPP-4

Subject: RE: do you know

That's pretty interesting... I'm gonna ask Nick.

Nick...have you seen or heard anything about this?

From: Ream,John R - TPC-TPP-4

Sent: Tuesday, November 17, 2009 1:15 PM

To: Cosola,Anna M - TPC-TPP-4

Subject: do you know

Is BPA involved in this project at all?

http://seattletimes.nwsourc.com/html/localnews/2010182322_apwasolarpower.html?syndication=rss

Fiedler,Paul A - TPC-TPP-4

From: Bingaman,Claire D - KEC-4
Sent: Tuesday, November 17, 2009 2:37 PM
To: Peck,Nick - TPC-TPP-4
Subject: RE: G0393: Teanaway Solar project FW: do you know

Haha...well, you might be right.

Claire Bingaman

office: 503.230.5922 | fax: 503.230.5699

From: Peck,Nick - TPC-TPP-4
Sent: Tuesday, November 17, 2009 2:35 PM
To: Bingaman,Claire D - KEC-4
Subject: RE: G0393: Teanaway Solar project FW: do you know

In the ancient Chinese sense, yes!

Nick Peck

LGIP Administrator

TPC/TPP-4

Tel: (360) 619-6419

Fax: (360) 619-6070

Cell: (360) 980-2183

Text: 3609802183@vtext.com

From: Bingaman,Claire D - KEC-4
Sent: Tuesday, November 17, 2009 2:35 PM
To: Peck,Nick - TPC-TPP-4
Subject: RE: G0393: Teanaway Solar project FW: do you know

Wow, sounds like it could be interesting!

Claire Bingaman

office: 503.230.5922 | fax: 503.230.5699

From: Peck,Nick - TPC-TPP-4
Sent: Tuesday, November 17, 2009 1:50 PM
To: Bingaman,Claire D - KEC-4
Subject: FW: G0393: Teanaway Solar project FW: do you know

Just fyi, some of the background. I've known about this since July when I read Clearing Up; I contacted them almost immediately and it took until now to get the request in.

Nick Peck

LGIP Administrator

TPC/TPP-4

Tel: (360) 619-6419

Fax: (360) 619-6070

Cell: (360) 980-2183

Text: 3609802183@vtext.com

From: Peck,Nick - TPC-TPP-4
Sent: Tuesday, November 17, 2009 1:48 PM
To: Fiedler,Paul A - TPC-TPP-4; DeClerck,Angela - TSE-TPP-2

Cc: Johnson,Kelly G - TPC-TPP-4; Cosola,Anna M - TPC-TPP-4; Ream,John R - TPC-TPP-4; Gilliland,Kimberly D - TSES-TPP-2

Subject: G0393: Teanaway Solar project FW: do you know

Paul and Angela:

Anna and John shared this link (see end of email) from the Seattle Times (originally Yakima Herald story) from a couple of weeks ago – and thanks, both, for sharing! The request coincidentally arrived today.

The key element in this is the over-the-top PR spiel coming from both Trott (the principal) and Aldrich, the consulting advisor for politics, policy and PR. Just this line (“For Trott to make a planned construction start date of April next year he's going to need commitments from buyers - namely big utility companies”) sends warning shivers down my spine. It gets better: “Renewable energy advocates around the state are rooting for the Cle Elum project, including Sen. Maria Cantwell, D-Wash., and Rep. Jay Inslee, D-Bainbridge Island.” If you have not already done so, a couple of minutes exploring <http://www.strategies360.com/> will help develop an understanding of the advice and support Mr. Trott is buying; it will likely outperform CEP many-fold.

Once I get the request processed and acknowledged, I'll suggest we should be targeting a Scoping Meeting as early in December as we can make it, with a view to getting reality restored by the start of the year.

Anyway, a heads-up we have a high-visibility project on our hands that may rapidly escalate to public controversy at a high level.

Nick

Nick Peck

LGIP Administrator

TPC/TPP-4

Tel: (360) 619-6419

Fax: (360) 619-6070

Cell: (360) 980-2183

Text: 3609802183@vtext.com

From: Cosola,Anna M - TPC-TPP-4

Sent: Tuesday, November 17, 2009 1:23 PM

To: Peck,Nick - TPC-TPP-4

Cc: Ream,John R - TPC-TPP-4

Subject: RE: do you know

That's pretty interesting... I'm gonna ask Nick.

Nick...have you seen or heard anything about this?

From: Ream,John R - TPC-TPP-4

Sent: Tuesday, November 17, 2009 1:15 PM

To: Cosola,Anna M - TPC-TPP-4

Subject: do you know

Is BPA involved in this project at all?

http://seattletimes.nwsources.com/html/localnews/2010182322_apwasolarpower.html?syndication=rss

Fiedler,Paul A - TPC-TPP-4

From: Peck,Nick - TPC-TPP-4
Sent: Tuesday, November 17, 2009 2:35 PM
To: Bingaman,Claire D - KEC-4
Subject: RE: G0393: Teanaway Solar project FW: do you know

In the ancient Chinese sense, yes!

Nick Peck

LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Bingaman,Claire D - KEC-4
Sent: Tuesday, November 17, 2009 2:35 PM
To: Peck,Nick - TPC-TPP-4
Subject: RE: G0393: Teanaway Solar project FW: do you know

Wow, sounds like it could be interesting!

Claire Bingaman

office: 503.230.5922 | fax: 503.230.5699

From: Peck,Nick - TPC-TPP-4
Sent: Tuesday, November 17, 2009 1:50 PM
To: Bingaman,Claire D - KEC-4
Subject: FW: G0393: Teanaway Solar project FW: do you know

Just fyi, some of the background. I've known about this since July when I read Clearing Up; I contacted them almost immediately and it took until now to get the request in.

Nick Peck

LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Peck,Nick - TPC-TPP-4
Sent: Tuesday, November 17, 2009 1:48 PM
To: Fiedler,Paul A - TPC-TPP-4; DeClerck,Angela - TSE-TPP-2
Cc: Johnson,Kelly G - TPC-TPP-4; Cosola,Anna M - TPC-TPP-4; Ream,John R - TPC-TPP-4; Gilliland,Kimberly D - TSES-TPP-2
Subject: G0393: Teanaway Solar project FW: do you know

Paul and Angela:

Anna and John shared this link (see end of email) from the Seattle Times (originally Yakima Herald story) from a couple of weeks ago – and thanks, both, for sharing! The request coincidentally arrived today.

The key element in this is the over-the-top PR spiel coming from both Trott (the principal) and Aldrich, the consulting advisor for politics, policy and PR. Just this line ("For Trott to make a planned construction start date of April next year he's

going to need commitments from buyers - namely big utility companies") sends warning shivers down my spine. It gets better: "Renewable energy advocates around the state are rooting for the Cle Elum project, including Sen. Maria Cantwell, D-Wash., and Rep. Jay Inslee, D-Bainbridge Island." If you have not already done so, a couple of minutes exploring <http://www.strategies360.com/> will help develop an understanding of the advice and support Mr. Trott is buying; it will likely outperform CEP many-fold.

Once I get the request processed and acknowledged, I'll suggest we should be targeting a Scoping Meeting as early in December as we can make it, with a view to getting reality restored by the start of the year.

Anyway, a heads-up we have a high-visibility project on our hands that may rapidly escalate to public controversy at a high level.

Nick

Nick Peck

LGIP Administrator

TPC/TPP-4

Tel: (360) 619-6419

Fax: (360) 619-6070

Cell: (360) 980-2183

Text: 3609802183@vtext.com

From: Cosola,Anna M - TPC-TPP-4

Sent: Tuesday, November 17, 2009 1:23 PM

To: Peck,Nick - TPC-TPP-4

Cc: Ream,John R - TPC-TPP-4

Subject: RE: do you know

That's pretty interesting... I'm gonna ask Nick.

Nick...have you seen or heard anything about this?

From: Ream,John R - TPC-TPP-4

Sent: Tuesday, November 17, 2009 1:15 PM

To: Cosola,Anna M - TPC-TPP-4

Subject: do you know

Is BPA involved in this project at all?

http://seattletimes.nwsourc.com/html/localnews/2010182322_apwasolarpower.html?syndication=rss

Fiedler, Paul A - TPC-TPP-4

From: Bingaman, Claire D - KEC-4
Sent: Tuesday, November 17, 2009 2:35 PM
To: Peck, Nick - TPC-TPP-4
Subject: RE: G0393: Teanaway Solar project FW: do you know

Wow, sounds like it could be interesting!

Claire Bingaman

office: 503.230.5922 | fax: 503.230.5699

From: Peck, Nick - TPC-TPP-4
Sent: Tuesday, November 17, 2009 1:50 PM
To: Bingaman, Claire D - KEC-4
Subject: FW: G0393: Teanaway Solar project FW: do you know

Just fyi, some of the background. I've known about this since July when I read Clearing Up; I contacted them almost immediately and it took until now to get the request in.

Nick Peck

LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Peck, Nick - TPC-TPP-4
Sent: Tuesday, November 17, 2009 1:48 PM
To: Fiedler, Paul A - TPC-TPP-4; DeClerck, Angela - TSE-TPP-2
Cc: Johnson, Kelly G - TPC-TPP-4; Cosola, Anna M - TPC-TPP-4; Ream, John R - TPC-TPP-4; Gilliland, Kimberly D - TSES-TPP-2
Subject: G0393: Teanaway Solar project FW: do you know

Paul and Angela:

Anna and John shared this link (see end of email) from the Seattle Times (originally Yakima Herald story) from a couple of weeks ago – and thanks, both, for sharing! The request coincidentally arrived today.

The key element in this is the over-the-top PR spiel coming from both Trott (the principal) and Aldrich, the consulting advisor for politics, policy and PR. Just this line ("For Trott to make a planned construction start date of April next year he's going to need commitments from buyers - namely big utility companies") sends warning shivers down my spine. It gets better: "Renewable energy advocates around the state are rooting for the Cle Elum project, including Sen. Maria Cantwell, D-Wash., and Rep. Jay Inslee, D-Bainbridge Island." If you have not already done so, a couple of minutes exploring <http://www.strategies360.com/> will help develop an understanding of the advice and support Mr. Trott is buying; it will likely outperform CEP many-fold.

Once I get the request processed and acknowledged, I'll suggest we should be targeting a Scoping Meeting as early in December as we can make it, with a view to getting reality restored by the start of the year.

Anyway, a heads-up we have a high-visibility project on our hands that may rapidly escalate to public controversy at a high level.

Nick

Nick Peck

LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Cosola,Anna M - TPC-TPP-4
Sent: Tuesday, November 17, 2009 1:23 PM
To: Peck,Nick - TPC-TPP-4
Cc: Ream,John R - TPC-TPP-4
Subject: RE: do you know

That's pretty interesting... I'm gonna ask Nick.

Nick...have you seen or heard anything about this?

From: Ream,John R - TPC-TPP-4
Sent: Tuesday, November 17, 2009 1:15 PM
To: Cosola,Anna M - TPC-TPP-4
Subject: do you know

Is BPA involved in this project at all?

http://seattletimes.nwsourc.com/html/localnews/2010182322_apwasolarpower.html?syndication=rss

Fiedler,Paul A - TPC-TPP-4

From: Ream,John R - TPC-TPP-4
Sent: Tuesday, November 17, 2009 1:55 PM
To: Peck,Nick - TPC-TPP-4
Subject: RE: G0393: Teanaway Solar project FW: do you know

You're welcome!

From: Peck,Nick - TPC-TPP-4
Sent: Tuesday, November 17, 2009 1:48 PM
To: Fiedler,Paul A - TPC-TPP-4; DeClerck,Angela - TSE-TPP-2
Cc: Johnson,Kelly G - TPC-TPP-4; Cosola,Anna M - TPC-TPP-4; Ream,John R - TPC-TPP-4; Gilliland,Kimberly D - TSES-TPP-2
Subject: G0393: Teanaway Solar project FW: do you know

Paul and Angela:

Anna and John shared this link (see end of email) from the Seattle Times (originally Yakima Herald story) from a couple of weeks ago – and thanks, both, for sharing! The request coincidentally arrived today.

The key element in this is the over-the-top PR spiel coming from both Trott (the principal) and Aldrich, the consulting advisor for politics, policy and PR. Just this line ("For Trott to make a planned construction start date of April next year he's going to need commitments from buyers - namely big utility companies") sends warning shivers down my spine. It gets better: "Renewable energy advocates around the state are rooting for the Cle Elum project, including Sen. Maria Cantwell, D-Wash., and Rep. Jay Inslee, D-Bainbridge Island." If you have not already done so, a couple of minutes exploring <http://www.strategies360.com/> will help develop an understanding of the advice and support Mr. Trott is buying; it will likely outperform CEP many-fold.

Once I get the request processed and acknowledged, I'll suggest we should be targeting a Scoping Meeting as early in December as we can make it, with a view to getting reality restored by the start of the year. Anyway, a heads-up we have a high-visibility project on our hands that may rapidly escalate to public controversy at a high level.

Nick

Nick Peck

LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Cosola,Anna M - TPC-TPP-4
Sent: Tuesday, November 17, 2009 1:23 PM
To: Peck,Nick - TPC-TPP-4
Cc: Ream,John R - TPC-TPP-4
Subject: RE: do you know

That's pretty interesting... I'm gonna ask Nick.

Nick...have you seen or heard anything about this?

From: Ream,John R - TPC-TPP-4
Sent: Tuesday, November 17, 2009 1:15 PM
To: Cosola,Anna M - TPC-TPP-4
Subject: do you know

Is BPA involved in this project at all?

http://seattletimes.nwsourc.com/html/localnews/2010182322_apwasolarpower.html?syndication=rss

Fiedler,Paul A - TPC-TPP-4

From: Peck,Nick - TPC-TPP-4
Sent: Tuesday, November 17, 2009 1:56 PM
To: Ream,John R - TPC-TPP-4
Subject: RE: G0393: Teanaway Solar project FW: do you know

☺

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Ream,John R - TPC-TPP-4
Sent: Tuesday, November 17, 2009 1:55 PM
To: Peck,Nick - TPC-TPP-4
Subject: RE: G0393: Teanaway Solar project FW: do you know

You're welcome!

From: Peck,Nick - TPC-TPP-4
Sent: Tuesday, November 17, 2009 1:48 PM
To: Fiedler,Paul A - TPC-TPP-4; DeClerck,Angela - TSE-TPP-2
Cc: Johnson,Kelly G - TPC-TPP-4; Cosola,Anna M - TPC-TPP-4; Ream,John R - TPC-TPP-4; Gilliland,Kimberly D - TSES-TPP-2
Subject: G0393: Teanaway Solar project FW: do you know

Paul and Angela:

Anna and John shared this link (see end of email) from the Seattle Times (originally Yakima Herald story) from a couple of weeks ago – and thanks, both, for sharing! The request coincidentally arrived today.

The key element in this is the over-the-top PR spiel coming from both Trott (the principal) and Aldrich, the consulting advisor for politics, policy and PR. Just this line (“For Trott to make a planned construction start date of April next year he's going to need commitments from buyers - namely big utility companies”) sends warning shivers down my spine. It gets better: “Renewable energy advocates around the state are rooting for the Cle Elum project, including Sen. Maria Cantwell, D-Wash., and Rep. Jay Inslee, D-Bainbridge Island.” If you have not already done so, a couple of minutes exploring <http://www.strategies360.com/> will help develop an understanding of the advice and support Mr. Trott is buying; it will likely outperform CEP many-fold.

Once I get the request processed and acknowledged, I'll suggest we should be targeting a Scoping Meeting as early in December as we can make it, with a view to getting reality restored by the start of the year.

Anyway, a heads-up we have a high-visibility project on our hands that may rapidly escalate to public controversy at a high level.

Nick

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Cosola,Anna M - TPC-TPP-4
Sent: Tuesday, November 17, 2009 1:23 PM
To: Peck,Nick - TPC-TPP-4
Cc: Ream,John R - TPC-TPP-4

Subject: RE: do you know

That's pretty interesting... I'm gonna ask Nick.

Nick...have you seen or heard anything about this?

From: Ream, John R - TPC-TPP-4

Sent: Tuesday, November 17, 2009 1:15 PM

To: Cosola, Anna M - TPC-TPP-4

Subject: do you know

Is BPA involved in this project at all?

http://seattletimes.nwsourc.com/html/localnews/2010182322_apwasolarpower.html?syndication=rss

Fiedler, Paul A - TPC-TPP-4

From: Peck, Nick - TPC-TPP-4
Sent: Tuesday, November 17, 2009 1:50 PM
To: Bingaman, Claire D - KEC-4
Subject: FW: G0393: Teanaway Solar project FW: do you know

Just fyi, some of the background. I've known about this since July when I read Clearing Up; I contacted them almost immediately and it took until now to get the request in.

Nick Peck

LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Peck, Nick - TPC-TPP-4
Sent: Tuesday, November 17, 2009 1:48 PM
To: Fiedler, Paul A - TPC-TPP-4; DeClerck, Angela - TSE-TPP-2
Cc: Johnson, Kelly G - TPC-TPP-4; Cosola, Anna M - TPC-TPP-4; Ream, John R - TPC-TPP-4; Gilliland, Kimberly D - TSES-TPP-2
Subject: G0393: Teanaway Solar project FW: do you know

Paul and Angela:

Anna and John shared this link (see end of email) from the Seattle Times (originally Yakima Herald story) from a couple of weeks ago – and thanks, both, for sharing! The request coincidentally arrived today.

The key element in this is the over-the-top PR spiel coming from both Trott (the principal) and Aldrich, the consulting advisor for politics, policy and PR. Just this line ("For Trott to make a planned construction start date of April next year he's going to need commitments from buyers - namely big utility companies") sends warning shivers down my spine. It gets better: "Renewable energy advocates around the state are rooting for the Cle Elum project, including Sen. Maria Cantwell, D-Wash., and Rep. Jay Inslee, D-Bainbridge Island." If you have not already done so, a couple of minutes exploring <http://www.strategies360.com/> will help develop an understanding of the advice and support Mr. Trott is buying; it will likely outperform CEP many-fold.

Once I get the request processed and acknowledged, I'll suggest we should be targeting a Scoping Meeting as early in December as we can make it, with a view to getting reality restored by the start of the year. Anyway, a heads-up we have a high-visibility project on our hands that may rapidly escalate to public controversy at a high level.

Nick

Nick Peck

LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Cosola, Anna M - TPC-TPP-4
Sent: Tuesday, November 17, 2009 1:23 PM
To: Peck, Nick - TPC-TPP-4
Cc: Ream, John R - TPC-TPP-4
Subject: RE: do you know

That's pretty interesting... I'm gonna ask Nick.

Nick...have you seen or heard anything about this?

From: Ream, John R - TPC-TPP-4
Sent: Tuesday, November 17, 2009 1:15 PM
To: Cosola, Anna M - TPC-TPP-4
Subject: do you know

Is BPA involved in this project at all?

http://seattletimes.nwsourc.com/html/localnews/2010182322_apwasolarpower.html?syndication=rss

Fiedler,Paul A - TPC-TPP-4

From: Peck,Nick - TPC-TPP-4
Sent: Tuesday, November 17, 2009 1:48 PM
To: Fiedler,Paul A - TPC-TPP-4; DeClerck,Angela - TSE-TPP-2
Cc: Johnson,Kelly G - TPC-TPP-4; Cosola,Anna M - TPC-TPP-4; Ream,John R - TPC-TPP-4; Gilliland,Kimberly D - TSES-TPP-2
Subject: G0393: Teanaway Solar project FW: do you know

Paul and Angela:

Anna and John shared this link (see end of email) from the Seattle Times (originally Yakima Herald story) from a couple of weeks ago – and thanks, both, for sharing! The request coincidentally arrived today.

The key element in this is the over-the-top PR spiel coming from both Trott (the principal) and Aldrich, the consulting advisor for politics, policy and PR. Just this line (“For Trott to make a planned construction start date of April next year he’s going to need commitments from buyers - namely big utility companies”) sends warning shivers down my spine. It gets better: “Renewable energy advocates around the state are rooting for the Cle Elum project, including Sen. Maria Cantwell, D-Wash., and Rep. Jay Inslee, D-Bainbridge Island.” If you have not already done so, a couple of minutes exploring <http://www.strategies360.com/> will help develop an understanding of the advice and support Mr. Trott is buying; it will likely outperform CEP many-fold.

Once I get the request processed and acknowledged, I’ll suggest we should be targeting a Scoping Meeting as early in December as we can make it, with a view to getting reality restored by the start of the year.

Anyway, a heads-up we have a high-visibility project on our hands that may rapidly escalate to public controversy at a high level.

Nick

Nick Peck

LGIP Administrator

TPC/TPP-4

Tel: (360) 619-6419

Fax: (360) 619-6070

Cell: (360) 980-2183

Text: 3609802183@vtext.com

From: Cosola,Anna M - TPC-TPP-4
Sent: Tuesday, November 17, 2009 1:23 PM
To: Peck,Nick - TPC-TPP-4
Cc: Ream,John R - TPC-TPP-4
Subject: RE: do you know

That’s pretty interesting... I’m gonna ask Nick.

Nick...have you seen or heard anything about this?

From: Ream,John R - TPC-TPP-4
Sent: Tuesday, November 17, 2009 1:15 PM
To: Cosola,Anna M - TPC-TPP-4
Subject: do you know

Is BPA involved in this project at all?

http://seattletimes.nwsourc.com/html/localnews/2010182322_apwasolarpower.html?syndication=rss

Fiedler,Paul A - TPC-TPP-4

From: Bingaman,Claire D - KEC-4
Sent: Tuesday, November 17, 2009 1:30 PM
To: Peck,Nick - TPC-TPP-4
Cc: Lynard,Gene P - KEC-4
Subject: RE: G0393 NEW LGI Request 75 MW Solar project

Excellent!

Claire Bingaman

office: 503.230.5922 | fax: 503.230.5699

From: Peck,Nick - TPC-TPP-4
Sent: Tuesday, November 17, 2009 1:29 PM
To: Bingaman,Claire D - KEC-4
Cc: Lynard,Gene P - KEC-4
Subject: RE: G0393 NEW LGI Request 75 MW Solar project

Yup. It will be a political nightmare.

Nick Peck

LGIP Administrator

TPC/TPP-4

Tel: (360) 619-6419

Fax: (360) 619-6070

Cell: (360) 980-2183

Text: 3609802183@vtext.com

From: Bingaman,Claire D - KEC-4
Sent: Tuesday, November 17, 2009 1:27 PM
To: Peck,Nick - TPC-TPP-4
Cc: Lynard,Gene P - KEC-4
Subject: RE: G0393 NEW LGI Request 75 MW Solar project

Hey Nick,

I will be the EC lead for this project. Anything you can tell me about it thus far?

~Claire

Claire Bingaman

office: 503.230.5922 | fax: 503.230.5699

From: Lynard,Gene P - KEC-4
Sent: Tuesday, November 17, 2009 1:21 PM
To: Bingaman,Claire D - KEC-4
Subject: FW: G0393 NEW LGI Request 75 MW Solar project
Importance: High

Here it is.

From: Peck,Nick - TPC-TPP-4
Sent: Tuesday, November 17, 2009 1:05 PM
To: Adams,Nicole A - TSE-TPP-2; Beck,Gary O - TEP-TPP-1; Berry,Theresa M - TEP-TPP-3; Blanco,Carlos - TSES-TPP-2; Campbell,Reed L - TPC-PASCO; Chong Tim,Marcus H - LT-7; Cook,Jeffrey W - TPM-OPP-3; Cosola,Anna M - TPC-TPP-4;

Czerwinski, Marilyn J - TSES-TPP-2; DeClerck, Angela - TSE-TPP-2; Enyeart, Stephen H - TPC-TPP-4; Fiedler, Paul A - TPC-TPP-4; Fitzsimmons, David A - TSE-TPP-2; Freel, Amy M - TEP-CSB-2; Furumasu, Larry A - TPP-OPP-3; Gibson, Mindy M - TSE-TPP-2; Gilliland, Kimberly D - TSES-TPP-2; Gingrich, Jennifer A - LT-7; Ha, Anita L - TPP-OPP-3; Hall, James L - TPC-TPP-4; Hensley, Stacie R - TER-3; Hollen, Bruce A - KEC-4; Holst, Michele R - TEP-TPP-2; Howard, Paula L - TSES-TPP-2; Huss, Steve - TSRS-DITT-1; Johnson, Anders L - TPP-OPP-3; Johnson, Danielle M - TSRS-DITT-1; Johnson, Kelly G - TPC-TPP-4; Larvick, Carol M - TPM-OPP-3; Luiz, Johny - TEP-CSB-2; Lynard, Gene P - KEC-4; Mainzer, Elliot E - S-7; Matthews, Chuck - TPP-OPP-3; Miller, Mike P - TECC-CSB-2; Moyer, Robert B - TPC-TPP-4; Peck, Nick - TPC-TPP-4; Perkins, Matthew W - LT-7; Radcliff, Tony P - TPP-OPP-3; Randall, Cherilyn C - TPC-TPP-4; Rogers-Holliday, Kammy - KSK-4; Russell, Glenn A - TPC-TPP-4; Sauer, Dena J - TPC-TPP-4; Schulz, Christina A - TPP-OPP-3; Shaw, Cynthia E - TEP-TPP-2; Stevens, Dennis A - TPP-OPP-3; Sundborg, Sara D - TOT-DITT2; Taylor, Eric K - TSE-TPP-2; Taylor, Jennifer L - TSS-DITT-1; Van Cleave, Tonya M - TPC-TPP-4; VanAntwerp, Sheila L - TSE-TPP-2; VanderZanden, Deedee - TSES-TPP-2; Vaughn, Shauna L - TSES-TPP-2; Wachsmann, Tara L - DGF-7; Weaver, John W - TPC-TPP-4; Wiese, Christine L - TSE-TPP-2; Wilson, Jenny - TPP-OPP-3

Cc: Patterson, Holly H - DN-Z992; Gallagher-Reiter, Melissa R - DN-Z992

Subject: G0393 NEW LGI Request 75 MW Solar project

Importance: High

This e-mail and any attached document contains information deemed Confidential under Attachment L to the OATT (the LGIP), and information protected by SOC rules.

Undesignated employees are prohibited from acting as a conduit by disclosing this e-mail or any attached document to Merchant Function employees or to any third parties.

Today we received the solar large generation interconnection request detailed below. Some of you may recall reading about this project first in Clearing Up in July. Note that the proposed in-service date is the *requested* date only.

This is the sixth interconnection request received so far this November, a month that so far has added 1,304 MW to the queue that is approaching something like +/- 20 Gigawatts of generation under study or in design/construction.

G0393	Generator Interconnection
Point of Interconnection	BPA's Rocky Reach to Maple Valley 345 kV transmission line in the vicinity of Cle Elum, Washington
In-service date	December 15, 2010
Summer MW	75 MW
Winter MW	75 MW
Request Date/Time	11/17/09 at 9:30 a.m.
Status	Received
Location	Kittitas County, Wash.
Type of Interconnection	NRIS
Type of Generating Facility	Solar
Related transmission request	na
Customer	Teaway Solar Reserve, LLC
Project	Teaway Solar Reserve

Please add into Internal Comments: Customer data being entered for Teaway Solar Reserve, LLC

Nick Peck

LGIP Administrator

TPC/TPP-4

Tel: (360) 619-6419

Fax: (360) 619-6070

Cell: (360) 980-2183

Text: 3609802183@vtext.com

Fiedler,Paul A - TPC-TPP-4

From: Peck,Nick - TPC-TPP-4
Sent: Tuesday, November 17, 2009 1:29 PM
To: Bingaman,Claire D - KEC-4
Cc: Lynard,Gene P - KEC-4
Subject: RE: G0393 NEW LGI Request 75 MW Solar project

Yup. It will be a political nightmare.

Nick Peck

LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Bingaman,Claire D - KEC-4
Sent: Tuesday, November 17, 2009 1:27 PM
To: Peck,Nick - TPC-TPP-4
Cc: Lynard,Gene P - KEC-4
Subject: RE: G0393 NEW LGI Request 75 MW Solar project

Hey Nick,

I will be the EC lead for this project. Anything you can tell me about it thus far?

~Claire

Claire Bingaman

office: 503.230.5922 | fax: 503.230.5699

From: Lynard,Gene P - KEC-4
Sent: Tuesday, November 17, 2009 1:21 PM
To: Bingaman,Claire D - KEC-4
Subject: FW: G0393 NEW LGI Request 75 MW Solar project
Importance: High

Here it is.

From: Peck,Nick - TPC-TPP-4
Sent: Tuesday, November 17, 2009 1:05 PM
To: Adams,Nicole A - TSE-TPP-2; Beck,Gary O - TEP-TPP-1; Berry,Theresa M - TEP-TPP-3; Blanco,Carlos - TSES-TPP-2; Campbell,Reed L - TPC-PASCO; Chong Tim,Marcus H - LT-7; Cook,Jeffrey W - TPM-OPP-3; Cosola,Anna M - TPC-TPP-4; Czerwinski,Marilyn J - TSES-TPP-2; DeClerck,Angela - TSE-TPP-2; Enyeart,Stephen H - TPC-TPP-4; Fiedler,Paul A - TPC-TPP-4; Fitzsimmons,David A - TSE-TPP-2; Freel,Amy M - TEP-CSB-2; Furumasu,Larry A - TPP-OPP-3; Gibson,Mindy M - TSE-TPP-2; Gilliland,Kimberly D - TSES-TPP-2; Gingrich,Jennifer A - LT-7; Ha,Anita L - TPP-OPP-3; Hall,James L - TPC-TPP-4; Hensley,Stacie R - TER-3; Hollen,Bruce A - KEC-4; Holst,Michele R - TEP-TPP-2; Howard,Paula L - TSES-TPP-2; Huss,Steve - TSRS-DITT-1; Johnson,Anders L - TPP-OPP-3; Johnson,Danielle M - TSRS-DITT-1; Johnson,Kelly G - TPC-TPP-4; Larvick,Carol M - TPM-OPP-3; Luiz,Johny - TEP-CSB-2; Lynard,Gene P - KEC-4; Mainzer,Elliot E - S-7; Matthews,Chuck - TPP-OPP-3; Miller,Mike P - TECC-CSB-2; Moyer,Robert B - TPC-TPP-4; Peck,Nick - TPC-TPP-4; Perkins,Matthew W - LT-7; Radcliff,Tony P - TPP-OPP-3; Randall,Cherilyn C - TPC-TPP-4; Rogers-Holliday,Kammy - KSK-4; Russell,Glenn A - TPC-TPP-4; Sauer,Dena J - TPC-TPP-4; Schulz,Christina A - TPP-OPP-3; Shaw,Cynthia E - TEP-TPP-2; Stevens,Dennis A - TPP-OPP-3; Sundborg,Sara D - TOT-DITT2; Taylor,Eric K - TSE-TPP-2; Taylor,Jennifer L - TSS-DITT-1; Van Cleave,Tonya M - TPC-TPP-4; VanAntwerp,Sheila L - TSE-TPP-2; VanderZanden,Deedee - TSES-TPP-2;

Vaughn,Shauna L - TSES-TPP-2; Wachsmann,Tara L - DGF-7; Weaver,John W - TPC-TPP-4; Wiese,Christine L - TSE-TPP-2; Wilson,Jenny - TPP-OPP-3

Cc: Patterson,Holly H - DN-Z992; Gallagher-Reiter,Melissa R - DN-Z992

Subject: G0393 NEW LGI Request 75 MW Solar project

Importance: High

This e-mail and any attached document contains information deemed Confidential under Attachment L to the OATT (the LGIP), and information protected by SOC rules.

Undesignated employees are prohibited from acting as a conduit by disclosing this e-mail or any attached document to Merchant Function employees or to any third parties.

Today we received the solar large generation interconnection request detailed below. Some of you may recall reading about this project first in Clearing Up in July. Note that the proposed in-service date is the *requested* date only.

This is the sixth interconnection request received so far this November, a month that so far has added 1,304 MW to the queue that is approaching something like +/- 20 Gigawatts of generation under study or in design/construction.

G0393	Generator Interconnection
Point of Interconnection	BPA's Rocky Reach to Maple Valley 345 kV transmission line in the vicinity of Cle Elum, Washington
In-service date	December 15, 2010
Summer MW	75 MW
Winter MW	75 MW
Request Date/Time	11/17/09 at 9:30 a.m.
Status	Received
Location	Kittitas County, Wash.
Type of Interconnection	NRIS
Type of Generating Facility	Solar
Related transmission request	na
Customer	Teaway Solar Reserve, LLC
Project	Teaway Solar Reserve

Please add into Internal Comments: Customer data being entered for Teaway Solar Reserve, LLC

Nick Peck

LGIP Administrator

TPC/TPP-4

Tel: (360) 619-6419

Fax: (360) 619-6070

Cell: (360) 980-2183

Text: 3609802183@vtext.com

Fiedler,Paul A - TPC-TPP-4

From: Cosola,Anna M - TPC-TPP-4
Sent: Tuesday, November 17, 2009 1:25 PM
To: Peck,Nick - TPC-TPP-4; Ream,John R - TPC-TPP-4
Subject: RE: G0393 NEW LGI Request 75 MW Solar project

That's hilarious!! I hadn't opened your e-mail yet.. but if I had...perfect timing!!!

From: Peck,Nick - TPC-TPP-4
Sent: Tuesday, November 17, 2009 1:24 PM
To: Cosola,Anna M - TPC-TPP-4; Ream,John R - TPC-TPP-4
Subject: FW: G0393 NEW LGI Request 75 MW Solar project
Importance: High

Funny you should ask....

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Peck,Nick - TPC-TPP-4
Sent: Tuesday, November 17, 2009 1:05 PM
To: Adams,Nicole A - TSE-TPP-2; Beck,Gary O - TEP-TPP-1; Berry,Theresa M - TEP-TPP-3; Blanco,Carlos - TSES-TPP-2; Campbell,Reed L - TPC-PASCO; Chong Tim,Marcus H - LT-7; Cook,Jeffrey W - TPM-OPP-3; Cosola,Anna M - TPC-TPP-4; Czerwinski,Marilyn J - TSES-TPP-2; DeClerck,Angela - TSE-TPP-2; Enyeart,Stephen H - TPC-TPP-4; Fiedler,Paul A - TPC-TPP-4; Fitzsimmons,David A - TSE-TPP-2; Freel,Amy M - TEP-CSB-2; Furumasu,Larry A - TPP-OPP-3; Gibson,Mindy M - TSE-TPP-2; Gilliland,Kimberly D - TSES-TPP-2; Gingrich,Jennifer A - LT-7; Ha,Anita L - TPP-OPP-3; Hall,James L - TPC-TPP-4; Hensley,Stacie R - TER-3; Hollen,Bruce A - KEC-4; Holst,Michele R - TEP-TPP-2; Howard,Paula L - TSES-TPP-2; Huss,Steve - TSRS-DITT-1; Johnson,Anders L - TPP-OPP-3; Johnson,Danielle M - TSRS-DITT-1; Johnson,Kelly G - TPC-TPP-4; Larvick,Carol M - TPM-OPP-3; Luiz,Johny - TEP-CSB-2; Lynard,Gene P - KEC-4; Mainzer,Elliot E - S-7; Matthews,Chuck - TPP-OPP-3; Miller,Mike P - TECC-CSB-2; Moyer,Robert B - TPC-TPP-4; Peck,Nick - TPC-TPP-4; Perkins,Matthew W - LT-7; Radcliff,Tony P - TPP-OPP-3; Randall,Cherilyn C - TPC-TPP-4; Rogers-Holliday,Kammy - KSK-4; Russell,Glenn A - TPC-TPP-4; Sauer,Dena J - TPC-TPP-4; Schulz,Christina A - TPP-OPP-3; Shaw,Cynthia E - TEP-TPP-2; Stevens,Dennis A - TPP-OPP-3; Sundborg,Sara D - TOT-DITT2; Taylor,Eric K - TSE-TPP-2; Taylor,Jennifer L - TSS-DITT-1; Van Cleave,Tonya M - TPC-TPP-4; VanAntwerp,Sheila L - TSE-TPP-2; VanderZanden,Deedee - TSES-TPP-2; Vaughn,Shauna L - TSES-TPP-2; Wachsmann,Tara L - DGF-7; Weaver,John W - TPC-TPP-4; Wiese,Christine L - TSE-TPP-2; Wilson,Jenny - TPP-OPP-3
Cc: Patterson,Holly H - DN-Z992; Gallagher-Reiter,Melissa R - DN-Z992
Subject: G0393 NEW LGI Request 75 MW Solar project
Importance: High

This e-mail and any attached document contains information deemed Confidential under Attachment L to the OATT (the LGIP), and information protected by SOC rules.

Undesignated employees are prohibited from acting as a conduit by disclosing this e-mail or any attached document to Merchant Function employees or to any third parties.

Today we received the solar large generation interconnection request detailed below. Some of you may recall reading about this project first in Clearing Up in July. Note that the proposed in-service date is the *requested* date only.

This is the sixth interconnection request received so far this November, a month that so far has added 1,304 MW to the queue that is approaching something like +/- 20 Gigawatts of generation under study or in design/construction.

G0393	Generator Interconnection
Point of Interconnection	BPA's Rocky Reach to Maple Valley 345 kV transmission line in the vicinity of Cle Elum, Washington
In-service date	December 15, 2010
Summer MW	75 MW
Winter MW	75 MW
Request Date/Time	11/17/09 at 9:30 a.m.
Status	Received
Location	Kittitas County, Wash.
Type of Interconnection	NRIS
Type of Generating Facility	Solar
Related transmission request	na
Customer	Teanaway Solar Reserve, LLC
Project	Teanaway Solar Reserve

Please add into Internal Comments: Customer data being entered for Teanaway Solar Reserve, LLC

Nick Peck

LGIP Administrator
 TPC/TPP-4
 Tel: (360) 619-6419
 Fax: (360) 619-6070
 Cell: (360) 980-2183
 Text: 3609802183@vtext.com

Fiedler,Paul A - TPC-TPP-4

From: Peck,Nick - TPC-TPP-4
Sent: Tuesday, November 17, 2009 1:24 PM
To: Cosola,Anna M - TPC-TPP-4; Ream,John R - TPC-TPP-4
Subject: FW: G0393 NEW LGI Request 75 MW Solar project

Importance: High

Funny you should ask....

Nick Peck

LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Peck,Nick - TPC-TPP-4

Sent: Tuesday, November 17, 2009 1:05 PM

To: Adams,Nicole A - TSE-TPP-2; Beck,Gary O - TEP-TPP-1; Berry,Theresa M - TEP-TPP-3; Blanco,Carlos - TSES-TPP-2; Campbell,Reed L - TPC-PASCO; Chong Tim,Marcus H - LT-7; Cook,Jeffrey W - TPM-OPP-3; Cosola,Anna M - TPC-TPP-4; Czerwinski,Marilyn J - TSES-TPP-2; DeClerck,Angela - TSE-TPP-2; Enyeart,Stephen H - TPC-TPP-4; Fiedler,Paul A - TPC-TPP-4; Fitzsimmons,David A - TSE-TPP-2; Freel,Amy M - TEP-CSB-2; Furumasu,Larry A - TPP-OPP-3; Gibson,Mindy M - TSE-TPP-2; Gilliland,Kimberly D - TSES-TPP-2; Gingrich,Jennifer A - LT-7; Ha,Anita L - TPP-OPP-3; Hall,James L - TPC-TPP-4; Hensley,Stacie R - TER-3; Hollen,Bruce A - KEC-4; Holst,Michele R - TEP-TPP-2; Howard,Paula L - TSES-TPP-2; Huss,Steve - TSRS-DITT-1; Johnson,Anders L - TPP-OPP-3; Johnson,Danielle M - TSRS-DITT-1; Johnson,Kelly G - TPC-TPP-4; Larvick,Carol M - TPM-OPP-3; Luiz,Johny - TEP-CSB-2; Lynard,Gene P - KEC-4; Mainzer,Elliot E - S-7; Matthews,Chuck - TPP-OPP-3; Miller,Mike P - TECC-CSB-2; Moyer,Robert B - TPC-TPP-4; Peck,Nick - TPC-TPP-4; Perkins,Matthew W - LT-7; Radcliff,Tony P - TPP-OPP-3; Randall,Cherilyn C - TPC-TPP-4; Rogers-Holliday,Kammy - KSK-4; Russell,Glenn A - TPC-TPP-4; Sauer,Dena J - TPC-TPP-4; Schulz,Christina A - TPP-OPP-3; Shaw,Cynthia E - TEP-TPP-2; Stevens,Dennis A - TPP-OPP-3; Sundborg,Sara D - TOT-DITT2; Taylor,Eric K - TSE-TPP-2; Taylor,Jennifer L - TSS-DITT-1; Van Cleave,Tonya M - TPC-TPP-4; VanAntwerp,Sheila L - TSE-TPP-2; VanderZanden,Deedee - TSES-TPP-2; Vaughn,Shauna L - TSES-TPP-2; Wachsmann,Tara L - DGF-7; Weaver,John W - TPC-TPP-4; Wiese,Christine L - TSE-TPP-2; Wilson,Jenny - TPP-OPP-3

Cc: Patterson,Holly H - DN-Z992; Gallagher-Reiter,Melissa R - DN-Z992

Subject: G0393 NEW LGI Request 75 MW Solar project

Importance: High

This e-mail and any attached document contains information deemed Confidential under Attachment L to the OATT (the LGIP), and information protected by SOC rules.

Undesignated employees are prohibited from acting as a conduit by disclosing this e-mail or any attached document to Merchant Function employees or to any third parties.

Today we received the solar large generation interconnection request detailed below. Some of you may recall reading about this project first in Clearing Up in July. Note that the proposed in-service date is the *requested* date only.

This is the sixth interconnection request received so far this November, a month that so far has added 1,304 MW to the queue that is approaching something like +/- 20 Gigawatts of generation under study or in design/construction.

G0393	Generator Interconnection
Point of Interconnection	BPA's Rocky Reach to Maple Valley 345 kV transmission line in the vicinity of Cle Elum, Washington
In-service date	December 15, 2010

Summer MW	75 MW
Winter MW	75 MW
Request Date/Time	11/17/09 at 9:30 a.m.
Status	Received
Location	Kittitas County, Wash.
Type of Interconnection	NRIS
Type of Generating Facility	Solar
Related transmission request	na
Customer	Teaway Solar Reserve, LLC
Project	Teaway Solar Reserve

Please add into Internal Comments: Customer data being entered for Teaway Solar Reserve, LLC

Nick Peck

LGIP Administrator

TPC/TPP-4

Tel: (360) 619-6419

Fax: (360) 619-6070

Cell: (360) 980-2183

Text: 3609802183@vtext.com

Fiedler,Paul A - TPC-TPP-4

From: Clinton,Penny - NWPP-AMPN-1
Sent: Tuesday, November 17, 2009 1:10 PM
To: Peck,Nick - TPC-TPP-4
Subject: RE: G0393 NEW LGI Request 75 MW Solar project

Oh my! Very interesting! Thanks for sharing~

Penny Clinton

Ross Mailroom
NWPP-AMPN-1
OFFICE: 418-2087
CELL: 852-3937

From: Peck,Nick - TPC-TPP-4
Sent: Tuesday, November 17, 2009 1:08 PM
To: Clinton,Penny - NWPP-AMPN-1
Subject: FW: G0393 NEW LGI Request 75 MW Solar project
Importance: High

Thought you might enjoy this: it's what was inside the envelope you retrieved and had carried over to me.

(Just for the record, this is internal-only not to be shared please!)

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Peck,Nick - TPC-TPP-4
Sent: Tuesday, November 17, 2009 1:05 PM
To: **Subject:** G0393 NEW LGI Request 75 MW Solar project
Importance: High

This e-mail and any attached document contains information deemed Confidential under Attachment L to the OATT (the LGIP), and information protected by SOC rules.

Undesignated employees are prohibited from acting as a conduit by disclosing this e-mail or any attached document to Merchant Function employees or to any third parties.

Today we received the solar large generation interconnection request detailed below. Some of you may recall reading about this project first in Clearing Up in July. Note that the proposed in-service date is the *requested* date only.

This is the sixth interconnection request received so far this November, a month that so far has added 1,304 MW to the queue that is approaching something like +/- 20 Gigawatts of generation under study or in design/construction.

G0393	Generator Interconnection
Point of Interconnection	BPA's Rocky Reach to Maple Valley 345 kV transmission line in the vicinity of Cle Elum, Washington
In-service date	December 15, 2010

Summer MW	75 MW
Winter MW	75 MW
Request Date/Time	11/17/09 at 9:30 a.m.
Status	Received
Location	Kittitas County, Wash.
Type of Interconnection	NRIS
Type of Generating Facility	Solar
Related transmission request	na
Customer	
Project	

Please add into Internal Comments: Customer data being entered for ...

Nick Peck

LGIP Administrator

TPC/TPP-4

Tel: (360) 619-6419

Fax: (360) 619-6070

Cell: (360) 980-2183

Text: 3609802183@vtext.com

Fiedler,Paul A - TPC-TPP-4

From: Peck,Nick - TPC-TPP-4
Sent: Tuesday, November 17, 2009 1:08 PM
To: Clinton,Penny - NWPP-AMPN-1
Subject: FW: G0393 NEW LGI Request 75 MW Solar project

Importance: High

Thought you might enjoy this: it's what was inside the envelope you retrieved and had carried over to me.

(Just for the record, this is internal-only not to be shared please!)

Nick Peck

LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Peck,Nick - TPC-TPP-4
Sent: Tuesday, November 17, 2009 1:05 PM
To: Subject: G0393 NEW LGI Request 75 MW Solar project
Importance: High

This e-mail and any attached document contains information deemed Confidential under Attachment L to the OATT (the LGIP), and information protected by SOC rules.

Undesignated employees are prohibited from acting as a conduit by disclosing this e-mail or any attached document to Merchant Function employees or to any third parties.

Today we received the solar large generation interconnection request detailed below. Some of you may recall reading about this project first in Clearing Up in July. Note that the proposed in-service date is the *requested* date only.

This is the sixth interconnection request received so far this November, a month that so far has added 1,304 MW to the queue that is approaching something like +/- 20 Gigawatts of generation under study or in design/construction.

G0393	Generator Interconnection
Point of Interconnection	BPA's Rocky Reach to Maple Valley 345 kV transmission line in the vicinity of Cle Elum, Washington
In-service date	December 15, 2010
Summer MW	75 MW
Winter MW	75 MW
Request Date/Time	11/17/09 at 9:30 a.m.
Status	Received
Location	Kittitas County, Wash.
Type of Interconnection	NRIS

Type of Generating Facility	Solar
Related transmission request	na
Customer	
Project	

Please add into Internal Comments: Customer data being entered for ...

Nick Peck

LGIP Administrator

TPC/TPP-4

Tel: (360) 619-6419

Fax: (360) 619-6070

Cell: (360) 980-2183

Text: 3609802183@vtext.com

Fiedler,Paul A - TPC-TPP-4

From: Peck,Nick - TPC-TPP-4
Sent: Tuesday, November 17, 2009 1:05 PM
To: Adams,Nicole A - TSE-TPP-2; Beck,Gary O - TEP-TPP-1; Berry,Theresa M - TEP-TPP-3; Blanco,Carlos - TSES-TPP-2; Campbell,Reed L - TPC-PASCO; Chong Tim,Marcus H - LT-7; Cook,Jeffrey W - TPM-OPP-3; Cosola,Anna M - TPC-TPP-4; Czerwinski,Marilyn J - TSES-TPP-2; DeClerck,Angela - TSE-TPP-2; Enyeart,Stephen H - TPC-TPP-4; Fiedler,Paul A - TPC-TPP-4; Fitzsimmons,David A - TSE-TPP-2; Freel,Amy M - TEP-CSB-2; Furumasu,Larry A - TPP-OPP-3; Gibson,Mindy M - TSE-TPP-2; Gilliland,Kimberly D - TSES-TPP-2; Gingrich,Jennifer A - LT-7; Ha,Anita L - TPP-OPP-3; Hall,James L - TPC-TPP-4; Hensley,Stacie R - TER-3; Hollen,Bruce A - KEC-4; Holst,Michele R - TEP-TPP-2; Howard,Paula L - TSES-TPP-2; Huss,Steve - TSRS-DITT-1; Johnson,Anders L - TPP-OPP-3; Johnson,Danielle M - TSRS-DITT-1; Johnson,Kelly G - TPC-TPP-4; Larvick,Carol M - TPM-OPP-3; Luiz,Johny - TEP-CSB-2; Lynard,Gene P - KEC-4; Mainzer,Elliot E - S-7; Matthews,Chuck - TPP-OPP-3; Miller,Mike P - TECP-AMPN-1; Moyer,Robert B - TPC-TPP-4; Peck,Nick - TPC-TPP-4; Perkins,Matthew W - LT-7; Radcliff,Tony P - TPP-OPP-3; Randall,Cherilyn C - TPC-TPP-4; Rogers-Holliday,Kammy - KSK-4; Russell,Glenn A - TPC-TPP-4; Sauer,Dena J - TPC-TPP-4; Schulz,Christina A - TPP-OPP-3; Shaw,Cynthia E - TEP-TPP-2; Stevens,Dennis A - TPP-OPP-3; Sundborg,Sara D - TOT-DITT2; Taylor,Eric K - TSE-TPP-2; Taylor,Jennifer L - TSS-DITT-1; Van Cleave,Tonya M - TPC-TPP-4; VanAntwerp,Sheila L - TSE-TPP-2; VanderZanden,Deedee - TSES-TPP-2; Vaughn,Shauna L - TSES-TPP-2; Wachsmann,Tara L - DGF-7; Weaver,John W - TPC-TPP-4; Wiese,Christine L - TSE-TPP-2; Wilson,Jenny - TPP-OPP-3
Cc: Patterson,Holly H - DN-Z992; Gallagher-Reiter,Melissa R - DN-Z992
Subject: G0393 NEW LGI Request 75 MW Solar project

Importance: High

This e-mail and any attached document contains information deemed Confidential under Attachment L to the OATT (the LGIP), and information protected by SOC rules.

Undesignated employees are prohibited from acting as a conduit by disclosing this e-mail or any attached document to Merchant Function employees or to any third parties.

Today we received the solar large generation interconnection request detailed below. Some of you may recall reading about this project first in Clearing Up in July. Note that the proposed in-service date is the *requested* date only.

This is the sixth interconnection request received so far this November, a month that so far has added 1,304 MW to the queue that is approaching something like +/- 20 Gigawatts of generation under study or in design/construction.

G0393	Generator Interconnection
Point of Interconnection	BPA's Rocky Reach to Maple Valley 345 kV transmission line in the vicinity of Cle Elum, Washington
In-service date	December 15, 2010
Summer MW	75 MW
Winter MW	75 MW
Request Date/Time	11/17/09 at 9:30 a.m.
Status	Received
Location	Kittitas County, Wash.
Type of Interconnection	NRIS

Type of Generating Facility	Solar
Related transmission request	na
Customer	Teaway Solar Reserve, LLC
Project	Teaway Solar Reserve

Please add into Internal Comments: Customer data being entered for Teaway Solar Reserve, LLC

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

Fiedler,Paul A - TPC-TPP-4

From: Peck,Nick - TPC-TPP-4
Sent: Tuesday, November 17, 2009 1:05 PM
To: Adams,Nicole A - TSE-TPP-2; Beck,Gary O - TEP-TPP-1; Berry,Theresa M - TEP-TPP-3; Blanco,Carlos - TSES-TPP-2; Campbell,Reed L - TPC-PASCO; Chong Tim,Marcus H - LT-7; Cook,Jeffrey W - TPM-OPP-3; Cosola,Anna M - TPC-TPP-4; Czerwinski,Marilyn J - TSES-TPP-2; DeClerck,Angela - TSE-TPP-2; Enyeart,Stephen H - TPC-TPP-4; Fiedler,Paul A - TPC-TPP-4; Fitzsimmons,David A - TSE-TPP-2; Freel,Amy M - TEP-CSB-2; Furumasu,Larry A - TPP-OPP-3; Gibson,Mindy M - TSE-TPP-2; Gilliland,Kimberly D - TSES-TPP-2; Gingrich,Jennifer A - LT-7; Ha,Anita L - TPP-OPP-3; Hall,James L - TPC-TPP-4; Hensley,Stacie R - TER-3; Hollen,Bruce A - KEC-4; Holst,Michele R - TEP-TPP-2; Howard,Paula L - TSES-TPP-2; Huss,Steve - TSRS-DITT-1; Johnson,Anders L - TPP-OPP-3; Johnson,Danielle M - TSRS-DITT-1; Johnson,Kelly G - TPC-TPP-4; Larvick,Carol M - TPM-OPP-3; Luiz,Johny - TEP-CSB-2; Lynard,Gene P - KEC-4; Mainzer,Elliot E - S-7; Matthews,Chuck - TPP-OPP-3; Miller,Mike P - TECC-CSB-2; Moyer,Robert B - TPC-TPP-4; Peck,Nick - TPC-TPP-4; Perkins,Matthew W - LT-7; Radcliff,Tony P - TPP-OPP-3; Randall,Cherilyn C - TPC-TPP-4; Rogers-Holliday,Kammy - KSK-4; Russell,Glenn A - TPC-TPP-4; Sauer,Dena J - TPC-TPP-4; Schulz,Christina A - TPP-OPP-3; Shaw,Cynthia E - TEP-TPP-2; Stevens,Dennis A - TPP-OPP-3; Sundborg,Sara D - TOT-DITT2; Taylor,Eric K - TSE-TPP-2; Taylor,Jennifer L - TSS-DITT-1; Van Cleave,Tonya M - TPC-TPP-4; VanAntwerp,Sheila L - TSE-TPP-2; VanderZanden,Deedee - TSES-TPP-2; Vaughn,Shauna L - TSES-TPP-2; Wachsmann,Tara L - DGF-7; Weaver,John W - TPC-TPP-4; Wiese,Christine L - TSE-TPP-2; Wilson,Jenny - TPP-OPP-3
Cc: Patterson,Holly H - DN-Z992; Gallagher-Reiter,Melissa R - DN-Z992
Subject: G0393 NEW LGI Request 75 MW Solar project

Importance: High

This e-mail and any attached document contains information deemed Confidential under Attachment L to the OATT (the LGIP), and information protected by SOC rules.

Undesignated employees are prohibited from acting as a conduit by disclosing this e-mail or any attached document to Merchant Function employees or to any third parties.

Today we received the solar large generation interconnection request detailed below. Some of you may recall reading about this project first in Clearing Up in July. Note that the proposed in-service date is the *requested* date only.

This is the sixth interconnection request received so far this November, a month that so far has added 1,304 MW to the queue that is approaching something like +/- 20 Gigawatts of generation under study or in design/construction.

G0393	Generator Interconnection
Point of Interconnection	BPA's Rocky Reach to Maple Valley 345 kV transmission line in the vicinity of Cle Elum, Washington
In-service date	December 15, 2010
Summer MW	75 MW
Winter MW	75 MW
Request Date/Time	11/17/09 at 9:30 a.m.
Status	Received
Location	Kittitas County, Wash.
Type of Interconnection	NRIS

Type of Generating Facility	Solar
Related transmission request	na
Customer	Teaway Solar Reserve, LLC
Project	Teaway Solar Reserve

Please add into Internal Comments: Customer data being entered for Teaway Solar Reserve, LLC

Nick Peck

LGIP Administrator

TPC/TPP-4

Tel: (360) 619-6419

Fax: (360) 619-6070

Cell: (360) 980-2183

Text: 3609802183@vtext.com

Fiedler,Paul A - TPC-TPP-4

From: Tueller,Beverly R - TPC-TPP-4
Sent: Tuesday, November 17, 2009 12:06 PM
To: Peck,Nick - TPC-TPP-4
Subject: OneTouch Nov 17, 2009 (1).PDF

Attachments: OneTouch Nov 17, 2009 (1).PDF



OneTouch Nov 17,
2009 (1).PDF ...

neTouch Nov 17, 2009 (1).PDF

Fiedler,Paul A - TPC-TPP-4

From: Peck,Nick - TPC-TPP-4
Sent: Thursday, December 17, 2009 10:52 AM
To: 'Howard Trott'
Cc: 'Al Aldrich'; 'Michael Raschio'; Fiedler,Paul A - TPC-TPP-4; DeClerck,Angela - TSE-TPP-2; Andrews,Page S - TPC-TPP-4
Subject: G0393 Teanaway Solar Reserve Interconnection Request
Importance: High
Attachments: 4220.01ae.doc

Tracking:	Recipient	Delivery
	'Howard Trott'	
	'Al Aldrich'	
	'Michael Raschio'	
	Fiedler,Paul A - TPC-TPP-4	Delivered: 12/17/2009 10:52 AM
	DeClerck,Angela - TSE-TPP-2	Delivered: 12/17/2009 10:52 AM
	Andrews,Page S - TPC-TPP-4	Delivered: 12/17/2009 10:52 AM

Mr. Trott:

I do not recall seeing any Site Control documentation following the email exchanges below; if you have already sent this to us, please let me know to whom and by what carrier it was sent. To expedite matters, it would be helpful if you could in any event FAX it to me at 360-619-6070.

Furthermore, we have in the past requested that you complete and return the W9e and Vendor form for Teanaway Solar Reserve LLC. I am attaching these again (as form 4220.01ae) for your convenience. I must emphasize that we are unable to continue any processing of your request until this is attended to. Please also include a copy of the Certificate of Incorporation of Teanaway.

While we are willing to resolve administrative matters such as these informally, the issue of Site Control does require formal attention, and I am drafting a formal letter under the terms of section 3.3.3 of the Large Generator Interconnection Procedures requiring the 'cure' of this deficiency in the Request.

As soon as we have all these matters addressed, I will be happy to work with you to schedule a Scoping Meeting.

Sincerely,

Nick

Nick Peck

LGIP Administrator

TPC/TPP-4

Tel: (360) 619-6419

Fax: (360) 619-6070

Cell: (360) 980-2183

Text: 3609802183@vtext.com

From: Howard Trott [mailto: EX 6]
Sent: Monday, November 23, 2009 1:57 PM
To: Peck,Nick - TPC-TPP-4
Cc: 'Al Aldrich'; 'Michael Raschio'; Fiedler,Paul A - TPC-TPP-4; DeClerck,Angela - TSE-TPP-2
Subject: RE: G0393 Teanaway Solar Reserve Interconnection Request

Mr. Peck

I thank you for receiving our application, and I look forward to meeting you in person soon.

I do authorize you to share all communications regarding this application with Elcon Associates and S 360.

I will contact Michael Raschio today and have him respond with the Evidence of site control.

I send the additional information direct to you, but it will check with you on shipping instructions before I send.

Thanks,

Howard

From: Peck,Nick - TPC-TPP-4 [mailto:cnpeck@bpa.gov]
Sent: Monday, November 23, 2009 11:15 AM
To: Howard Trott
Cc: 'Al Aldrich'; 'Michael Raschio'; Fiedler,Paul A - TPC-TPP-4; DeClerck,Angela - TSE-TPP-2
Subject: G0393 Teanaway Solar Reserve Interconnection Request

Mr. Trott:

I look forward to working with you and your team on the generator interconnection request you have submitted to us for the Teanaway Solar Reserve Project. Before we can make any progress, there are some formalities we need to complete, and your prompt attention to these will assist us all greatly.

1: By reply, please authorize us to continue to share all communications regarding this interconnection request with Strategies360 and with Elcon Associates.

2: In section 7 of the Request you indicated Evidence of Site Control is attached; there was none included in the envelope. I can not move forward without this, or an additional deposit of \$10,000 in lieu. If we can not resolve this informally quickly, I am required to begin a formal 'cure' process. I invite you to call me as soon as possible if you have any questions or concerns about this, bearing in mind that should you submit an additional deposit in lieu of site control, both this and the initial \$10,000 deposit may in some circumstances be defined as non-refundable.

3: We require the information detailed in the attached form before we can complete documentation of your request; the W9e should be printed, signed, scanned and returned.

4: Please also provide a copy of the Certificate of Incorporation for Teanaway Solar Reserve, LLC.

Finally, before mailing any further documents to us, please contact me for precise addressing instructions, which vary depending on whether you use the USPS or an overnight delivery service.

Please note that items 2 through 4 above all require timely resolution to avoid us commencing the regulatory cure procedures described above (and referenced in the LGIP section 3.3.3).

I look forward to hearing from you shortly. In the meantime, for your reference I am attaching a scan of your original request.

12/21/2009

Very sincerely,

Nick

Nick Peck

LGIP Administrator

TPC/TPP-4

Tel: (360) 619-6419

Fax: (360) 619-6070

Cell: (360) 980-2183

Text: 3609802183@vtext.com

Fiedler,Paul A - TPC-TPP-4

From: Howard Trott EX 6
Sent: Monday, November 23, 2009 1:57 PM
To: Peck,Nick - TPC-TPP-4
Cc: 'Al Aldrich'; 'Michael Raschio'; Fiedler,Paul A - TPC-TPP-4; DeClerck,Angela - TSE-TPP-2
Subject: RE: G0393 Teanaway Solar Reserve Interconnection Request

Mr. Peck

I thank you for receiving our application, and I look forward to meeting you in person soon.

I do authorize you to share all communications regarding this application with Elcon Associates and S 360.

I will contact Michael Raschio today and have him respond with the Evidence of site control.

I send the additional information direct to you, but it will check with you on shipping instructions before I send.

Thanks,

Howard

From: Peck,Nick - TPC-TPP-4 [mailto:cnpeck@bpa.gov]
Sent: Monday, November 23, 2009 11:15 AM
To: Howard Trott
Cc: 'Al Aldrich'; 'Michael Raschio'; Fiedler,Paul A - TPC-TPP-4; DeClerck,Angela - TSE-TPP-2
Subject: G0393 Teanaway Solar Reserve Interconnection Request

Mr. Trott:

I look forward to working with you and your team on the generator interconnection request you have submitted to us for the Teanaway Solar Reserve Project. Before we can make any progress, there are some formalities we need to complete, and your prompt attention to these will assist us all greatly.

1: By reply, please authorize us to continue to share all communications regarding this interconnection request with Strategies360 and with Elcon Associates.

2: In section 7 of the Request you indicated Evidence of Site Control is attached; there was none included in the envelope. I can not move forward without this, or an additional deposit of \$10,000 in lieu. If we can not resolve this informally quickly, I am required to begin a formal 'cure' process. I invite you to call me as soon as possible if you have any questions or concerns about this, bearing in mind that should you submit an additional deposit in lieu of site control, both this and the initial \$10,000 deposit may in some circumstances be defined as non-refundable.

3: We require the information detailed in the attached form before we can complete documentation of your request; the W9e should be printed, signed, scanned and returned.

4: Please also provide a copy of the Certificate of Incorporation for Teanaway Solar Reserve, LLC.

Finally, before mailing any further documents to us, please contact me for precise addressing instructions, which vary depending on whether you use the USPS or an overnight delivery service.

Please note that items 2 through 4 above all require timely resolution to avoid us commencing the regulatory cure

12/21/2009

procedures described above (and referenced in the LGIP section 3.3.3).

I look forward to hearing from you shortly. In the meantime, for your reference I am attaching a scan of your original request.

Very sincerely,

Nick

Nick Peck

LGIP Administrator

TPC/TPP-4

Tel: (360) 619-6419

Fax: (360) 619-6070

Cell: (360) 980-2183

Text: 3609802183@vtext.com

Fiedler,Paul A - TPC-TPP-4

From: Peck,Nick - TPC-TPP-4
Sent: Monday, November 16, 2009 9:38 AM
To: 'Al Aldrich'
Subject: RE: LGIP introductory links - Teanaway Solar

Al,

I trust you had a good weekend.

We have no trace of the Request here. Have you had any luck identifying where the package was addressed, and the tracking number?

Thanks,

Nick

Nick Peck

LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Al Aldrich [mailto: EX 6]
Sent: Friday, November 13, 2009 12:18 PM
To: Peck,Nick - TPC-TPP-4
Subject: Re: LGIP introductory links - Teanaway Solar

I will try to get it.

Sent using BlackBerry

-----Original Message-----

From: Peck,Nick - TPC-TPP-4 <cnpeck@bpa.gov>
To: Al Aldrich < EX 6
Sent: Fri Nov 13 12:16:03 2009
Subject: RE: LGIP introductory links - Teanaway Solar

Al,

Any chance I can get the tracking number from the Fedex receipt?

We have three campuses in two states using three different mailing addresses and three different street addresses. Without knowing where this was sent, or to whom it was addressed, I can not realistically begin to track it down.....

12/21/2009

I realize you are somewhat caught in the middle here. Let me know if it would be simpler to steer me directly to Mr. Trott.

Thanks!!

Nick

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Al Aldrich [mailto:[EX 6](#)]
Sent: Friday, November 13, 2009 11:54 AM
To: Peck,Nick - TPC-TPP-4
Subject: Re: LGIP introductory links - Teanaway Solar

Howard told me last night that he sent the deposit and application both by FedEx, so by now they should be delivered--somewhere--to BPA. I don't know exactly where he sent it. If you stumble upon it, please let me know.

Thanks,
Al

Sent using BlackBerry

-----Original Message-----
From: Peck,Nick - TPC-TPP-4 <cnpeck@bpa.gov>
To: Al Aldrich <[EX 6](#)>
Sent: Thu Nov 12 13:59:46 2009
Subject: RE: LGIP introductory links - Teanaway Solar

No problem!

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Al Aldrich [mailto:EX 6]
Sent: Thursday, November 12, 2009 1:56 PM
To: Peck,Nick - TPC-TPP-4
Subject: Re: LGIP introductory links - Teanaway Solar

Not now, might know later today.

Sent using BlackBerry

-----Original Message-----
From: Peck,Nick - TPC-TPP-4 <cnpeck@bpa.gov>
To: Al Aldrich - EX 6
Sent: Thu Nov 12 13:50:53 2009
Subject: RE: LGIP introductory links - Teanaway Solar

If there's a tracking number, I can look for it. Any idea to whom it was addressed?

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Al Aldrich - EX 6
Sent: Thursday, November 12, 2009 1:50 PM
To: Peck,Nick - TPC-TPP-4
Subject: Re: LGIP introductory links - Teanaway Solar

They were sent Fed Ex yesterday or today, I found out.
Al

Sent using BlackBerry

-----Original Message-----
From: Peck,Nick - TPC-TPP-4 <cnpeck@bpa.gov>
To: Al Aldrich - EX 6
Sent: Thu Nov 12 09:45:15 2009
Subject: RE: LGIP introductory links - Teanaway Solar

Not yet. How are they arriving...?

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183

Text: 3609802183@vtext.com

From: Al Aldrich [mailto:] EX 6
Sent: Thursday, November 12, 2009 9:44 AM
To: Peck,Nick - TPC-TPP-4
Subject: RE: LGIP introductory links - Teanaway Solar

Understandable advice and I have sent it on. Do you have the application papers by now?

From: Peck,Nick - TPC-TPP-4 [mailto:cnpeck@bpa.gov]
Sent: Thursday, November 12, 2009 9:32 AM
To: Al Aldrich
Subject: RE: LGIP introductory links - Teanaway Solar

Strong recommendation to use an overnight delivery service:

BPA
Attention: LGIP Administrator
TPC/TPP-4
7500 NE 41st Street, Suite 130
Vancouver, WA 98662

In the memo space on the check, write: Interconnection Request

Hope this helps!!

Nick

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Al Aldrich | EX 6

12/21/2009

Sent: Thursday, November 12, 2009 8:59 AM
To: Peck,Nick - TPC-TPP-4
Subject: RE: LGIP introductory links - Teanaway Solar

What address should he mail it to, Nick?

Thanks,
Al

From: Peck,Nick - TPC-TPP-4 [<mailto:cnpeck@bpa.gov>]
Sent: Thursday, November 12, 2009 8:53 AM
To: Al Aldrich
Subject: RE: LGIP introductory links - Teanaway Solar

Al,

He could come to our building here in Vancouver but I would infinitely prefer he mail it when he gets back to the office. Our Portland offices are not staffed for this sort of transaction.

Thanks!

Nick

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Al Aldrich [EX 6]
Sent: Wednesday, November 11, 2009 5:22 PM
To: Peck,Nick - TPC-TPP-4
Subject: RE: LGIP introductory links - Teanaway Solar

Nick,

Howard Trott with the Teanaway Solar Reserve will be in Portland tomorrow for a couple of meetings. He told me an hour ago that he has or is planning to bring, a check for the deposit. I just scanned your link/attachment on sending payments and didn't see an option for handing a check to someone. Can he do that? If so, to someone at your office or HQ in Portland or...?

Thanks,

Al

Office 206-282-1990

Cell 425-344-1571

From: Peck,Nick - TPC-TPP-4 [mailto:cnpeck@bpa.gov]
Sent: Wednesday, October 21, 2009 10:20 AM
To: Al Aldrich
Subject: FW: LGIP introductory links - Teanaway Solar

Al,

It's the first doc (LGIP Appendix 1) we need to establish a queue position. Swift way to do this: Print, complete, sign, scan, email to Interconnection@bpa.gov , cc me. I'll need the 4220.01 very shortly thereafter.

Nick

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Peck,Nick - TPC-TPP-4
Sent: Wednesday, August 05, 2009 4:38 PM
To: EX 6
Cc: Fiedler,Paul A - TPC-TPP-4; DeClerck,Angela - TSE-TPP-2; Gilliland,Kimberly D - TPC-TPP-3
Subject: LGIP introductory links - Teanaway Solar

Al,

12/21/2009

It was a pleasure to talk to you earlier about the Teanaway Solar project.

The interconnection process is closely regulated, and is governed by the Large Generator Interconnection Procedures (LGIP); the Interconnection Queue, which establishes the priority of rights for interconnection, is referenced later.

Below are some detailed links that may be helpful in compiling and submitting a Large Generator Interconnection Request; and the relevant forms are attached to this email to assist you.

The LGIP in full is Attachment L to our Tariff, linked from <http://www.transmission.bpa.gov/business/default.cfm> <<http://www.transmission.bpa.gov/business/default.cfm>> (The LGIP begins at the 157th page of the pdf, shown as 'Original sheet 191' .) Our Business Practices are also available from that page. I attach a graphical representation of the entire process as a guideline.

I attach electronic copies of the Interconnection Request Form (Appendix 1; I include also its Attachment A - which is welcome but not required at the Request stage); and the W9e and New Vendor form: we will need the W9e information in advance of, or included with any request, to establish your company in our systems before we can begin the processes of validating the request. Unless you are also requesting transmission service, the information sought by these two forms is all we require and you can ignore, at least for the time being, the more stringent requirements listed under 'Becoming a customer'.

At this site, http://www.transmission.bpa.gov/system_planning/planning_studies/default.cfm <http://www.transmission.bpa.gov/system_planning/planning_studies/default.cfm> , you will find instructions on how to obtain existing study reports - these instructions pertain both to the Transmission studies listed on that page and to the LGIP studies referenced from our Interconnection Queue (http://www.transmission.bpa.gov/Business/Reserve_and_Schedule_Transmission/girequests.cfm <http://www.transmission.bpa.gov/Business/Reserve_and_Schedule_Transmission/girequests.cfm> . The LGIP provides you the right to view completed interconnection studies - redacted to protect commercial information.

For an overview of our NEPA compliance requirements and processes, this page (http://www.efw.bpa.gov/environmental_services/environmentalplanning.aspx <http://www.efw.bpa.gov/environmental_services/environmentalplanning.aspx>) and the links from it are valuable reading. For the website with both complete and on-going environmental reviews, see http://www.efw.bpa.gov/environmental_services/nepadocs.aspx <http://www.efw.bpa.gov/environmental_services/nepadocs.aspx> .

I would be happy to assist you through the Request Submittal process, which it is possible to initiate by emailing signed and scanned documents to "interconnection@bpa.gov <<mailto:interconnection@bpa.gov>> " . We recommend including me as a cc to that email. The deposit (the \$10,000 initial deposit and optional \$10,000 deposit in lieu of Site Control) should be submitted per the attached Payment instructions.

Do not hesitate to call or email with any questions .

Sincerely,

12/21/2009

Nick

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183

Fiedler,Paul A - TPC-TPP-4

From: Al Aldrich EX 6
Sent: Monday, November 16, 2009 10:52 AM
To: Peck,Nick - TPC-TPP-4
Subject: Re: LGIP introductory links - Teanaway Solar

I will check with Howard.
Thanks,
Al

Sent using BlackBerry

-----Original Message-----
From: Peck,Nick - TPC-TPP-4 <cnpeck@bpa.gov>
To: Al Aldrich EX 6
Sent: Mon Nov 16 09:38:06 2009
Subject: RE: LGIP introductory links - Teanaway Solar

Al,

I trust you had a good weekend.

We have no trace of the Request here. Have you had any luck identifying where the package was addressed, and the tracking number?

Thanks,

Nick

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Al Aldrich EX 6
Sent: Friday, November 13, 2009 12:18 PM
To: Peck,Nick - TPC-TPP-4
Subject: Re: LGIP introductory links - Teanaway Solar

I will try to get it.

Sent using BlackBerry

-----Original Message-----

From: Peck,Nick - TPC-TPP-4 <cnpeck@bpa.gov>
To: Al Aldrich EX 6
Sent: Fri Nov 13 12:16:03 2009
Subject: RE: LGIP introductory links - Teanaway Solar

Al,

Any chance I can get the tracking number from the Fedex receipt?

We have three campuses in two states using three different mailing addresses and three different street addresses. Without knowing where this was sent, or to whom it was addressed, I can not realistically begin to track it down.....

I realize you are somewhat caught in the middle here. Let me know if it would be simpler to steer me directly to Mr. Trott.

Thanks!!

Nick

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Al Aldrich EX 6
Sent: Friday, November 13, 2009 11:54 AM
To: Peck,Nick - TPC-TPP-4
Subject: Re: LGIP introductory links - Teanaway Solar

Howard told me last night that he sent the deposit and application both by FedEx, so by now they should be delivered--somewhere--to BPA. I don't know exactly where he sent it. If you stumble upon it, please let me know.

Thanks,
Al

Sent using BlackBerry

12/21/2009

-----Original Message-----

From: Peck,Nick - TPC-TPP-4 <cnpeck@bpa.gov>
To: Al Aldrich, EX 6
Sent: Thu Nov 12 13:59:46 2009
Subject: RE: LGIP introductory links - Teanaway Solar

No problem!

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Al Aldrich, EX 6
Sent: Thursday, November 12, 2009 1:56 PM
To: Peck,Nick - TPC-TPP-4
Subject: Re: LGIP introductory links - Teanaway Solar

Not now, might know later today.

Sent using BlackBerry

-----Original Message-----

From: Peck,Nick - TPC-TPP-4 <cnpeck@bpa.gov>
To: Al Aldrich < EX 6
Sent: Thu Nov 12 13:50:53 2009
Subject: RE: LGIP introductory links - Teanaway Solar

If there's a tracking number, I can look for it. Any idea to whom it was addressed?

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Al Aldrich, EX 6
Sent: Thursday, November 12, 2009 1:50 PM
To: Peck,Nick - TPC-TPP-4
Subject: Re: LGIP introductory links - Teanaway Solar

They were sent Fed Ex yesterday or today, I found out.

12/21/2009

Al

Sent using BlackBerry

-----Original Message-----

From: Peck, Nick - TPC-TPP-4 <cnpeck@bpa.gov>
To: Al Aldrich <EX 6>
Sent: Thu Nov 12 09:45:15 2009
Subject: RE: LGIP introductory links - Teanaway Solar

Not yet. How are they arriving...?

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Al Aldrich <EX 6>
Sent: Thursday, November 12, 2009 9:44 AM
To: Peck, Nick - TPC-TPP-4
Subject: RE: LGIP introductory links - Teanaway Solar

Understandable advice and I have sent it on. Do you have the application papers by now?

From: Peck, Nick - TPC-TPP-4 [mailto:cnpeck@bpa.gov]
Sent: Thursday, November 12, 2009 9:32 AM
To: Al Aldrich
Subject: RE: LGIP introductory links - Teanaway Solar

Strong recommendation to use an overnight delivery service:

BPA
Attention: LGIP Administrator
TPC/TPP-4
7500 NE 41st Street, Suite 130
Vancouver, WA 98662

In the memo space on the check, write: Interconnection Request

12/21/2009

Hope this helps!!

Nick

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Al Aldrich [EX 6]
Sent: Thursday, November 12, 2009 8:59 AM
To: Peck,Nick - TPC-TPP-4
Subject: RE: LGIP introductory links - Teanaway Solar

What address should he mail it to, Nick?

Thanks,

Al

From: Peck,Nick - TPC-TPP-4 [mailto:cnpeck@bpa.gov]
Sent: Thursday, November 12, 2009 8:53 AM
To: Al Aldrich
Subject: RE: LGIP introductory links - Teanaway Solar

Al,

He could come to our building here in Vancouver but I would infinitely prefer he mail it when he gets back to the office. Our Portland offices are not staffed for this sort of transaction.

Thanks!

Nick

12/21/2009

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Al Aldrich [mailto:**EX 6**]
Sent: Wednesday, November 11, 2009 5:22 PM
To: Peck,Nick - TPC-TPP-4
Subject: RE: LGIP introductory links - Teanaway Solar

Nick,

Howard Trott with the Teanaway Solar Reserve will be in Portland tomorrow for a couple of meetings. He told me an hour ago that he has or is planning to bring, a check for the deposit. I just scanned your link/attachment on sending payments and didn't see an option for handing a check to someone. Can he do that? If so, to someone at your office or HQ in Portland or...?

Thanks,

Al

Office 206-282-1990

Cell 425-344-1571

From: Peck,Nick - TPC-TPP-4 [mailto:cnpeck@bpa.gov]
Sent: Wednesday, October 21, 2009 10:20 AM
To: Al Aldrich
Subject: FW: LGIP introductory links - Teanaway Solar

Al,

It's the first doc (LGIP Appendix 1) we need to establish a queue position. Swift way to do this: Print, complete, sign, scan, email to Interconnection@bpa.gov , cc me. I'll need the 4220.01 very shortly thereafter.

Nick

Nick Peck

12/21/2009

LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Peck,Nick - TPC-TPP-4
Sent: Wednesday, August 05, 2009 4:38 PM
To: EX 6
Cc: Fiedler,Paul A - TPC-TPP-4; DeClerck,Angela - TSE-TPP-2; Gilliland,Kimberly D - TPC-TPP-3
Subject: LGIP introductory links - Teanaway Solar

Al,

It was a pleasure to talk to you earlier about the Teanaway Solar project.

The interconnection process is closely regulated, and is governed by the Large Generator Interconnection Procedures (LGIP); the Interconnection Queue, which establishes the priority of rights for interconnection, is referenced later.

Below are some detailed links that may be helpful in compiling and submitting a Large Generator Interconnection Request; and the relevant forms are attached to this email to assist you.

The LGIP in full is Attachment L to our Tariff, linked from <http://www.transmission.bpa.gov/business/default.cfm> <<http://www.transmission.bpa.gov/business/default.cfm>> (The LGIP begins at the 157th page of the pdf, shown as 'Original sheet 191' .) Our Business Practices are also available from that page. I attach a graphical representation of the entire process as a guideline.

I attach electronic copies of the Interconnection Request Form (Appendix 1; I include also its Attachment A - which is welcome but not required at the Request stage); and the W9e and New Vendor form: we will need the W9e information in advance of, or included with any request, to establish your company in our systems before we can begin the processes of validating the request. Unless you are also requesting transmission service, the information sought by these two forms is all we require and you can ignore, at least for the time being, the more stringent requirements listed under 'Becoming a customer'.

At this site, http://www.transmission.bpa.gov/system_planning/planning_studies/default.cfm <http://www.transmission.bpa.gov/system_planning/planning_studies/default.cfm> , you will find instructions on how to obtain existing study reports - these instructions pertain both to the Transmission studies listed on that page and to the LGIP studies referenced from our Interconnection Queue (http://www.transmission.bpa.gov/Business/Reserve_and_Schedule_Transmission/girequests.cfm <http://www.transmission.bpa.gov/Business/Reserve_and_Schedule_Transmission/girequests.cfm> . The LGIP provides you the right to view completed interconnection studies - redacted to protect commercial information.

For an overview of our NEPA compliance requirements and processes, this page (http://www.efw.bpa.gov/environmental_services/environmentalplanning.aspx <http://www.efw.bpa.gov/environmental_services/environmentalplanning.aspx>) and the links from it are valuable reading. For the website with both complete and on-going environmental reviews, see http://www.efw.bpa.gov/environmental_services/nepadocs.aspx <http://www.efw.bpa.gov/environmental_services/nepadocs.aspx> .

I would be happy to assist you through the Request Submittal process, which it is possible to initiate by emailing signed and scanned documents to "interconnection@bpa.gov <<mailto:interconnection@bpa.gov>> " . We recommend including me as a cc to that email. The deposit (the \$10,000 initial deposit and optional \$10,000 deposit in lieu of Site Control) should be submitted per the attached Payment instructions.

Do not hesitate to call or email with any questions .

Sincerely,

Nick

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183

Fiedler,Paul A - TPC-TPP-4

From: Peck,Nick - TPC-TPP-4
Sent: Thursday, November 12, 2009 2:00 PM
To: 'Al Aldrich'
Subject: RE: LGIP introductory links - Teanaway Solar

No problem!

Nick Peck

LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Al Aldrich EX 6
Sent: Thursday, November 12, 2009 1:56 PM
To: Peck,Nick - TPC-TPP-4
Subject: Re: LGIP introductory links - Teanaway Solar

Not now, might know later today.

Sent using BlackBerry

-----Original Message-----

From: Peck,Nick - TPC-TPP-4 <cnpeck@bpa.gov>
To: Al Aldrich, EX 6
Sent: Thu Nov 12 13:50:53 2009
Subject: RE: LGIP introductory links - Teanaway Solar

If there's a tracking number, I can look for it. Any idea to whom it was addressed?

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Al Aldrich EX 6
Sent: Thursday, November 12, 2009 1:50 PM
To: Peck,Nick - TPC-TPP-4
Subject: Re: LGIP introductory links - Teanaway Solar

They were sent Fed Ex yesterday or today, I found out.

Al

Sent using BlackBerry

-----Original Message-----

From: Peck,Nick - TPC-TPP-4 <cnpeck@bpa.gov>

To: Al Aldrich, EX 6

Sent: Thu Nov 12 09:45:15 2009

Subject: RE: LGIP introductory links - Teanaway Solar

Not yet. How are they arriving...?

Nick Peck

LGIP Administrator

TPC/TPP-4

Tel: (360) 619-6419

Fax: (360) 619-6070

Cell: (360) 980-2183

Text: 3609802183@vtext.com

From: Al Aldrich, EX 6

Sent: Thursday, November 12, 2009 9:44 AM

To: Peck,Nick - TPC-TPP-4

Subject: RE: LGIP introductory links - Teanaway Solar

Understandable advice and I have sent it on. Do you have the application papers by now?

From: Peck,Nick - TPC-TPP-4 [<mailto:cnpeck@bpa.gov>]

Sent: Thursday, November 12, 2009 9:32 AM

To: Al Aldrich

Subject: RE: LGIP introductory links - Teanaway Solar

Strong recommendation to use an overnight delivery service:

BPA

Attention: LGIP Administrator

TPC/TPP-4

7500 NE 41st Street, Suite 130

Vancouver, WA 98662

12/21/2009

In the memo space on the check, write: Interconnection Request

Hope this helps!!

Nick

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Al Aldrich **EX 6**
Sent: Thursday, November 12, 2009 8:59 AM
To: Peck,Nick - TPC-TPP-4
Subject: RE: LGIP introductory links - Teanaway Solar

What address should he mail it to, Nick?

Thanks,

Al

From: Peck,Nick - TPC-TPP-4 [<mailto:cnpeck@bpa.gov>]
Sent: Thursday, November 12, 2009 8:53 AM
To: Al Aldrich
Subject: RE: LGIP introductory links - Teanaway Solar

Al,

He could come to our building here in Vancouver but I would infinitely prefer he mail it when he gets back to the office. Our Portland offices are not staffed for this sort of transaction.

Thanks!

Nick

12/21/2009

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Al Aldrich **EX 6**
Sent: Wednesday, November 11, 2009 5:22 PM
To: Peck,Nick - TPC-TPP-4
Subject: RE: LGIP introductory links - Teanaway Solar

Nick,

Howard Trott with the Teanaway Solar Reserve will be in Portland tomorrow for a couple of meetings. He told me an hour ago that he has or is planning to bring, a check for the deposit. I just scanned your link/attachment on sending payments and didn't see an option for handing a check to someone. Can he do that? If so, to someone at your office or HQ in Portland or...?

Thanks,

Al

Office 206-282-1990

Cell 425-344-1571

From: Peck,Nick - TPC-TPP-4 [<mailto:cnpeck@bpa.gov>]
Sent: Wednesday, October 21, 2009 10:20 AM
To: Al Aldrich
Subject: FW: LGIP introductory links - Teanaway Solar

Al,

It's the first doc (LGIP Appendix 1) we need to establish a queue position. Swift way to do this: Print, complete, sign, scan, email to Interconnection@bpa.gov, cc me. I'll need the 4220.01 very shortly thereafter.

Nick

12/21/2009

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Peck,Nick - TPC-TPP-4
Sent: Wednesday, August 05, 2009 4:38 PM
To: 'EX 6'
Cc: Fiedler,Paul A - TPC-TPP-4; DeClerck,Angela - TSE-TPP-2; Gilliland,Kimberly D - TPC-TPP-3
Subject: LGIP introductory links - Teanaway Solar

Al,

It was a pleasure to talk to you earlier about the Teanaway Solar project.

The interconnection process is closely regulated, and is governed by the Large Generator Interconnection Procedures (LGIP); the Interconnection Queue, which establishes the priority of rights for interconnection, is referenced later.

Below are some detailed links that may be helpful in compiling and submitting a Large Generator Interconnection Request; and the relevant forms are attached to this email to assist you.

The LGIP in full is Attachment L to our Tariff, linked from <http://www.transmission.bpa.gov/business/default.cfm> <<http://www.transmission.bpa.gov/business/default.cfm>> (The LGIP begins at the 157th page of the pdf, shown as 'Original sheet 191' .) Our Business Practices are also available from that page. I attach a graphical representation of the entire process as a guideline.

I attach electronic copies of the Interconnection Request Form (Appendix I; I include also its Attachment A - which is welcome but not required at the Request stage); and the W9e and New Vendor form: we will need the W9e information in advance of, or included with any request, to establish your company in our systems before we can begin the processes of validating the request. Unless you are also requesting transmission service, the information sought by these two forms is all we require and you can ignore, at least for the time being, the more stringent requirements listed under 'Becoming a customer'.

At this site, http://www.transmission.bpa.gov/system_planning/planning_studies/default.cfm <http://www.transmission.bpa.gov/system_planning/planning_studies/default.cfm> , you will find instructions on how to obtain existing study reports - these instructions pertain both to the Transmission studies listed on that page and to the LGIP studies referenced from our Interconnection Queue (http://www.transmission.bpa.gov/Business/Reserve_and_Schedule_Transmission/girequests.cfm <http://www.transmission.bpa.gov/Business/Reserve_and_Schedule_Transmission/girequests.cfm> . The LGIP provides you the right to view completed interconnection studies - redacted to protect commercial information.

For an overview of our NEPA compliance requirements and processes, this page (http://www.efw.bpa.gov/environmental_services/environmentalplanning.aspx <http://www.efw.bpa.gov/environmental_services/environmentalplanning.aspx>) and the links from it are valuable reading. For the website with both complete and on-going environmental reviews, see http://www.efw.bpa.gov/environmental_services/nepadocs.aspx <http://www.efw.bpa.gov/environmental_services/nepadocs.aspx> .

I would be happy to assist you through the Request Submittal process, which it is possible to initiate by emailing signed and scanned documents to "interconnection@bpa.gov <<mailto:interconnection@bpa.gov>> " . We recommend including me as a cc to that email. The deposit (the \$10,000 initial deposit and optional \$10,000 deposit in lieu of Site Control) should be submitted per the attached Payment instructions.

Do not hesitate to call or email with any questions .

Sincerely,

Nick

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183

Fiedler,Paul A - TPC-TPP-4

From: Peck,Nick - TPC-TPP-4
Sent: Friday, November 13, 2009 12:16 PM
To: 'Al Aldrich'
Subject: RE: LGIP introductory links - Teanaway Solar

Al,

Any chance I can get the tracking number from the Fedex receipt?

We have three campuses in two states using three different mailing addresses and three different street addresses. Without knowing where this was sent, or to whom it was addressed, I can not realistically begin to track it down.....

I realize you are somewhat caught in the middle here. Let me know if it would be simpler to steer me directly to Mr. Trott.

Thanks!!

Nick

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Al Aldrich [mailto:**EX 6**]
Sent: Friday, November 13, 2009 11:54 AM
To: Peck,Nick - TPC-TPP-4
Subject: Re: LGIP introductory links - Teanaway Solar

Howard told me last night that he sent the deposit and appication both by FedEx, so by now they should be delivered-- somewhere--to BPA. I don't know exactly where he sent it. If you stumble upon it, please let me know.

Thanks,
Al

Sent using BlackBerry

-----Original Message-----
From: Peck,Nick - TPC-TPP-4 <cnpeck@hpa.gov>
To: Al Aldrich **EX 6**
Sent: Thu Nov 12 13:59:46 2009
Subject: RE: LGIP introductory links - Teanaway Solar

No problem!

12/21/2009

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Al Aldrich [mailto:EX 6]
Sent: Thursday, November 12, 2009 1:56 PM
To: Peck,Nick - TPC-TPP-4
Subject: Re: LGIP introductory links - Teanaway Solar

Not now, might know later today.

Sent using BlackBerry

-----Original Message-----
From: Peck,Nick - TPC-TPP-4 <cnpeck@bpa.gov>
To: Al Aldrich [mailto:EX 6]
Sent: Thu Nov 12 13:50:53 2009
Subject: RE: LGIP introductory links - Teanaway Solar

If there's a tracking number, I can look for it. Any idea to whom it was addressed?

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Al Aldrich [mailto:EX 6]
Sent: Thursday, November 12, 2009 1:50 PM
To: Peck,Nick - TPC-TPP-4
Subject: Re: LGIP introductory links - Teanaway Solar

They were sent Fed Ex yesterday or today, I found out.
Al

Sent using BlackBerry

-----Original Message-----
From: Peck,Nick - TPC-TPP-4 <cnpeck@bpa.gov>
To: Al Aldrich [mailto:EX 6]
Sent: Thu Nov 12 09:45:15 2009

Subject: RE: LGIP introductory links - Teanaway Solar

Not yet. How are they arriving...?

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Al Aldrich [mailto:[alaldrich@bpa.gov](#)] EX 6
Sent: Thursday, November 12, 2009 9:44 AM
To: Peck,Nick - TPC-TPP-4
Subject: RE: LGIP introductory links - Teanaway Solar

Understandable advice and I have sent it on. Do you have the application papers by now?

From: Peck,Nick - TPC-TPP-4 [mailto:cnpeck@bpa.gov]
Sent: Thursday, November 12, 2009 9:32 AM
To: Al Aldrich
Subject: RE: LGIP introductory links - Teanaway Solar

Strong recommendation to use an overnight delivery service:

BPA
Attention: LGIP Administrator
TPC/TPP-4
7500 NE 41st Street, Suite 130
Vancouver, WA 98662

In the memo space on the check, write: Interconnection Request

Hope this helps!!

Nick

12/21/2009

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Al Aldrich [mailto:[al.aldrich@bpa.gov](#)] EX 6
Sent: Thursday, November 12, 2009 8:59 AM
To: Peck,Nick - TPC-TPP-4
Subject: RE: LGIP introductory links - Teanaway Solar

What address should he mail it to, Nick?

Thanks,

Al

From: Peck,Nick - TPC-TPP-4 [mailto:cnpeck@bpa.gov]
Sent: Thursday, November 12, 2009 8:53 AM
To: Al Aldrich
Subject: RE: LGIP introductory links - Teanaway Solar

Al,

He could come to our building here in Vancouver but I would infinitely prefer he mail it when he gets back to the office. Our Portland offices are not staffed for this sort of transaction.

Thanks!

Nick

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

12/21/2009

From: Al Aldrich [mailto:alaldrich@bpa.gov] EX 6
Sent: Wednesday, November 11, 2009 5:22 PM
To: Peck,Nick - TPC-TPP-4
Subject: RE: LGIP introductory links - Teanaway Solar

Nick,

Howard Trott with the Teanaway Solar Reserve will be in Portland tomorrow for a couple of meetings. He told me an hour ago that he has or is planning to bring, a check for the deposit. I just scanned your link/attachment on sending payments and didn't see an option for handing a check to someone. Can he do that? If so, to someone at your office or HQ in Portland or...?

Thanks,

Al

Office 206-282-1990

Cell EX 6

From: Peck,Nick - TPC-TPP-4 [mailto:cnpeck@bpa.gov]
Sent: Wednesday, October 21, 2009 10:20 AM
To: Al Aldrich
Subject: FW: LGIP introductory links - Teanaway Solar

Al,

It's the first doc (LGIP Appendix 1) we need to establish a queue position. Swift way to do this: Print, complete, sign, scan, email to Interconnection@bpa.gov, cc me. I'll need the 4220.01 very shortly thereafter.

Nick

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Peck,Nick - TPC-TPP-4

Sent: Wednesday, August 05, 2009 4:38 PM

To: EX 6

Cc: Fiedler,Paul A - TPC-TPP-4; DeClerck,Angela - TSE-TPP-2; Gilliland,Kimberly D - TPC-TPP-3

Subject: LGIP introductory links - Teanaway Solar

Al,

It was a pleasure to talk to you earlier about the Teanaway Solar project.

The interconnection process is closely regulated, and is governed by the Large Generator Interconnection Procedures (LGIP); the Interconnection Queue, which establishes the priority of rights for interconnection, is referenced later.

Below are some detailed links that may be helpful in compiling and submitting a Large Generator Interconnection Request; and the relevant forms are attached to this email to assist you.

The LGIP in full is Attachment L to our Tariff, linked from <http://www.transmission.bpa.gov/business/default.cfm> <<http://www.transmission.bpa.gov/business/default.cfm>> (The LGIP begins at the 157th page of the pdf, shown as 'Original sheet 191' .) Our Business Practices are also available from that page. I attach a graphical representation of the entire process as a guideline.

I attach electronic copies of the Interconnection Request Form (Appendix 1; I include also its Attachment A - which is welcome but not required at the Request stage); and the W9e and New Vendor form: we will need the W9e information in advance of, or included with any request, to establish your company in our systems before we can begin the processes of validating the request. Unless you are also requesting transmission service, the information sought by these two forms is all we require and you can ignore, at least for the time being, the more stringent requirements listed under 'Becoming a customer'.

At this site, http://www.transmission.bpa.gov/system_planning/planning_studies/default.cfm <http://www.transmission.bpa.gov/system_planning/planning_studies/default.cfm> , you will find instructions on how to obtain existing study reports - these instructions pertain both to the Transmission studies listed on that page and to the LGIP studies referenced from our Interconnection Queue (http://www.transmission.bpa.gov/Business/Reserve_and_Schedule_Transmission/girequests.cfm <http://www.transmission.bpa.gov/Business/Reserve_and_Schedule_Transmission/girequests.cfm> . The LGIP provides you the right to view completed interconnection studies - redacted to protect commercial information.

For an overview of our NEPA compliance requirements and processes, this page (http://www.efw.bpa.gov/environmental_services/environmentalplanning.aspx <http://www.efw.bpa.gov/environmental_services/environmentalplanning.aspx>) and the links from it are valuable reading. For the website with both complete and on-going environmental reviews, see http://www.efw.bpa.gov/environmental_services/nepadocs.aspx <http://www.efw.bpa.gov/environmental_services/nepadocs.aspx> .

I would be happy to assist you through the Request Submittal process, which it is possible to initiate by emailing signed and scanned documents to "interconnection@bpa.gov <<mailto:interconnection@bpa.gov>> ". We recommend including me as a cc to that email. The deposit (the \$10,000 initial deposit and optional \$10,000 deposit in lieu of Site Control) should be submitted per the attached Payment instructions.

Do not hesitate to call or email with any questions .

Sincerely,

Nick

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183

Fiedler,Paul A - TPC-TPP-4

From: Al Aldrich EX 6
Sent: Friday, November 13, 2009 12:18 PM
To: Peck,Nick - TPC-TPP-4
Subject: Re: LGIP introductory links - Teanaway Solar

I will try to get it.

Sent using BlackBerry

-----Original Message-----

From: Peck,Nick - TPC-TPP-4 <cnpeck@bpa.gov>
To: Al Aldrich EX 6
Sent: Fri Nov 13 12:16:03 2009
Subject: RE: LGIP introductory links - Teanaway Solar

Al,

Any chance I can get the tracking number from the Fedex receipt?

We have three campuses in two states using three different mailing addresses and three different street addresses. Without knowing where this was sent, or to whom it was addressed, I can not realistically begin to track it down.....

I realize you are somewhat caught in the middle here. Let me know if it would be simpler to steer me directly to Mr. Trott.

Thanks!!

Nick

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Al Aldrich EX 6
Sent: Friday, November 13, 2009 11:54 AM
To: Peck,Nick - TPC-TPP-4
Subject: Re: LGIP introductory links - Teanaway Solar

Howard told me last night that he sent the deposit and application both by FedEx, so by now they should be delivered--somewhere--to BPA. I don't know exactly where he sent it. If you stumble upon it, please let me know.

Thanks,
Al

Sent using BlackBerry

-----Original Message-----

From: Peck,Nick - TPC-TPP-4 <cnneck@bpa.gov>
To: Al Aldrich EX 6
Sent: Thu Nov 12 13:59:46 2009
Subject: RE: LGIP introductory links - Teanaway Solar

No problem!

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Al Aldrich EX 6
Sent: Thursday, November 12, 2009 1:56 PM
To: Peck,Nick - TPC-TPP-4
Subject: Re: LGIP introductory links - Teanaway Solar

Not now, might know later today.

Sent using BlackBerry

-----Original Message-----

From: Peck,Nick - TPC-TPP-4 <cnpeck@bpa.gov>
To: Al Aldrich EX 6
Sent: Thu Nov 12 13:50:53 2009
Subject: RE: LGIP introductory links - Teanaway Solar

If there's a tracking number, I can look for it. Any idea to whom it was addressed?

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

12/21/2009

From: Al Aldrich [mailto:EX 6]
Sent: Thursday, November 12, 2009 1:50 PM
To: Peck,Nick - TPC-TPP-4
Subject: Re: LGIP introductory links - Teanaway Solar

They were sent Fed Ex yesterday or today, I found out.

Al

Sent using BlackBerry

-----Original Message-----

From: Peck,Nick - TPC-TPP-4 <cnpeck@bpa.gov>
To: Al Aldrich [mailto:EX 6]
Sent: Thu Nov 12 09:45:15 2009
Subject: RE: LGIP introductory links - Teanaway Solar

Not yet. How are they arriving...?

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Al Aldrich [mailto:EX 6]
Sent: Thursday, November 12, 2009 9:44 AM
To: Peck,Nick - TPC-TPP-4
Subject: RE: LGIP introductory links - Teanaway Solar

Understandable advice and I have sent it on. Do you have the application papers by now?

From: Peck,Nick - TPC-TPP-4 [mailto:cnpeck@bpa.gov]
Sent: Thursday, November 12, 2009 9:32 AM
To: Al Aldrich
Subject: RE: LGIP introductory links - Teanaway Solar

Strong recommendation to use an overnight delivery service:

BPA

Attention: LGIP Administrator

12/21/2009

TPC/TPP-4

7500 NE 41st Street, Suite 130

Vancouver, WA 98662

In the memo space on the check, write: Interconnection Request

Hope this helps!!

Nick

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Al Aldrich [mailto:EX 6]
Sent: Thursday, November 12, 2009 8:59 AM
To: Peck,Nick - TPC-TPP-4
Subject: RE: LGIP introductory links - Teanaway Solar

What address should he mail it to, Nick?

Thanks,

Al

From: Peck,Nick - TPC-TPP-4 [mailto:cnpeck@bpa.gov]
Sent: Thursday, November 12, 2009 8:53 AM
To: Al Aldrich
Subject: RE: LGIP introductory links - Teanaway Solar

Al,

He could come to our building here in Vancouver but I would infinitely prefer he mail it when he gets back to the office. Our Portland offices are not staffed for this sort of transaction.

12/21/2009

Thanks!

Nick

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Al Aldrich [mailto:[EX 6](#)]
Sent: Wednesday, November 11, 2009 5:22 PM
To: Peck,Nick - TPC-TPP-4
Subject: RE: LGIP introductory links - Teanaway Solar

Nick,

Howard Trott with the Teanaway Solar Reserve will be in Portland tomorrow for a couple of meetings. He told me an hour ago that he has or is planning to bring, a check for the deposit. I just scanned your link/attachment on sending payments and didn't see an option for handing a check to someone. Can he do that? If so, to someone at your office or HQ in Portland or...?

Thanks,

Al

Office 206-282-1990

Cell 425-344-1571

From: Peck,Nick - TPC-TPP-4 [mailto:cnpeck@bpa.gov]
Sent: Wednesday, October 21, 2009 10:20 AM
To: Al Aldrich
Subject: FW: LGIP introductory links - Teanaway Solar

Al,

12/21/2009

It's the first doc (LGIP Appendix 1) we need to establish a queue position. Swift way to do this: Print, complete, sign, scan, email to Interconnection@bpa.gov , cc me. I'll need the 4220.01 very shortly thereafter.

Nick

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Peck,Nick - TPC-TPP-4
Sent: Wednesday, August 05, 2009 4:38 PM
To: EX 6
Cc: Fiedler,Paul A - TPC-TPP-4; DeClerck,Angela - TSE-TPP-2; Gilliland,Kimberly D - TPC-TPP-3
Subject: LGIP introductory links - Teanaway Solar

Al,

It was a pleasure to talk to you earlier about the Teanaway Solar project.

The interconnection process is closely regulated, and is governed by the Large Generator Interconnection Procedures (LGIP); the Interconnection Queue, which establishes the priority of rights for interconnection, is referenced later.

Below are some detailed links that may be helpful in compiling and submitting a Large Generator Interconnection Request; and the relevant forms are attached to this email to assist you.

The LGIP in full is Attachment L to our Tariff, linked from <http://www.transmission.bpa.gov/business/default.cfm> <<http://www.transmission.bpa.gov/business/default.cfm>> (The LGIP begins at the 157th page of the pdf, shown as 'Original sheet 191' .) Our Business Practices are also available from that page. I attach a graphical representation of the entire process as a guideline.

I attach electronic copies of the Interconnection Request Form (Appendix 1; I include also its Attachment A - which is welcome but not required at the Request stage); and the W9e and New Vendor form: we will need the W9e information in advance of, or included with any request, to establish your company in our systems before we can begin the processes of validating the request. Unless you are also requesting transmission service, the information sought by these two forms is all we require and you can ignore, at least for the time being, the more stringent requirements listed under 'Becoming a customer'.

12/21/2009

At this site, http://www.transmission.bpa.gov/system_planning/planning_studies/default.cfm
<http://www.transmission.bpa.gov/system_planning/planning_studies/default.cfm> , you will find instructions on how to obtain existing study reports - these instructions pertain both to the Transmission studies listed on that page and to the LGIP studies referenced from our Interconnection Queue
([http://www.transmission.bpa.gov/Business/Reserve and Schedule Transmission/girequests.cfm](http://www.transmission.bpa.gov/Business/Reserve_and_Schedule_Transmission/girequests.cfm)
<[http://www.transmission.bpa.gov/Business/Reserve and Schedule Transmission/girequests.cfm](http://www.transmission.bpa.gov/Business/Reserve_and_Schedule_Transmission/girequests.cfm)> . The LGIP provides you the right to view completed interconnection studies - redacted to protect commercial information.

For an overview of our NEPA compliance requirements and processes, this page
(http://www.efw.bpa.gov/environmental_services/environmentalplanning.aspx
<http://www.efw.bpa.gov/environmental_services/environmentalplanning.aspx>) and the links from it are valuable reading.
For the website with both complete and on-going environmental reviews, see
http://www.efw.bpa.gov/environmental_services/nepadocs.aspx
<http://www.efw.bpa.gov/environmental_services/nepadocs.aspx> .

I would be happy to assist you through the Request Submittal process, which it is possible to initiate by emailing signed and scanned documents to "interconnection@bpa.gov <<mailto:interconnection@bpa.gov>> " . We recommend including me as a cc to that email. The deposit (the \$10,000 initial deposit and optional \$10,000 deposit in lieu of Site Control) should be submitted per the attached Payment instructions.

Do not hesitate to call or email with any questions .

Sincerely,

Nick

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183

12/21/2009

Fiedler,Paul A - TPC-TPP-4

From: Al Aldrich [REDACTED] EX 6
Sent: Thursday, November 12, 2009 1:56 PM
To: Peck,Nick - TPC-TPP-4
Subject: Re: LGIP introductory links - Teanaway Solar

Not now, might know later today.

Sent using BlackBerry

-----Original Message-----

From: Peck,Nick - TPC-TPP-4 <cnpeck@bpa.gov>
To: Al Aldrich [REDACTED] EX 6
Sent: Thu Nov 12 13:50:53 2009
Subject: RE: LGIP introductory links - Teanaway Solar

If there's a tracking number, I can look for it. Any idea to whom it was addressed?

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Al Aldrich [REDACTED] EX 6
Sent: Thursday, November 12, 2009 1:50 PM
To: Peck,Nick - TPC-TPP-4
Subject: Re: LGIP introductory links - Teanaway Solar

They were sent Fed Ex yesterday or today, I found out.
Al

Sent using BlackBerry

-----Original Message-----

From: Peck,Nick - TPC-TPP-4 <cnpeck@bpa.gov>
To: Al Aldrich [REDACTED] EX 6
Sent: Thu Nov 12 09:45:15 2009
Subject: RE: LGIP introductory links - Teanaway Solar

Not yet. How are they arriving...?

Nick Peck
LGIP Administrator
TPC/TPP-4

12/21/2009

Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Al Aldrich, EX 6
Sent: Thursday, November 12, 2009 9:44 AM
To: Peck,Nick - TPC-TPP-4
Subject: RE: LGIP introductory links - Teanaway Solar

Understandable advice and I have sent it on. Do you have the application papers by now?

From: Peck,Nick - TPC-TPP-4 [mailto:cnpeck@bpa.gov]
Sent: Thursday, November 12, 2009 9:32 AM
To: Al Aldrich
Subject: RE: LGIP introductory links - Teanaway Solar

Strong recommendation to use an overnight delivery service:

BPA

Attention: LGIP Administrator

TPC/TPP-4

7500 NE 41st Street, Suite 130

Vancouver, WA 98662

In the memo space on the check, write: Interconnection Request

Hope this helps!!

Nick

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

12/21/2009

EX 6

From: Al Aldrich [mailto:alaldrich@tpc-tpa.gov]
Sent: Thursday, November 12, 2009 8:59 AM
To: Peck,Nick - TPC-TPP-4
Subject: RE: LGIP introductory links - Teanaway Solar

What address should he mail it to, Nick?

Thanks,

Al

From: Peck,Nick - TPC-TPP-4 [mailto:cnpeck@bpa.gov]
Sent: Thursday, November 12, 2009 8:53 AM
To: Al Aldrich
Subject: RE: LGIP introductory links - Teanaway Solar

Al,

He could come to our building here in Vancouver but I would infinitely prefer he mail it when he gets back to the office. Our Portland offices are not staffed for this sort of transaction.

Thanks!

Nick

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

EX 6

From: Al Aldrich [mailto:alaldrich@tpc-tpa.gov]
Sent: Wednesday, November 11, 2009 5:22 PM
To: Peck,Nick - TPC-TPP-4
Subject: RE: LGIP introductory links - Teanaway Solar

Nick,

12/21/2009

Howard Trott with the Teanaway Solar Reserve will be in Portland tomorrow for a couple of meetings. He told me an hour ago that he has or is planning to bring, a check for the deposit. I just scanned your link/attachment on sending payments and didn't see an option for handing a check to someone. Can he do that? If so, to someone at your office or HQ in Portland or...?

Thanks,

Al

Office 206-282-1990

Cell 425-344-1571

From: Peck,Nick - TPC-TPP-4 [<mailto:cnpeck@bpa.gov>]
Sent: Wednesday, October 21, 2009 10:20 AM
To: Al Aldrich
Subject: FW: LGIP introductory links - Teanaway Solar

Al,

It's the first doc (LGIP Appendix 1) we need to establish a queue position. Swift way to do this: Print, complete, sign, scan, email to Interconnection@bpa.gov, cc me. I'll need the 4220.01 very shortly thereafter.

Nick

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Peck,Nick - TPC-TPP-4
Sent: Wednesday, August 05, 2009 4:38 PM
To: EX 6
Cc: Fiedler,Paul A - TPC-TPP-4; DeClerck,Angela - TSE-TPP-2; Gilliland,Kimberly D - TPC-TPP-3
Subject: LGIP introductory links - Teanaway Solar

Al,

12/21/2009

It was a pleasure to talk to you earlier about the Teanaway Solar project.

The interconnection process is closely regulated, and is governed by the Large Generator Interconnection Procedures (LGIP); the Interconnection Queue, which establishes the priority of rights for interconnection, is referenced later.

Below are some detailed links that may be helpful in compiling and submitting a Large Generator Interconnection Request; and the relevant forms are attached to this email to assist you.

The LGIP in full is Attachment L to our Tariff, linked from <http://www.transmission.bpa.gov/business/default.cfm> <<http://www.transmission.bpa.gov/business/default.cfm>> (The LGIP begins at the 157th page of the pdf, shown as 'Original sheet 191' .) Our Business Practices are also available from that page. I attach a graphical representation of the entire process as a guideline.

I attach electronic copies of the Interconnection Request Form (Appendix 1; I include also its Attachment A - which is welcome but not required at the Request stage); and the W9e and New Vendor form: we will need the W9e information in advance of, or included with any request, to establish your company in our systems before we can begin the processes of validating the request. Unless you are also requesting transmission service, the information sought by these two forms is all we require and you can ignore, at least for the time being, the more stringent requirements listed under 'Becoming a customer'.

At this site, http://www.transmission.bpa.gov/system_planning/planning_studies/default.cfm <http://www.transmission.bpa.gov/system_planning/planning_studies/default.cfm> , you will find instructions on how to obtain existing study reports - these instructions pertain both to the Transmission studies listed on that page and to the LGIP studies referenced from our Interconnection Queue (http://www.transmission.bpa.gov/Business/Reserve_and_Schedule_Transmission/girequests.cfm <http://www.transmission.bpa.gov/Business/Reserve_and_Schedule_Transmission/girequests.cfm> . The LGIP provides you the right to view completed interconnection studies - redacted to protect commercial information.

For an overview of our NEPA compliance requirements and processes, this page (http://www.efw.bpa.gov/environmental_services/environmentalplanning.aspx <http://www.efw.bpa.gov/environmental_services/environmentalplanning.aspx>) and the links from it are valuable reading. For the website with both complete and on-going environmental reviews, see http://www.efw.bpa.gov/environmental_services/nepadocs.aspx <http://www.efw.bpa.gov/environmental_services/nepadocs.aspx> .

I would be happy to assist you through the Request Submittal process, which it is possible to initiate by emailing signed and scanned documents to "interconnection@bpa.gov <<mailto:interconnection@bpa.gov>> " . We recommend including me as a cc to that email. The deposit (the \$10,000 initial deposit and optional \$10,000 deposit in lieu of Site Control) should be submitted per the attached Payment instructions.

Do not hesitate to call or email with any questions .

12/21/2009

Sincerely,

Nick

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183

Fiedler,Paul A - TPC-TPP-4

From: Peck,Nick - TPC-TPP-4
Sent: Friday, November 13, 2009 11:56 AM
To: 'Al Aldrich'
Subject: RE: LGIP introductory links - Teanaway Solar

Thanks. I'll initiate a search-party.....

Nick Peck

LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Al Aldrich [mailto:] EX 6
Sent: Friday, November 13, 2009 11:54 AM
To: Peck,Nick - TPC-TPP-4
Subject: Re: LGIP introductory links - Teanaway Solar

Howard told me last night that he sent the deposit and appication both by FedEx, so by now they should be delivered--somewhere--to BPA. I don't know exactly where he sent it. If you stumble upon it, please let me know.

Thanks,
Al

Sent using BlackBerry

-----Original Message-----
From: Peck,Nick - TPC-TPP-4 <cnpeck@bpa.gov>
To: Al Aldrich EX 6
Sent: Thu Nov 12 13:59:46 2009
Subject: RE: LGIP introductory links - Teanaway Solar

No problem!

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Al Aldrich [mailto:] EX 6

12/21/2009

Sent: Thursday, November 12, 2009 1:56 PM
To: Peck,Nick - TPC-TPP-4
Subject: Re: LGIP introductory links - Teanaway Solar

Not now, might know later today.

Sent using BlackBerry

-----Original Message-----

From: Peck,Nick - TPC-TPP-4 <cnpeck@bpa.gov>
To: Al Aldrich **EX 6**
Sent: Thu Nov 12 13:50:53 2009
Subject: RE: LGIP introductory links - Teanaway Solar

If there's a tracking number, I can look for it. Any idea to whom it was addressed?

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Al Aldrich [mailto:**EX 6**]
Sent: Thursday, November 12, 2009 1:50 PM
To: Peck,Nick - TPC-TPP-4
Subject: Re: LGIP introductory links - Teanaway Solar

They were sent Fed Ex yesterday or today, I found out.
Al

Sent using BlackBerry

-----Original Message-----

From: Peck,Nick - TPC-TPP-4 <cnpeck@bpa.gov>
To: Al Aldrich <**EX 6**>
Sent: Thu Nov 12 09:45:15 2009
Subject: RE: LGIP introductory links - Teanaway Solar

Not yet. How are they arriving...?

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

12/21/2009

From: Al Aldrich [mailto:**EX 6**]
Sent: Thursday, November 12, 2009 9:44 AM
To: Peck,Nick - TPC-TPP-4
Subject: RE: LGIP introductory links - Teanaway Solar

Understandable advice and I have sent it on. Do you have the application papers by now?

From: Peck,Nick - TPC-TPP-4 [mailto:cnpeck@bpa.gov]
Sent: Thursday, November 12, 2009 9:32 AM
To: Al Aldrich **EX 6**
Subject: RE: LGIP introductory links - Teanaway Solar

Strong recommendation to use an overnight delivery service:

BPA
Attention: LGIP Administrator
TPC/TPP-4
7500 NE 41st Street, Suite 130
Vancouver, WA 98662

In the memo space on the check, write: Interconnection Request

Hope this helps!!

Nick

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Al Aldrich [mai **EX 6**]
Sent: Thursday, November 12, 2009 8:59 AM

12/21/2009

To: Peck,Nick - TPC-TPP-4
Subject: RE: LGIP introductory links - Teanaway Solar

What address should he mail it to, Nick?

Thanks,

Al

From: Peck,Nick - TPC-TPP-4 [mailto:cnpeck@bpa.gov]
Sent: Thursday, November 12, 2009 8:53 AM
To: Al Aldrich
Subject: RE: LGIP introductory links - Teanaway Solar

EX 6

Al,

He could come to our building here in Vancouver but I would infinitely prefer he mail it when he gets back to the office. Our Portland offices are not staffed for this sort of transaction.

Thanks!

Nick

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Al Aldrich [mailto:] EX 6
Sent: Wednesday, November 11, 2009 5:22 PM
To: Peck,Nick - TPC-TPP-4
Subject: RE: LGIP introductory links - Teanaway Solar

Nick,

Howard Trott with the Teanaway Solar Reserve will be in Portland tomorrow for a couple of meetings. He told me an hour

12/21/2009

ago that he has or is planning to bring, a check for the deposit. I just scanned your link/attachment on sending payments and didn't see an option for handing a check to someone. Can he do that? If so, to someone at your office or HQ in Portland or...?

Thanks,

Al

Office 206-282-1990

Cell **EX 6**

From: Peck,Nick - TPC-TPP-4 [mailto:cnpeck@bpa.gov]
Sent: Wednesday, October 21, 2009 10:20 AM
To: Al Aldrich
Subject: FW: LGIP introductory links - Teanaway Solar

Al,

It's the first doc (LGIP Appendix 1) we need to establish a queue position. Swift way to do this: Print, complete, sign, scan, email to Interconnection@bpa.gov , cc me. I'll need the 4220.01 very shortly thereafter.

Nick

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Peck,Nick - TPC-TPP-4
Sent: Wednesday, August 05, 2009 4:38 PM
To: **EX 6**
Cc: Fiedler,Paul A - TPC-TPP-4; DeClerck,Angela - TSE-TPP-2; Gilliland,Kimberly D - TPC-TPP-3
Subject: LGIP introductory links - Teanaway Solar

Al,

It was a pleasure to talk to you earlier about the Teanaway Solar project.

12/21/2009

The interconnection process is closely regulated, and is governed by the Large Generator Interconnection Procedures (LGIP); the Interconnection Queue, which establishes the priority of rights for interconnection, is referenced later.

Below are some detailed links that may be helpful in compiling and submitting a Large Generator Interconnection Request; and the relevant forms are attached to this email to assist you.

The LGIP in full is Attachment L to our Tariff, linked from <http://www.transmission.bpa.gov/business/default.cfm> <<http://www.transmission.bpa.gov/business/default.cfm>> (The LGIP begins at the 157th page of the pdf, shown as 'Original sheet 191' .) Our Business Practices are also available from that page. I attach a graphical representation of the entire process as a guideline.

I attach electronic copies of the Interconnection Request Form (Appendix 1; I include also its Attachment A - which is welcome but not required at the Request stage); and the W9e and New Vendor form: we will need the W9e information in advance of, or included with any request, to establish your company in our systems before we can begin the processes of validating the request. Unless you are also requesting transmission service, the information sought by these two forms is all we require and you can ignore, at least for the time being, the more stringent requirements listed under 'Becoming a customer'.

At this site, http://www.transmission.bpa.gov/system_planning/planning_studies/default.cfm <http://www.transmission.bpa.gov/system_planning/planning_studies/default.cfm> , you will find instructions on how to obtain existing study reports - these instructions pertain both to the Transmission studies listed on that page and to the LGIP studies referenced from our Interconnection Queue (http://www.transmission.bpa.gov/Business/Reserve_and_Schedule_Transmission/girequests.cfm <http://www.transmission.bpa.gov/Business/Reserve_and_Schedule_Transmission/girequests.cfm> . The LGIP provides you the right to view completed interconnection studies - redacted to protect commercial information.

For an overview of our NEPA compliance requirements and processes, this page (http://www.efw.bpa.gov/environmental_services/environmentalplanning.aspx <http://www.efw.bpa.gov/environmental_services/environmentalplanning.aspx>) and the links from it are valuable reading. For the website with both complete and on-going environmental reviews, see http://www.efw.bpa.gov/environmental_services/nepadocs.aspx <http://www.efw.bpa.gov/environmental_services/nepadocs.aspx> .

I would be happy to assist you through the Request Submittal process, which it is possible to initiate by emailing signed and scanned documents to "interconnection@bpa.gov <<mailto:interconnection@bpa.gov>> " . We recommend including me as a cc to that email. The deposit (the \$10,000 initial deposit and optional \$10,000 deposit in lieu of Site Control) should be submitted per the attached Payment instructions.

Do not hesitate to call or email with any questions .

Sincerely,

12/21/2009

Nick

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183

Fiedler,Paul A - TPC-TPP-4

From: Al Aldrich **EX 6**
Sent: Friday, November 13, 2009 11:54 AM
To: Peck,Nick - TPC-TPP-4
Subject: Re: LGIP introductory links - Teanaway Solar

Howard told me last night that he sent the deposit and application both by FedEx, so by now they should be delivered--somewhere--to BPA. I don't know exactly where he sent it. If you stumble upon it, please let me know.

Thanks,
Al

Sent using BlackBerry

-----Original Message-----
From: Peck,Nick - TPC-TPP-4 <cnpeck@bpa.gov>
To: Al Aldrich **EX 6**
Sent: Thu Nov 12 13:59:46 2009
Subject: RE: LGIP introductory links - Teanaway Solar

No problem!

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Al Aldrich [mailto:**EX 6**]
Sent: Thursday, November 12, 2009 1:56 PM
To: Peck,Nick - TPC-TPP-4
Subject: Re: LGIP introductory links - Teanaway Solar

Not now, might know later today.

Sent using BlackBerry

-----Original Message-----
From: Peck,Nick - TPC-TPP-4 <cnpeck@bpa.gov>
To: Al Aldrich **EX 6**
Sent: Thu Nov 12 13:50:53 2009
Subject: RE: LGIP introductory links - Teanaway Solar

If there's a tracking number, I can look for it. Any idea to whom it was addressed?

12/21/2009

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Al Aldrich [mailto:EX 6]
Sent: Thursday, November 12, 2009 1:50 PM
To: Peck,Nick - TPC-TPP-4
Subject: Re: LGIP introductory links - Teanaway Solar

They were sent Fed Ex yesterday or today, I found out.
Al

Sent using BlackBerry

-----Original Message-----
From: Peck,Nick - TPC-TPP-4 <cnpeck@bpa.gov>
To: Al Aldrich - EX 6
Sent: Thu Nov 12 09:45:15 2009
Subject: RE: LGIP introductory links - Teanaway Solar

Not yet. How are they arriving...?

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Al Aldrich [mailto:EX 6]
Sent: Thursday, November 12, 2009 9:44 AM
To: Peck,Nick - TPC-TPP-4
Subject: RE: LGIP introductory links - Teanaway Solar

Understandable advice and I have sent it on. Do you have the application papers by now?

From: Peck,Nick - TPC-TPP-4 [mailto:cnpeck@bpa.gov]
Sent: Thursday, November 12, 2009 9:32 AM
To: Al Aldrich EX 6
Subject: RE: LGIP introductory links - Teanaway Solar

12/21/2009

Strong recommendation to use an overnight delivery service:

BPA

Attention: LGIP Administrator

TPC/TPP-4

7500 NE 41st Street, Suite 130

Vancouver, WA 98662

In the memo space on the check, write: Interconnection Request

Hope this helps!!

Nick

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Al Aldrich [mailto:**EX 6**]
Sent: Thursday, November 12, 2009 8:59 AM
To: Peck,Nick - TPC-TPP-4
Subject: RE: LGIP introductory links - Teanaway Solar

What address should he mail it to, Nick?

Thanks,

Al

From: Peck,Nick - TPC-TPP-4 [mailto:cnpeck@bpa.gov]
Sent: Thursday, November 12, 2009 8:53 AM
To: Al Aldrich
Subject: RE: LGIP introductory links - Teanaway Solar

12/21/2009

Al,

He could come to our building here in Vancouver but I would infinitely prefer he mail it when he gets back to the office. Our Portland offices are not staffed for this sort of transaction.

Thanks!

Nick

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Al Aldrich [mailto:**EX 6**]
Sent: Wednesday, November 11, 2009 5:22 PM
To: Peck,Nick - TPC-TPP-4
Subject: RE: LGIP introductory links - Teanaway Solar

Nick,

Howard Trott with the Teanaway Solar Reserve will be in Portland tomorrow for a couple of meetings. He told me an hour ago that he has or is planning to bring, a check for the deposit. I just scanned your link/attachment on sending payments and didn't see an option for handing a check to someone. Can he do that? If so, to someone at your office or HQ in Portland or...?

Thanks,

Al

Office 206-282-1990

Cell **EX 6**

From: Peck,Nick - TPC-TPP-4 [mailto:cnpeck@bpa.gov]
Sent: Wednesday, October 21, 2009 10:20 AM
To: Al Aldrich

12/21/2009

Subject: FW: LGIP introductory links - Teanaway Solar

Al,

It's the first doc (LGIP Appendix 1) we need to establish a queue position. Swift way to do this: Print, complete, sign, scan, email to Interconnection@bpa.gov, cc me. I'll need the 4220.01 very shortly thereafter.

Nick

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Peck,Nick - TPC-TPP-4
Sent: Wednesday, August 05, 2009 4:38 PM
To: EX 6
Cc: Fiedler,Paul A - TPC-TPP-4; DeClerck,Angela - TSE-TPP-2; Gilliland,Kimberly D - TPC-TPP-3
Subject: LGIP introductory links - Teanaway Solar

Al,

It was a pleasure to talk to you earlier about the Teanaway Solar project.

The interconnection process is closely regulated, and is governed by the Large Generator Interconnection Procedures (LGIP); the Interconnection Queue, which establishes the priority of rights for interconnection, is referenced later.

Below are some detailed links that may be helpful in compiling and submitting a Large Generator Interconnection Request; and the relevant forms are attached to this email to assist you.

The LGIP in full is Attachment L to our Tariff, linked from <http://www.transmission.bpa.gov/business/default.cfm> <<http://www.transmission.bpa.gov/business/default.cfm>> (The LGIP begins at the 157th page of the pdf, shown as 'Original sheet 191'.) Our Business Practices are also available from that page. I attach a graphical representation of the entire process as a guideline.

I attach electronic copies of the Interconnection Request Form (Appendix 1; I include also its Attachment A - which is

12/21/2009

welcome but not required at the Request stage); and the W9e and New Vendor form: we will need the W9e information in advance of, or included with any request, to establish your company in our systems before we can begin the processes of validating the request. Unless you are also requesting transmission service, the information sought by these two forms is all we require and you can ignore, at least for the time being, the more stringent requirements listed under 'Becoming a customer'.

At this site, http://www.transmission.bpa.gov/system_planning/planning_studies/default.cfm <http://www.transmission.bpa.gov/system_planning/planning_studies/default.cfm> , you will find instructions on how to obtain existing study reports - these instructions pertain both to the Transmission studies listed on that page and to the LGIP studies referenced from our Interconnection Queue (http://www.transmission.bpa.gov/Business/Reserve_and_Schedule_Transmission/girequests.cfm <http://www.transmission.bpa.gov/Business/Reserve_and_Schedule_Transmission/girequests.cfm> . The LGIP provides you the right to view completed interconnection studies - redacted to protect commercial information.

For an overview of our NEPA compliance requirements and processes, this page (http://www.efw.bpa.gov/environmental_services/environmentalplanning.aspx <http://www.efw.bpa.gov/environmental_services/environmentalplanning.aspx>) and the links from it are valuable reading. For the website with both complete and on-going environmental reviews, see http://www.efw.bpa.gov/environmental_services/nepadocs.aspx <http://www.efw.bpa.gov/environmental_services/nepadocs.aspx> .

I would be happy to assist you through the Request Submittal process, which it is possible to initiate by emailing signed and scanned documents to "interconnection@bpa.gov <<mailto:interconnection@bpa.gov>> " . We recommend including me as a cc to that email. The deposit (the \$10,000 initial deposit and optional \$10,000 deposit in lieu of Site Control) should be submitted per the attached Payment instructions.

Do not hesitate to call or email with any questions .

Sincerely,

Nick

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183

12/21/2009

Fiedler,Paul A - TPC-TPP-4

From: Peck,Nick - TPC-TPP-4
Sent: Thursday, November 12, 2009 1:51 PM
To: 'Al Aldrich' EX 6
Subject: RE: LGIP introductory links - Teanaway Solar

If there's a tracking number, I can look for it. Any idea to whom it was addressed?

Nick Peck

LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Al Aldrich [mailto: EX 6
Sent: Thursday, November 12, 2009 1:50 PM
To: Peck,Nick - TPC-TPP-4
Subject: Re: LGIP introductory links - Teanaway Solar

They were sent Fed Ex yesterday or today, I found out.

Al

Sent using BlackBerry

-----Original Message-----

From: Peck,Nick - TPC-TPP-4 <cnpeck@bpa.gov>
To: Al Aldrich EX 6
Sent: Thu Nov 12 09:45:15 2009
Subject: RE: LGIP introductory links - Teanaway Solar

Not yet. How are they arriving...?

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Al Aldrich [mailto: EX 6
Sent: Thursday, November 12, 2009 9:44 AM
To: Peck,Nick - TPC-TPP-4
Subject: RE: LGIP introductory links - Teanaway Solar

12/21/2009

Understandable advice and I have sent it on. Do you have the application papers by now?

From: Peck,Nick - TPC-TPP-4 [mailto:cnpeck@bpa.gov]
Sent: Thursday, November 12, 2009 9:32 AM
To: Al Aldrich
Subject: RE: LGIP introductory links - Teanaway Solar

Strong recommendation to use an overnight delivery service:

BPA

Attention: LGIP Administrator

TPC/TPP-4

7500 NE 41st Street, Suite 130

Vancouver, WA 98662

In the memo space on the check, write: Interconnection Request

Hope this helps!!

Nick

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Al Aldrich [mailto:EX 6]
Sent: Thursday, November 12, 2009 8:59 AM
To: Peck,Nick - TPC-TPP-4
Subject: RE: LGIP introductory links - Teanaway Solar

What address should he mail it to, Nick?

12/21/2009

Thanks,

Al

From: Peck,Nick - TPC-TPP-4 [mailto:cnpeck@bpa.gov]
Sent: Thursday, November 12, 2009 8:53 AM
To: Al Aldrich
Subject: RE: LGIP introductory links - Teanaway Solar

Al,

He could come to our building here in Vancouver but I would infinitely prefer he mail it when he gets back to the office. Our Portland offices are not staffed for this sort of transaction.

Thanks!

Nick

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Al Aldrich [mailto:EX 6]
Sent: Wednesday, November 11, 2009 5:22 PM
To: Peck,Nick - TPC-TPP-4
Subject: RE: LGIP introductory links - Teanaway Solar

Nick,

Howard Trott with the Teanaway Solar Reserve will be in Portland tomorrow for a couple of meetings. He told me an hour ago that he has or is planning to bring, a check for the deposit. I just scanned your link/attachment on sending payments and didn't see an option for handing a check to someone. Can he do that? If so, to someone at your office or HQ in Portland or...?

Thanks,

12/21/2009

Al

Office 206-282-1990

Cell **EX 6**

From: Peck,Nick - TPC-TPP-4 [mailto:cnpeck@bpa.gov]
Sent: Wednesday, October 21, 2009 10:20 AM
To: Al Aldrich
Subject: FW: LGIP introductory links - Teanaway Solar

Al,

It's the first doc (LGIP Appendix 1) we need to establish a queue position. Swift way to do this: Print, complete, sign, scan, email to Interconnection@bpa.gov , cc me. I'll need the 4220.01 very shortly thereafter.

Nick

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Peck,Nick - TPC-TPP-4
Sent: Wednesday, August 05, 2009 4:38 PM
To: 'a **EX 6**
Cc: Fiedler,Paul A - TPC-TPP-4; DeClerck,Angela - TSE-TPP-2; Gilliland,Kimberly D - TPC-TPP-3
Subject: LGIP introductory links - Teanaway Solar

Al,

It was a pleasure to talk to you earlier about the Teanaway Solar project.

The interconnection process is closely regulated, and is governed by the Large Generator Interconnection Procedures (LGIP); the Interconnection Queue, which establishes the priority of rights for interconnection, is referenced later.

12/21/2009

Below are some detailed links that may be helpful in compiling and submitting a Large Generator Interconnection Request; and the relevant forms are attached to this email to assist you.

The LGIP in full is Attachment L to our Tariff, linked from <http://www.transmission.bpa.gov/business/default.cfm> <<http://www.transmission.bpa.gov/business/default.cfm>> (The LGIP begins at the 157th page of the pdf, shown as 'Original sheet 191' .) Our Business Practices are also available from that page. I attach a graphical representation of the entire process as a guideline.

I attach electronic copies of the Interconnection Request Form (Appendix 1; I include also its Attachment A - which is welcome but not required at the Request stage); and the W9e and New Vendor form: we will need the W9e information in advance of, or included with any request, to establish your company in our systems before we can begin the processes of validating the request. Unless you are also requesting transmission service, the information sought by these two forms is all we require and you can ignore, at least for the time being, the more stringent requirements listed under 'Becoming a customer'.

At this site, http://www.transmission.bpa.gov/system_planning/planning_studies/default.cfm <http://www.transmission.bpa.gov/system_planning/planning_studies/default.cfm> , you will find instructions on how to obtain existing study reports - these instructions pertain both to the Transmission studies listed on that page and to the LGIP studies referenced from our Interconnection Queue (http://www.transmission.bpa.gov/Business/Reserve_and_Schedule_Transmission/girequests.cfm <http://www.transmission.bpa.gov/Business/Reserve_and_Schedule_Transmission/girequests.cfm> . The LGIP provides you the right to view completed interconnection studies - redacted to protect commercial information.

For an overview of our NEPA compliance requirements and processes, this page (http://www.efw.bpa.gov/environmental_services/environmentalplanning.aspx <http://www.efw.bpa.gov/environmental_services/environmentalplanning.aspx>) and the links from it are valuable reading. For the website with both complete and on-going environmental reviews, see http://www.efw.bpa.gov/environmental_services/nepadocs.aspx <http://www.efw.bpa.gov/environmental_services/nepadocs.aspx> .

I would be happy to assist you through the Request Submittal process, which it is possible to initiate by emailing signed and scanned documents to "interconnection@bpa.gov <<mailto:interconnection@bpa.gov>> " . We recommend including me as a cc to that email. The deposit (the \$10,000 initial deposit and optional \$10,000 deposit in lieu of Site Control) should be submitted per the attached Payment instructions.

Do not hesitate to call or email with any questions .

Sincerely,

Nick

12/21/2009

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183

Fiedler,Paul A - TPC-TPP-4

From: Al Aldrich | EX 6
Sent: Thursday, November 12, 2009 1:50 PM
To: Peck,Nick - TPC-TPP-4
Subject: Re: LGIP introductory links - Teanaway Solar

They were sent Fed Ex yesterday or today, I found out.
Al

Sent using BlackBerry

-----Original Message-----

From: Peck,Nick - TPC-TPP-4 <cnpeck@bpa.gov>
To: Al Aldrich <| EX 6
Sent: Thu Nov 12 09:45:15 2009
Subject: RE: LGIP introductory links - Teanaway Solar

Not yet. How are they arriving...?

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Al Aldrich [mailto:| EX 6
Sent: Thursday, November 12, 2009 9:44 AM
To: Peck,Nick - TPC-TPP-4
Subject: RE: LGIP introductory links - Teanaway Solar

Understandable advice and I have sent it on. Do you have the application papers by now?

From: Peck,Nick - TPC-TPP-4 [mailto:cnpeck@bpa.gov]
Sent: Thursday, November 12, 2009 9:32 AM
To: Al Aldrich
Subject: RE: LGIP introductory links - Teanaway Solar

Strong recommendation to use an overnight delivery service:

BPA

Attention: LGIP Administrator

12/21/2009

TPC/TPP-4

7500 NE 41st Street, Suite 130

Vancouver, WA 98662

In the memo space on the check, write: Interconnection Request

Hope this helps!!

Nick

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Al Aldrich [mailto: **EX 6**]
Sent: Thursday, November 12, 2009 8:59 AM
To: Peck,Nick - TPC-TPP-4
Subject: RE: LGIP introductory links - Teanaway Solar

What address should he mail it to, Nick?

Thanks,

Al

From: Peck,Nick - TPC-TPP-4 [mailto:cnpeck@bpa.gov]
Sent: Thursday, November 12, 2009 8:53 AM
To: Al Aldrich
Subject: RE: LGIP introductory links - Teanaway Solar

Al,

He could come to our building here in Vancouver but I would infinitely prefer he mail it when he gets back to the office. Our Portland offices are not staffed for this sort of transaction.

12/21/2009

Thanks!

Nick

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Al Aldrich [mailto:**EX 6**]
Sent: Wednesday, November 11, 2009 5:22 PM
To: Peck,Nick - TPC-TPP-4
Subject: RE: LGIP introductory links - Teanaway Solar

Nick,

Howard Trott with the Teanaway Solar Reserve will be in Portland tomorrow for a couple of meetings. He told me an hour ago that he has or is planning to bring, a check for the deposit. I just scanned your link/attachment on sending payments and didn't see an option for handing a check to someone. Can he do that? If so, to someone at your office or HQ in Portland or...?

Thanks,

Al

Office 206-282-1990

Cell **EX 6**

From: Peck,Nick - TPC-TPP-4 [mailto:cnpeck@bpa.gov]
Sent: Wednesday, October 21, 2009 10:20 AM
To: Al Aldrich
Subject: FW: LGIP introductory links - Teanaway Solar

Al,

12/21/2009

It's the first doc (LGIP Appendix 1) we need to establish a queue position. Swift way to do this: Print, complete, sign, scan, email to Interconnection@bpa.gov , cc me. I'll need the 4220.01 very shortly thereafter.

Nick

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Peck,Nick - TPC-TPP-4
Sent: Wednesday, August 05, 2009 4:38 PM
To: 'EX6'
Cc: Fiedler,Paul A - TPC-TPP-4; DeClerck,Angela - TSE-TPP-2; Gilliland,Kimberly D - TPC-TPP-3
Subject: LGIP introductory links - Teanaway Solar

Al,

It was a pleasure to talk to you earlier about the Teanaway Solar project.

The interconnection process is closely regulated, and is governed by the Large Generator Interconnection Procedures (LGIP); the Interconnection Queue, which establishes the priority of rights for interconnection, is referenced later.

Below are some detailed links that may be helpful in compiling and submitting a Large Generator Interconnection Request; and the relevant forms are attached to this email to assist you.

The LGIP in full is Attachment L to our Tariff, linked from <http://www.transmission.bpa.gov/business/default.cfm> <<http://www.transmission.bpa.gov/business/default.cfm>> (The LGIP begins at the 157th page of the pdf, shown as 'Original sheet 191' .) Our Business Practices are also available from that page. I attach a graphical representation of the entire process as a guideline.

I attach electronic copies of the Interconnection Request Form (Appendix 1; I include also its Attachment A - which is welcome but not required at the Request stage); and the W9e and New Vendor form: we will need the W9e information in advance of, or included with any request, to establish your company in our systems before we can begin the processes of validating the request. Unless you are also requesting transmission service, the information sought by these two forms is all we require and you can ignore, at least for the time being, the more stringent requirements listed under 'Becoming a customer'.

12/21/2009

At this site, http://www.transmission.bpa.gov/system_planning/planning_studies/default.cfm
<http://www.transmission.bpa.gov/system_planning/planning_studies/default.cfm> , you will find instructions on how to obtain existing study reports - these instructions pertain both to the Transmission studies listed on that page and to the LGIP studies referenced from our Interconnection Queue
(http://www.transmission.bpa.gov/Business/Reserve_and_Schedule_Transmission/girequests.cfm
<http://www.transmission.bpa.gov/Business/Reserve_and_Schedule_Transmission/girequests.cfm> . The LGIP provides you the right to view completed interconnection studies - redacted to protect commercial information.

For an overview of our NEPA compliance requirements and processes, this page
(http://www.efw.bpa.gov/environmental_services/environmentalplanning.aspx
<http://www.efw.bpa.gov/environmental_services/environmentalplanning.aspx>) and the links from it are valuable reading. For the website with both complete and on-going environmental reviews, see
http://www.efw.bpa.gov/environmental_services/nepadocs.aspx
<http://www.efw.bpa.gov/environmental_services/nepadocs.aspx> .

I would be happy to assist you through the Request Submittal process, which it is possible to initiate by emailing signed and scanned documents to "interconnection@bpa.gov <<mailto:interconnection@bpa.gov>> " . We recommend including me as a cc to that email. The deposit (the \$10,000 initial deposit and optional \$10,000 deposit in lieu of Site Control) should be submitted per the attached Payment instructions.

Do not hesitate to call or email with any questions .

Sincerely,

Nick

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183

Fiedler,Paul A - TPC-TPP-4

From: Peck,Nick - TPC-TPP-4
Sent: Thursday, November 12, 2009 9:45 AM
To: 'Al Aldrich'
Subject: RE: LGIP introductory links - Teanaway Solar

Not yet. How are they arriving...?

Nick Peck

LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Al Aldrich [mailto:**EX 6**]
Sent: Thursday, November 12, 2009 9:44 AM
To: Peck,Nick - TPC-TPP-4
Subject: RE: LGIP introductory links - Teanaway Solar

Understandable advice and I have sent it on. Do you have the application papers by now?

From: Peck,Nick - TPC-TPP-4 [mailto:cnpeck@bpa.gov]
Sent: Thursday, November 12, 2009 9:32 AM
To: Al Aldrich
Subject: RE: LGIP introductory links - Teanaway Solar

Strong recommendation to use an overnight delivery service:

BPA
Attention: LGIP Administrator
TPC/TPP-4
7500 NE 41st Street, Suite 130
Vancouver, WA 98662

In the memo space on the check, write: Interconnection Request

Hope this helps!!

Nick

Nick Peck

LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183

12/21/2009

Text: 3609802183@vtext.com

From: Al Aldrich [mailto: EX 6]
Sent: Thursday, November 12, 2009 8:59 AM
To: Peck,Nick - TPC-TPP-4
Subject: RE: LGIP introductory links - Teanaway Solar

What address should he mail it to, Nick?

Thanks,
Al

From: Peck,Nick - TPC-TPP-4 [mailto:cnpeck@bpa.gov]
Sent: Thursday, November 12, 2009 8:53 AM
To: Al Aldrich
Subject: RE: LGIP introductory links - Teanaway Solar

Al,

He could come to our building here in Vancouver but I would infinitely prefer he mail it when he gets back to the office. Our Portland offices are not staffed for this sort of transaction.

Thanks!

Nick

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Al Aldrich [mailto: EX 6]
Sent: Wednesday, November 11, 2009 5:22 PM
To: Peck,Nick - TPC-TPP-4
Subject: RE: LGIP introductory links - Teanaway Solar

Nick,

Howard Trott with the Teanaway Solar Reserve will be in Portland tomorrow for a couple of meetings. He told me an hour ago that he has or is planning to bring, a check for the deposit. I just scanned your link/attachment on sending payments and didn't see an option for handing a check to someone. Can he do that? If so, to someone at your office or HQ in Portland or...?

Thanks,
Al

Office 206-282-1990

12/21/2009

Cell EX 6

From: Peck,Nick - TPC-TPP-4 [mailto:cnpeck@bpa.gov]
Sent: Wednesday, October 21, 2009 10:20 AM
To: Al Aldrich
Subject: FW: LGIP introductory links - Teanaway Solar

Al,

It's the first doc (LGIP Appendix 1) we need to establish a queue position. Swift way to do this: Print, complete, sign, scan, email to Interconnection@bpa.gov , cc me. I'll need the 4220.01 very shortly thereafter.

Nick

Nick Peck

LGIP Administrator
 TPC/TPP-4
 Tel: (360) 619-6419
 Fax: (360) 619-6070
 Cell: (360) 980-2183
 Text: 3609802183@vtext.com

From: Peck,Nick - TPC-TPP-4
Sent: Wednesday, August 05, 2009 4:38 PM
To: EX 6
Cc: Fiedler,Paul A - TPC-TPP-4; DeClerck,Angela - TSE-TPP-2; Gilliland,Kimberly D - TPC-TPP-3
Subject: LGIP introductory links - Teanaway Solar

Al,

It was a pleasure to talk to you earlier about the Teanaway Solar project.

The interconnection process is closely regulated, and is governed by the Large Generator Interconnection Procedures (LGIP); the Interconnection Queue, which establishes the priority of rights for interconnection, is referenced later.

Below are some detailed links that may be helpful in compiling and submitting a Large Generator Interconnection Request; and the relevant forms are attached to this email to assist you.

The LGIP in full is Attachment L to our Tariff, linked from <http://www.transmission.bpa.gov/business/default.cfm> (The LGIP begins at the 157th page of the pdf, shown as 'Original sheet 191' .) Our Business Practices are also available from that page. I attach a graphical representation of the entire process as a guideline.

I attach electronic copies of the Interconnection Request Form (Appendix 1; I include also its Attachment A - which is welcome but not required at the Request stage); and the W9e and New Vendor form: we will need the W9e information in advance of, or included with any request, to establish your company in our systems before we can begin the processes of validating the request. *Unless you are also requesting transmission service*, the information sought by these two forms is all we require and you can ignore, at least for the time being, the more stringent requirements listed under 'Becoming a customer'.

At this site, http://www.transmission.bpa.gov/system_planning/planning_studies/default.cfm , you will find instructions on how to obtain existing study reports - these instructions pertain both to the Transmission studies listed on that page and to the LGIP studies referenced from our Interconnection Queue

12/21/2009

(http://www.transmission.bpa.gov/Business/Reserve_and_Schedule_Transmission/girequests.cfm). The LGIP provides you the right to view completed interconnection studies - redacted to protect commercial information.

For an overview of our NEPA compliance requirements and processes, this page (http://www.efw.bpa.gov/environmental_services/environmentalplanning.aspx) and the links from it are valuable reading. For the website with both complete and on-going environmental reviews, see http://www.efw.bpa.gov/environmental_services/nepadocs.aspx.

I would be happy to assist you through the Request Submittal process, which it is possible to initiate by emailing signed and scanned documents to "interconnection@bpa.gov". We recommend including me as a cc to that email. The deposit (the \$10,000 initial deposit and optional \$10,000 deposit in lieu of Site Control) should be submitted per the attached Payment instructions.

Do not hesitate to call or email with any questions .

Sincerely,

Nick

Nick Peck

LGIP Administrator

TPC/TPP-4

Tel: (360) 619-6419

Fax: (360) 619-6070

Cell: (360) 980-2183

Fiedler,Paul A - TPC-TPP-4

From: Al Aldrich _ EX 6
Sent: Thursday, November 12, 2009 9:58 AM
To: Peck,Nick - TPC-TPP-4
Subject: Re: LGIP introductory links - Teanaway Solar

Bot sure, I will check a little later. In something else now.

Sent using BlackBerry

-----Original Message-----

From: Peck,Nick - TPC-TPP-4 <cnpeck@bpa.gov>
To: Al Aldrich < EX 6
Sent: Thu Nov 12 09:45:15 2009
Subject: RE: LGIP introductory links - Teanaway Solar

Not yet. How are they arriving...?

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Al Aldrich [mailto: EX 6
Sent: Thursday, November 12, 2009 9:44 AM
To: Peck,Nick - TPC-TPP-4
Subject: RE: LGIP introductory links - Teanaway Solar

Understandable advice and I have sent it on. Do you have the application papers by now?

From: Peck,Nick - TPC-TPP-4 [mailto:cnpeck@bpa.gov]
Sent: Thursday, November 12, 2009 9:32 AM
To: Al Aldrich
Subject: RE: LGIP introductory links - Teanaway Solar

Strong recommendation to use an overnight delivery service:

BPA

Attention: LGIP Administrator

12/21/2009

TPC/TPP-4

7500 NE 41st Street, Suite 130

Vancouver, WA 98662

In the memo space on the check, write: Interconnection Request

Hope this helps!!

Nick

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Al Aldrich [mailto:**EX 6**]
Sent: Thursday, November 12, 2009 8:59 AM
To: Peck,Nick - TPC-TPP-4
Subject: RE: LGIP introductory links - Teanaway Solar

What address should he mail it to, Nick?

Thanks,

Al

From: Peck,Nick - TPC-TPP-4 [mailto:cnpeck@bpa.gov]
Sent: Thursday, November 12, 2009 8:53 AM
To: Al Aldrich
Subject: RE: LGIP introductory links - Teanaway Solar

Al,

He could come to our building here in Vancouver but I would infinitely prefer he mail it when he gets back to the office. Our Portland offices are not staffed for this sort of transaction.

12/21/2009

Thanks!

Nick

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Al Aldrich [mailto:**EX 6**]
Sent: Wednesday, November 11, 2009 5:22 PM
To: Peck,Nick - TPC-TPP-4
Subject: RE: LGIP introductory links - Teanaway Solar

Nick,

Howard Trott with the Teanaway Solar Reserve will be in Portland tomorrow for a couple of meetings. He told me an hour ago that he has or is planning to bring, a check for the deposit. I just scanned your link/attachment on sending payments and didn't see an option for handing a check to someone. Can he do that? If so, to someone at your office or HQ in Portland or...?

Thanks,

Al

Office 206-282-1990

Cell **EX 6**

From: Peck,Nick - TPC-TPP-4 [mailto:cnpeck@bpa.gov]
Sent: Wednesday, October 21, 2009 10:20 AM
To: Al Aldrich
Subject: FW: LGIP introductory links - Teanaway Solar

Al,

12/21/2009

It's the first doc (LGIP Appendix 1) we need to establish a queue position. Swift way to do this: Print, complete, sign, scan, email to Interconnection@bpa.gov, cc me. I'll need the 4220.01 very shortly thereafter.

Nick

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Peck,Nick - TPC-TPP-4
Sent: Wednesday, August 05, 2009 4:38 PM
To: 'EX 6'
Cc: Fiedler,Paul A - TPC-TPP-4; DeClerck,Angela - TSE-TPP-2; Gilliland,Kimberly D - TPC-TPP-3
Subject: LGIP introductory links - Teanaway Solar

Al,

It was a pleasure to talk to you earlier about the Teanaway Solar project.

The interconnection process is closely regulated, and is governed by the Large Generator Interconnection Procedures (LGIP); the Interconnection Queue, which establishes the priority of rights for interconnection, is referenced later.

Below are some detailed links that may be helpful in compiling and submitting a Large Generator Interconnection Request; and the relevant forms are attached to this email to assist you.

The LGIP in full is Attachment L to our Tariff, linked from <http://www.transmission.bpa.gov/business/default.cfm> <<http://www.transmission.bpa.gov/business/default.cfm>> (The LGIP begins at the 157th page of the pdf, shown as 'Original sheet 191' .) Our Business Practices are also available from that page. I attach a graphical representation of the entire process as a guideline.

I attach electronic copies of the Interconnection Request Form (Appendix 1; I include also its Attachment A - which is welcome but not required at the Request stage); and the W9e and New Vendor form: we will need the W9e information in advance of, or included with any request, to establish your company in our systems before we can begin the processes of validating the request. Unless you are also requesting transmission service, the information sought by these two forms is all we require and you can ignore, at least for the time being, the more stringent requirements listed under 'Becoming a customer'.

12/21/2009

At this site, http://www.transmission.bpa.gov/system_planning/planning_studies/default.cfm
<http://www.transmission.bpa.gov/system_planning/planning_studies/default.cfm> , you will find instructions on how to obtain existing study reports - these instructions pertain both to the Transmission studies listed on that page and to the LGIP studies referenced from our Interconnection Queue
(http://www.transmission.bpa.gov/Business/Reserve_and_Schedule_Transmission/girequests.cfm
<http://www.transmission.bpa.gov/Business/Reserve_and_Schedule_Transmission/girequests.cfm> . The LGIP provides you the right to view completed interconnection studies - redacted to protect commercial information.

For an overview of our NEPA compliance requirements and processes, this page
(http://www.efw.bpa.gov/environmental_services/environmentalplanning.aspx
<http://www.efw.bpa.gov/environmental_services/environmentalplanning.aspx>) and the links from it are valuable reading. For the website with both complete and on-going environmental reviews, see
http://www.efw.bpa.gov/environmental_services/nepadocs.aspx
<http://www.efw.bpa.gov/environmental_services/nepadocs.aspx> .

I would be happy to assist you through the Request Submittal process, which it is possible to initiate by emailing signed and scanned documents to "interconnection@bpa.gov <<mailto:interconnection@bpa.gov>> " . We recommend including me as a cc to that email. The deposit (the \$10,000 initial deposit and optional \$10,000 deposit in lieu of Site Control) should be submitted per the attached Payment instructions.

Do not hesitate to call or email with any questions .

Sincerely,

Nick

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183

Fiedler,Paul A - TPC-TPP-4

From: Peck,Nick - TPC-TPP-4
Sent: Thursday, November 12, 2009 9:32 AM
To: 'Al Aldrich'
Subject: RE: LGIP introductory links - Teanaway Solar

Strong recommendation to use an overnight delivery service:

BPA
Attention: LGIP Administrator
TPC/TPP-4
7500 NE 41st Street, Suite 130
Vancouver, WA 98662

In the memo space on the check, write: Interconnection Request

Hope this helps!!

Nick

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Al Aldrich [mailto:[EX 6](mailto:EX6)]
Sent: Thursday, November 12, 2009 8:59 AM
To: Peck,Nick - TPC-TPP-4
Subject: RE: LGIP introductory links - Teanaway Solar

What address should he mail it to, Nick?

Thanks,
Al

From: Peck,Nick - TPC-TPP-4 [mailto:cnpeck@bpa.gov]
Sent: Thursday, November 12, 2009 8:53 AM
To: Al Aldrich
Subject: RE: LGIP introductory links - Teanaway Solar

Al,

He could come to our building here in Vancouver but I would infinitely prefer he mail it when he gets back to the office. Our Portland offices are not staffed for this sort of transaction.

Thanks!

12/21/2009

Nick

Nick Peck

LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Al Aldrich [mailto: EX 6]
Sent: Wednesday, November 11, 2009 5:22 PM
To: Peck,Nick - TPC-TPP-4
Subject: RE: LGIP introductory links - Teanaway Solar

Nick,

Howard Trott with the Teanaway Solar Reserve will be in Portland tomorrow for a couple of meetings. He told me an hour ago that he has or is planning to bring, a check for the deposit. I just scanned your link/attachment on sending payments and didn't see an option for handing a check to someone. Can he do that? If so, to someone at your office or HQ in Portland or...?

Thanks,
Al

Office 206-282-1990
Cell EX 6

From: Peck,Nick - TPC-TPP-4 [mailto:cnpeck@bpa.gov]
Sent: Wednesday, October 21, 2009 10:20 AM
To: Al Aldrich
Subject: FW: LGIP introductory links - Teanaway Solar

Al,

It's the first doc (LGIP Appendix 1) we need to establish a queue position. Swift way to do this: Print, complete, sign, scan, email to Interconnection@bpa.gov , cc me. I'll need the 4220.01 very shortly thereafter.

Nick

Nick Peck

LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Peck,Nick - TPC-TPP-4

12/21/2009

Sent: Wednesday, August 05, 2009 4:38 PM

To: EX 6

Cc: Fiedler,Paul A - TPC-TPP-4; DeClerck,Angela - TSE-TPP-2; Gilliland,Kimberly D - TPC-TPP-3

Subject: LGIP introductory links - Teanaway Solar

Al,

It was a pleasure to talk to you earlier about the Teanaway Solar project.

The interconnection process is closely regulated, and is governed by the Large Generator Interconnection Procedures (LGIP); the Interconnection Queue, which establishes the priority of rights for interconnection, is referenced later.

Below are some detailed links that may be helpful in compiling and submitting a Large Generator Interconnection Request; and the relevant forms are attached to this email to assist you.

The LGIP in full is Attachment L to our Tariff, linked from <http://www.transmission.bpa.gov/business/default.cfm> (The LGIP begins at the 157th page of the pdf, shown as 'Original sheet 191' .) Our Business Practices are also available from that page. I attach a graphical representation of the entire process as a guideline.

I attach electronic copies of the Interconnection Request Form (Appendix 1; I include also its Attachment A - which is welcome but not required at the Request stage); and the W9e and New Vendor form: we will need the W9e information in advance of, or included with any request, to establish your company in our systems before we can begin the processes of validating the request. *Unless you are also requesting transmission service*, the information sought by these two forms is all we require and you can ignore, at least for the time being, the more stringent requirements listed under 'Becoming a customer'.

At this site, http://www.transmission.bpa.gov/system_planning/planning_studies/default.cfm , you will find instructions on how to obtain existing study reports - these instructions pertain both to the Transmission studies listed on that page and to the LGIP studies referenced from our Interconnection Queue (http://www.transmission.bpa.gov/Business/Reserve_and_Schedule_Transmission/girequests.cfm). The LGIP provides you the right to view completed interconnection studies - redacted to protect commercial information.

For an overview of our NEPA compliance requirements and processes, this page (http://www.efw.bpa.gov/environmental_services/environmentalplanning.aspx) and the links from it are valuable reading. For the website with both complete and on-going environmental reviews, see http://www.efw.bpa.gov/environmental_services/nepadocs.aspx.

I would be happy to assist you through the Request Submittal process, which it is possible to initiate by emailing signed and scanned documents to "interconnection@bpa.gov". We recommend including me as a cc to that email. The deposit (the \$10,000 initial deposit and optional \$10,000 deposit in lieu of Site Control) should be submitted per the attached Payment instructions.

Do not hesitate to call or email with any questions .

Sincerely,

Nick

Nick Peck

LGIP Administrator

TPC/TPP-4

Tel: (360) 619-6419

Fax: (360) 619-6070

Cell: (360) 980-2183

12/21/2009

Fiedler,Paul A - TPC-TPP-4

From: Al Aldrich [EX 6
Sent: Thursday, November 12, 2009 9:44 AM
To: Peck,Nick - TPC-TPP-4
Subject: RE: LGIP introductory links - Teanaway Solar

Understandable advice and I have sent it on. Do you have the application papers by now?

From: Peck,Nick - TPC-TPP-4 [mailto:cnpeck@bpa.gov]
Sent: Thursday, November 12, 2009 9:32 AM
To: Al Aldrich EX 6
Subject: RE: LGIP introductory links - Teanaway Solar

Strong recommendation to use an overnight delivery service:

BPA
Attention: LGIP Administrator
TPC/TPP-4
7500 NE 41st Street, Suite 130
Vancouver, WA 98662

In the memo space on the check, write: Interconnection Request

Hope this helps!!

Nick

Nick Peck

LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Al Aldrich [mailto: EX 6
Sent: Thursday, November 12, 2009 8:59 AM
To: Peck,Nick - TPC-TPP-4
Subject: RE: LGIP introductory links - Teanaway Solar

What address should he mail it to, Nick?

Thanks,
Al

From: Peck,Nick - TPC-TPP-4 [mailto:cnpeck@bpa.gov]
Sent: Thursday, November 12, 2009 8:53 AM
To: Al Aldrich
Subject: RE: LGIP introductory links - Teanaway Solar

12/21/2009

Al,

He could come to our building here in Vancouver but I would infinitely prefer he mail it when he gets back to the office. Our Portland offices are not staffed for this sort of transaction.

Thanks!

Nick

Nick Peck

LGIP Administrator

TPC/TPP-4

Tel: (360) 619-6419

Fax: (360) 619-6070

Cell: (360) 980-2183

Text: 3609802183@vtext.com

From: Al Aldrich [mailto: EX 6]
Sent: Wednesday, November 11, 2009 5:22 PM
To: Peck,Nick - TPC-TPP-4
Subject: RE: LGIP introductory links - Teanaway Solar

Nick,

Howard Trott with the Teanaway Solar Reserve will be in Portland tomorrow for a couple of meetings. He told me an hour ago that he has or is planning to bring, a check for the deposit. I just scanned your link/attachment on sending payments and didn't see an option for handing a check to someone. Can he do that? If so, to someone at your office or HQ in Portland or...?

Thanks,

Al

Office 206-282-1990

Cell EX 6

From: Peck,Nick - TPC-TPP-4 [mailto:cnpeck@bpa.gov]
Sent: Wednesday, October 21, 2009 10:20 AM
To: Al Aldrich
Subject: FW: LGIP introductory links - Teanaway Solar

Al,

It's the first doc (LGIP Appendix 1) we need to establish a queue position. Swift way to do this: Print, complete, sign, scan, email to Interconnection@bpa.gov , cc me. I'll need the 4220.01 very shortly thereafter.

Nick

Nick Peck

LGIP Administrator

TPC/TPP-4

12/21/2009

Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Peck,Nick - TPC-TPP-4
Sent: Wednesday, August 05, 2009 4:38 PM
To: ' EX 6
Cc: Fiedler,Paul A - TPC-TPP-4; DeClerck,Angela - TSE-TPP-2; Gilliland,Kimberly D - TPC-TPP-3
Subject: LGIP introductory links - Teanaway Solar

Al,

It was a pleasure to talk to you earlier about the Teanaway Solar project.

The interconnection process is closely regulated, and is governed by the Large Generator Interconnection Procedures (LGIP); the Interconnection Queue, which establishes the priority of rights for interconnection, is referenced later.

Below are some detailed links that may be helpful in compiling and submitting a Large Generator Interconnection Request; and the relevant forms are attached to this email to assist you.

The LGIP in full is Attachment L to our Tariff, linked from <http://www.transmission.bpa.gov/business/default.cfm> (The LGIP begins at the 157th page of the pdf, shown as 'Original sheet 191' .) Our Business Practices are also available from that page. I attach a graphical representation of the entire process as a guideline.

I attach electronic copies of the Interconnection Request Form (Appendix 1; I include also its Attachment A - which is welcome but not required at the Request stage); and the W9e and New Vendor form: we will need the W9e information in advance of, or included with any request, to establish your company in our systems before we can begin the processes of validating the request. *Unless you are also requesting transmission service*, the information sought by these two forms is all we require and you can ignore, at least for the time being, the more stringent requirements listed under 'Becoming a customer'.

At this site, http://www.transmission.bpa.gov/system_planning/planning_studies/default.cfm , you will find instructions on how to obtain existing study reports - these instructions pertain both to the Transmission studies listed on that page and to the LGIP studies referenced from our Interconnection Queue (http://www.transmission.bpa.gov/Business/Reserve_and_Schedule_Transmission/girequests.cfm). The LGIP provides you the right to view completed interconnection studies - redacted to protect commercial information.

For an overview of our NEPA compliance requirements and processes, this page (http://www.efw.bpa.gov/environmental_services/environmentalplanning.aspx) and the links from it are valuable reading. For the website with both complete and on-going environmental reviews, see http://www.efw.bpa.gov/environmental_services/nepadocs.aspx.

I would be happy to assist you through the Request Submittal process, which it is possible to initiate by emailing signed and scanned documents to "interconnection@bpa.gov". We recommend including me as a cc to that email. The deposit (the \$10,000 initial deposit and optional \$10,000 deposit in lieu of Site Control) should be submitted per the attached Payment instructions.

Do not hesitate to call or email with any questions .

Sincerely,

Nick

12/21/2009

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183

Fiedler,Paul A - TPC-TPP-4

From: Al Aldrich [mailto:EX 6]
Sent: Thursday, November 12, 2009 8:59 AM
To: Peck,Nick - TPC-TPP-4
Subject: RE: LGIP introductory links - Teanaway Solar

What address should he mail it to, Nick?

Thanks,
Al

From: Peck,Nick - TPC-TPP-4 [mailto:cnpeck@bpa.gov]
Sent: Thursday, November 12, 2009 8:53 AM
To: Al Aldrich
Subject: RE: LGIP introductory links - Teanaway Solar

Al,

He could come to our building here in Vancouver but I would infinitely prefer he mail it when he gets back to the office. Our Portland offices are not staffed for this sort of transaction.

Thanks!

Nick

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Al Aldrich [mailto:EX 6]
Sent: Wednesday, November 11, 2009 5:22 PM
To: Peck,Nick - TPC-TPP-4
Subject: RE: LGIP introductory links - Teanaway Solar

Nick,

Howard Trott with the Teanaway Solar Reserve will be in Portland tomorrow for a couple of meetings. He told me an hour ago that he has or is planning to bring, a check for the deposit. I just scanned your link/attachment on sending payments and didn't see an option for handing a check to someone. Can he do that? If so, to someone at your office or HQ in Portland or...?

Thanks,
Al

12/21/2009

Office 206-282-1990

Cell EX 6

From: Peck,Nick - TPC-TPP-4 [mailto:cnpeck@bpa.gov]
Sent: Wednesday, October 21, 2009 10:20 AM
To: Al Aldrich
Subject: FW: LGIP introductory links - Teanaway Solar

Al,

It's the first doc (LGIP Appendix 1) we need to establish a queue position. Swift way to do this: Print, complete, sign, scan, email to Interconnection@bpa.gov , cc me. I'll need the 4220.01 very shortly thereafter.

Nick

Nick Peck

LGIP Administrator

TPC/TPP-4

Tel: (360) 619-6419

Fax: (360) 619-6070

Cell: (360) 980-2183

Text: 3609802183@vtext.com

From: Peck,Nick - TPC-TPP-4
Sent: Wednesday, August 05, 2009 4:38 PM
To: EX 6
Cc: Fiedler,Paul A - TPC-TPP-4; DeClerck,Angela - TSE-TPP-2; Gilliland,Kimberly D - TPC-TPP-3
Subject: LGIP introductory links - Teanaway Solar

Al,

It was a pleasure to talk to you earlier about the Teanaway Solar project.

The interconnection process is closely regulated, and is governed by the Large Generator Interconnection Procedures (LGIP); the Interconnection Queue, which establishes the priority of rights for interconnection, is referenced later.

Below are some detailed links that may be helpful in compiling and submitting a Large Generator Interconnection Request; and the relevant forms are attached to this email to assist you.

The LGIP in full is Attachment L to our Tariff, linked from <http://www.transmission.bpa.gov/business/default.cfm> (The LGIP begins at the 157th page of the pdf, shown as 'Original sheet 191' .) Our Business Practices are also available from that page. I attach a graphical representation of the entire process as a guideline.

I attach electronic copies of the Interconnection Request Form (Appendix 1; I include also its Attachment A - which is welcome but not required at the Request stage); and the W9e and New Vendor form: we will need the W9e information in advance of, or included with any request, to establish your company in our systems before we can begin the processes of validating the request. *Unless you are also requesting transmission service*, the information sought by these two forms is all we require and you can ignore, at least for the time being, the more stringent requirements listed under 'Becoming a customer'.

At this site, http://www.transmission.bpa.gov/system_planning/planning_studies/default.cfm , you will find instructions on how to obtain existing study reports - these instructions pertain both to the Transmission studies

12/21/2009

listed on that page and to the LGIP studies referenced from our Interconnection Queue (http://www.transmission.bpa.gov/Business/Reserve_and_Schedule_Transmission/girequests.cfm). The LGIP provides you the right to view completed interconnection studies - redacted to protect commercial information.

For an overview of our NEPA compliance requirements and processes, this page (http://www.efw.bpa.gov/environmental_services/environmentalplanning.aspx) and the links from it are valuable reading. For the website with both complete and on-going environmental reviews, see http://www.efw.bpa.gov/environmental_services/nepadocs.aspx.

I would be happy to assist you through the Request Submittal process, which it is possible to initiate by emailing signed and scanned documents to "interconnection@bpa.gov". We recommend including me as a cc to that email. The deposit (the \$10,000 initial deposit and optional \$10,000 deposit in lieu of Site Control) should be submitted per the attached Payment instructions.

Do not hesitate to call or email with any questions .

Sincerely,

Nick

Nick Peck

LGIP Administrator

TPC/TPP-4

Tel: (360) 619-6419

Fax: (360) 619-6070

Cell: (360) 980-2183

Fiedler,Paul A - TPC-TPP-4

From: Peck,Nick - TPC-TPP-4
Sent: Thursday, November 12, 2009 8:53 AM
To: 'Al Aldrich'
Subject: RE: LGIP introductory links - Teanaway Solar

Al,

He could come to our building here in Vancouver but I would infinitely prefer he mail it when he gets back to the office. Our Portland offices are not staffed for this sort of transaction.

Thanks!

Nick

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Al Aldrich [mailto:**EX 6**]
Sent: Wednesday, November 11, 2009 5:22 PM
To: Peck,Nick - TPC-TPP-4
Subject: RE: LGIP introductory links - Teanaway Solar

Nick,

Howard Trott with the Teanaway Solar Reserve will be in Portland tomorrow for a couple of meetings. He told me an hour ago that he has or is planning to bring, a check for the deposit. I just scanned your link/attachment on sending payments and didn't see an option for handing a check to someone. Can he do that? If so, to someone at your office or HQ in Portland or...?

Thanks,
Al

Office 206-282-1990
Cell **EX 6**

From: Peck,Nick - TPC-TPP-4 [mailto:cnpeck@bpa.gov]
Sent: Wednesday, October 21, 2009 10:20 AM
To: Al Aldrich
Subject: FW: LGIP introductory links - Teanaway Solar

Al,

It's the first doc (LGIP Appendix 1) we need to establish a queue position. Swift way to do this: Print, complete,

12/21/2009

sign, scan, email to Interconnection@bpa.gov , cc me. I'll need the 4220.01 very shortly thereafter.

Nick

Nick Peck

LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Peck,Nick - TPC-TPP-4
Sent: Wednesday, August 05, 2009 4:38 PM
To: EX 6
Cc: Fiedler,Paul A - TPC-TPP-4; DeClerck,Angela - TSE-TPP-2; Gilliland,Kimberly D - TPC-TPP-3
Subject: LGIP introductory links - Teanaway Solar

Al,

It was a pleasure to talk to you earlier about the Teanaway Solar project.

The interconnection process is closely regulated, and is governed by the Large Generator Interconnection Procedures (LGIP); the Interconnection Queue, which establishes the priority of rights for interconnection, is referenced later.

Below are some detailed links that may be helpful in compiling and submitting a Large Generator Interconnection Request; and the relevant forms are attached to this email to assist you.

The LGIP in full is Attachment L to our Tariff, linked from <http://www.transmission.bpa.gov/business/default.cfm> (The LGIP begins at the 157th page of the pdf, shown as 'Original sheet 191' .) Our Business Practices are also available from that page. I attach a graphical representation of the entire process as a guideline.

I attach electronic copies of the Interconnection Request Form (Appendix 1; I include also its Attachment A - which is welcome but not required at the Request stage); and the W9e and New Vendor form: we will need the W9e information in advance of, or included with any request, to establish your company in our systems before we can begin the processes of validating the request. *Unless you are also requesting transmission service*, the information sought by these two forms is all we require and you can ignore, at least for the time being, the more stringent requirements listed under 'Becoming a customer'.

At this site, http://www.transmission.bpa.gov/system_planning/planning_studies/default.cfm , you will find instructions on how to obtain existing study reports - these instructions pertain both to the Transmission studies listed on that page and to the LGIP studies referenced from our Interconnection Queue (http://www.transmission.bpa.gov/Business/Reserve_and_Schedule_Transmission/girequests.cfm). The LGIP provides you the right to view completed interconnection studies - redacted to protect commercial information.

For an overview of our NEPA compliance requirements and processes, this page (http://www.efw.bpa.gov/environmental_services/environmentalplanning.aspx) and the links from it are valuable reading. For the website with both complete and on-going environmental reviews, see http://www.efw.bpa.gov/environmental_services/nepadocs.aspx.

I would be happy to assist you through the Request Submittal process, which it is possible to initiate by emailing signed and scanned documents to "interconnection@bpa.gov". We recommend including me as a cc to that email. The deposit (the \$10,000 initial deposit and optional \$10,000 deposit in lieu of Site Control) should be

12/21/2009

submitted per the attached Payment instructions.

Do not hesitate to call or email with any questions .

Sincerely,

Nick

Nick Peck

LGIP Administrator

TPC/TPP-4

Tel: (360) 619-6419

Fax: (360) 619-6070

Cell: (360) 980-2183

Fiedler,Paul A - TPC-TPP-4

From: Al Aldrich [EX 6]
Sent: Wednesday, November 11, 2009 5:22 PM
To: Peck,Nick - TPC-TPP-4
Subject: RE: LGIP introductory links - Teanaway Solar

Nick,

Howard Trott with the Teanaway Solar Reserve will be in Portland tomorrow for a couple of meetings. He told me an hour ago that he has or is planning to bring, a check for the deposit. I just scanned your link/attachment on sending payments and didn't see an option for handing a check to someone. Can he do that? If so, to someone at your office or HQ in Portland or...?

Thanks,
 Al

Office 206-282-1990
 Cell EX 6

From: Peck,Nick - TPC-TPP-4 [mailto:cnpeck@bpa.gov]
Sent: Wednesday, October 21, 2009 10:20 AM
To: Al Aldrich
Subject: FW: LGIP introductory links - Teanaway Solar

Al,

It's the first doc (LGIP Appendix 1) we need to establish a queue position. Swift way to do this: Print, complete, sign, scan, email to Interconnection@bpa.gov , cc me. I'll need the 4220.01 very shortly thereafter.

Nick

Nick Peck

LGIP Administrator
 TPC/TPP-4
 Tel: (360) 619-6419
 Fax: (360) 619-6070
 Cell: (360) 980-2183
 Text: 3609802183@vtext.com

From: Peck,Nick - TPC-TPP-4
Sent: Wednesday, August 05, 2009 4:38 PM
To: EX 6
Cc: Fiedler,Paul A - TPC-TPP-4; DeClerck,Angela - TSE-TPP-2; Gilliland,Kimberly D - TPC-TPP-3
Subject: LGIP introductory links - Teanaway Solar

Al,

It was a pleasure to talk to you earlier about the Teanaway Solar project.

12/21/2009

The interconnection process is closely regulated, and is governed by the Large Generator Interconnection Procedures (LGIP); the Interconnection Queue, which establishes the priority of rights for interconnection, is referenced later.

Below are some detailed links that may be helpful in compiling and submitting a Large Generator Interconnection Request; and the relevant forms are attached to this email to assist you.

The LGIP in full is Attachment L to our Tariff, linked from <http://www.transmission.bpa.gov/business/default.cfm> (The LGIP begins at the 157th page of the pdf, shown as 'Original sheet 191' .) Our Business Practices are also available from that page. I attach a graphical representation of the entire process as a guideline.

I attach electronic copies of the Interconnection Request Form (Appendix 1; I include also its Attachment A - which is welcome but not required at the Request stage); and the W9e and New Vendor form: we will need the W9e information in advance of, or included with any request, to establish your company in our systems before we can begin the processes of validating the request. Unless you are also requesting transmission service, the information sought by these two forms is all we require and you can ignore, at least for the time being, the more stringent requirements listed under 'Becoming a customer'.

At this site, http://www.transmission.bpa.gov/system_planning/planning_studies/default.cfm , you will find instructions on how to obtain existing study reports - these instructions pertain both to the Transmission studies listed on that page and to the LGIP studies referenced from our Interconnection Queue (http://www.transmission.bpa.gov/Business/Reserve_and_Schedule_Transmission/girequests.cfm). The LGIP provides you the right to view completed interconnection studies - redacted to protect commercial information.

For an overview of our NEPA compliance requirements and processes, this page (http://www.efw.bpa.gov/environmental_services/environmentalplanning.aspx) and the links from it are valuable reading. For the website with both complete and on-going environmental reviews, see http://www.efw.bpa.gov/environmental_services/nepadocs.aspx.

I would be happy to assist you through the Request Submittal process, which it is possible to initiate by emailing signed and scanned documents to "interconnection@bpa.gov". We recommend including me as a cc to that email. The deposit (the \$10,000 initial deposit and optional \$10,000 deposit in lieu of Site Control) should be submitted per the attached Payment instructions.

Do not hesitate to call or email with any questions .

Sincerely,

Nick

Nick Peck

LGIP Administrator

TPC/TPP-4

Tel: (360) 619-6419

Fax: (360) 619-6070

Cell: (360) 980-2183

12/21/2009

Fiedler,Paul A - TPC-TPP-4

From: Al Aldrich EX 6
Sent: Wednesday, October 21, 2009 11:22 AM
To: Peck,Nick - TPC-TPP-4
Subject: RE: LGIP introductory links - Teanaway Solar

Thanks, Nick!
Al

From: Peck,Nick - TPC-TPP-4 [mailto:cnpeck@bpa.gov]
Sent: Wednesday, October 21, 2009 10:20 AM
To: Al Aldrich
Subject: FW: LGIP introductory links - Teanaway Solar

Al,

It's the first doc (LGIP Appendix 1) we need to establish a queue position. Swift way to do this: Print, complete, sign, scan, email to Interconnection@bpa.gov , cc me. I'll need the 4220.01 very shortly thereafter.

Nick

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Peck,Nick - TPC-TPP-4
Sent: Wednesday, August 05, 2009 4:38 PM
To: ' EX 6
Cc: Fiedler,Paul A - TPC-TPP-4; DeClerck,Angela - TSE-TPP-2; Gilliland,Kimberly D - TPC-TPP-3
Subject: LGIP introductory links - Teanaway Solar

Al,

It was a pleasure to talk to you earlier about the Teanaway Solar project.

The interconnection process is closely regulated, and is governed by the Large Generator Interconnection Procedures (LGIP); the Interconnection Queue, which establishes the priority of rights for interconnection, is referenced later.

Below are some detailed links that may be helpful in compiling and submitting a Large Generator Interconnection Request; and the relevant forms are attached to this email to assist you.

The LGIP in full is Attachment L to our Tariff, linked from <http://www.transmission.bpa.gov/business/default.cfm> (The LGIP begins at the 157th page of the pdf, shown as 'Original sheet 191' .) Our Business Practices are also available from that page. I attach a graphical representation of the entire process as a guideline.

12/21/2009

I attach electronic copies of the Interconnection Request Form (Appendix 1; I include also its Attachment A - which is welcome but not required at the Request stage); and the W9e and New Vendor form: we will need the W9e information in advance of, or included with any request, to establish your company in our systems before we can begin the processes of validating the request. *Unless you are also requesting transmission service*, the information sought by these two forms is all we require and you can ignore, at least for the time being, the more stringent requirements listed under 'Becoming a customer'.

At this site, http://www.transmission.bpa.gov/system_planning/planning_studies/default.cfm , you will find instructions on how to obtain existing study reports - these instructions pertain both to the Transmission studies listed on that page and to the LGIP studies referenced from our Interconnection Queue (http://www.transmission.bpa.gov/Business/Reserve_and_Schedule_Transmission/girequests.cfm). The LGIP provides you the right to view completed interconnection studies - redacted to protect commercial information.

For an overview of our NEPA compliance requirements and processes, this page (http://www.efw.bpa.gov/environmental_services/environmentalplanning.aspx) and the links from it are valuable reading. For the website with both complete and on-going environmental reviews, see http://www.efw.bpa.gov/environmental_services/nepadocs.aspx.

I would be happy to assist you through the Request Submittal process, which it is possible to initiate by emailing signed and scanned documents to "interconnection@bpa.gov". We recommend including me as a cc to that email. The deposit (the \$10,000 initial deposit and optional \$10,000 deposit in lieu of Site Control) should be submitted per the attached Payment instructions.

Do not hesitate to call or email with any questions .

Sincerely,

Nick

Nick Peck

LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183

Fiedler,Paul A - TPC-TPP-4

From: Peck,Nick - TPC-TPP-4
Sent: Tuesday, October 20, 2009 4:04 PM
To: 'Al Aldrich'
Subject: RE: LGIP introductory links - Teanaway Solar

No problem!!

Nick Peck

LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Al Aldrich [mailto: EX 6
Sent: Tuesday, October 20, 2009 3:56 PM
To: Peck,Nick - TPC-TPP-4
Subject: Re: LGIP introductory links - Teanaway Solar

Nick,
Our impulsive salmon fishing trip up to the Skagit River has run longwr than expected today. I will call you in the morning.
Thanks,
Al

Sent using BlackBerry

-----Original Message-----
From: Peck,Nick - TPC-TPP-4 <cnpeck@bpa.gov>
To: Al Aldrich < EX 6
Sent: Mon Oct 19 16:38:46 2009
Subject: RE: LGIP introductory links - Teanaway Solar

Great, thanks!

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Al Aldrich [mailto: EX 6
Sent: Monday, October 19, 2009 4:19 PM

12/21/2009

To: Peck,Nick - TPC-TPP-4
Subject: Re: LGIP introductory links - Teanaway Solar

I will call you tomorrow afternoon, Nick, with an update of what I know. I'm traveling right now.

Thanks,
Al

Sent using BlackBerry

-----Original Message-----
From: Peck,Nick - TPC-TPP-4 <cnpeck@bpa.gov>
To: Al Aldrich - EX 6
CC: Fiedler,Paul A - TPC-TPP-4 <pafiedler@bpa.gov>
Sent: Mon Oct 19 14:35:36 2009
Subject: FW: LGIP introductory links - Teanaway Solar

Al,

Following our initial flurry of contact, I am curious if there is any headway we should be expecting soon?

Don't hesitate to call me if you have any outstanding questions.

Sincerely,

Nick

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Al Aldrich [mailto: EX 6]
Sent: Thursday, August 06, 2009 1:52 PM
To: Peck,Nick - TPC-TPP-4
Subject: RE: LGIP introductory links - Teanaway Solar

Nick,

Great info and thanks! I will try to find out how soon Howard Trott and his group plan to make the deposit so I can advise you. We also appreciate your willingness to help us through the process. We will stay in touch.

12/21/2009

Thanks,

Al

From: Peck,Nick - TPC-TPP-4 [mailto:cnpeck@bpa.gov]
Sent: Wednesday, August 05, 2009 4:38 PM
To: Al Aldrich
Cc: Fiedler,Paul A - TPC-TPP-4; DeClerck,Angela - TSE-TPP-2; Gilliland,Kimberly D - TPC-TPP-3
Subject: LGIP introductory links - Teanaway Solar

Al,

It was a pleasure to talk to you earlier about the Teanaway Solar project.

The interconnection process is closely regulated, and is governed by the Large Generator Interconnection Procedures (LGIP); the Interconnection Queue, which establishes the priority of rights for interconnection, is referenced later.

Below are some detailed links that may be helpful in compiling and submitting a Large Generator Interconnection Request; and the relevant forms are attached to this email to assist you.

The LGIP in full is Attachment L to our Tariff, linked from <http://www.transmission.bpa.gov/business/default.cfm> <<http://www.transmission.bpa.gov/business/default.cfm>> (The LGIP begins at the 157th page of the pdf, shown as 'Original sheet 191' .) Our Business Practices are also available from that page. I attach a graphical representation of the entire process as a guideline.

I attach electronic copies of the Interconnection Request Form (Appendix 1; I include also its Attachment A - which is welcome but not required at the Request stage); and the W9e and New Vendor form: we will need the W9e information in advance of, or included with any request, to establish your company in our systems before we can begin the processes of validating the request. Unless you are also requesting transmission service, the information sought by these two forms is all we require and you can ignore, at least for the time being, the more stringent requirements listed under 'Becoming a customer'.

At this site, http://www.transmission.bpa.gov/system_planning/planning_studies/default.cfm <http://www.transmission.bpa.gov/system_planning/planning_studies/default.cfm> , you will find instructions on how to obtain existing study reports - these instructions pertain both to the Transmission studies listed on that page and to the LGIP studies referenced from our Interconnection Queue (http://www.transmission.bpa.gov/Business/Reserve_and_Schedule_Transmission/girequests.cfm <http://www.transmission.bpa.gov/Business/Reserve_and_Schedule_Transmission/girequests.cfm> . The LGIP provides you the right to view completed interconnection studies - redacted to protect commercial information.

For an overview of our NEPA compliance requirements and processes, this page (http://www.efw.bpa.gov/environmental_services/environmentalplanning.aspx <http://www.efw.bpa.gov/environmental_services/environmentalplanning.aspx>) and the links from it are valuable reading. For the website with both complete and on-going environmental reviews, see http://www.efw.bpa.gov/environmental_services/nepadocs.aspx <http://www.efw.bpa.gov/environmental_services/nepadocs.aspx> .

I would be happy to assist you through the Request Submittal process, which it is possible to initiate by emailing signed and scanned documents to "interconnection@bpa.gov <<mailto:interconnection@bpa.gov>> ". We recommend including me as a cc to that email. The deposit (the \$10,000 initial deposit and optional \$10,000 deposit in lieu of Site Control) should be submitted per the attached Payment instructions.

Do not hesitate to call or email with any questions .

Sincerely,

Nick

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183

Fiedler,Paul A - TPC-TPP-4

From: Peck,Nick - TPC-TPP-4
Sent: Monday, October 19, 2009 4:39 PM
To: 'Al Aldrich'
Subject: RE: LGIP introductory links - Teanaway Solar

Great, thanks!

Nick Peck

LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Al Aldrich [mailto: **EX 6**]
Sent: Monday, October 19, 2009 4:19 PM
To: Peck,Nick - TPC-TPP-4
Subject: Re: LGIP introductory links - Teanaway Solar

I will call you tomorrow afternoon, Nick, with an update of what I know. I'm traveling right now.

Thanks,
Al

Sent using BlackBerry

-----Original Message-----
From: Peck,Nick - TPC-TPP-4 <cnpeck@bpa.gov>
To: Al Aldrich · **EX 6**
CC: Fiedler,Paul A - TPC-TPP-4 <pafiedler@bpa.gov>
Sent: Mon Oct 19 14:35:36 2009
Subject: FW: LGIP introductory links - Teanaway Solar

Al,

Following our initial flurry of contact, I am curious if there is any headway we should be expecting soon?

Don't hesitate to call me if you have any outstanding questions.

Sincerely,

12/21/2009

Nick

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Al Aldrich [mailto:**EX 6**]
Sent: Thursday, August 06, 2009 1:52 PM
To: Peck,Nick - TPC-TPP-4
Subject: RE: LGIP introductory links - Teanaway Solar

Nick,

Great info and thanks! I will try to find out how soon Howard Trott and his group plan to make the deposit so I can advise you. We also appreciate your willingness to help us through the process. We will stay in touch.

Thanks,

Al

From: Peck,Nick - TPC-TPP-4 [mailto:cnpeck@bpa.gov]
Sent: Wednesday, August 05, 2009 4:38 PM
To: Al Aldrich
Cc: Fiedler,Paul A - TPC-TPP-4; DeClerck,Angela - TSE-TPP-2; Gilliland,Kimberly D - TPC-TPP-3
Subject: LGIP introductory links - Teanaway Solar

Al,

It was a pleasure to talk to you earlier about the Teanaway Solar project.

The interconnection process is closely regulated, and is governed by the Large Generator Interconnection Procedures (LGIP); the Interconnection Queue, which establishes the priority of rights for interconnection, is referenced later.

Below are some detailed links that may be helpful in compiling and submitting a Large Generator Interconnection Request; and the relevant forms are attached to this email to assist you.

12/21/2009

The LGIP in full is Attachment L to our Tariff, linked from <http://www.transmission.bpa.gov/business/default.cfm> <<http://www.transmission.bpa.gov/business/default.cfm>> (The LGIP begins at the 157th page of the pdf, shown as 'Original sheet 191' .) Our Business Practices are also available from that page. I attach a graphical representation of the entire process as a guideline.

I attach electronic copies of the Interconnection Request Form (Appendix 1; I include also its Attachment A - which is welcome but not required at the Request stage); and the W9e and New Vendor form: we will need the W9e information in advance of, or included with any request, to establish your company in our systems before we can begin the processes of validating the request. Unless you are also requesting transmission service, the information sought by these two forms is all we require and you can ignore, at least for the time being, the more stringent requirements listed under 'Becoming a customer'.

At this site, http://www.transmission.bpa.gov/system_planning/planning_studies/default.cfm <http://www.transmission.bpa.gov/system_planning/planning_studies/default.cfm> , you will find instructions on how to obtain existing study reports - these instructions pertain both to the Transmission studies listed on that page and to the LGIP studies referenced from our Interconnection Queue (http://www.transmission.bpa.gov/Business/Reserve_and_Schedule_Transmission/girequests.cfm <http://www.transmission.bpa.gov/Business/Reserve_and_Schedule_Transmission/girequests.cfm> . The LGIP provides you the right to view completed interconnection studies - redacted to protect commercial information.

For an overview of our NEPA compliance requirements and processes, this page (http://www.efw.bpa.gov/environmental_services/environmentalplanning.aspx <http://www.efw.bpa.gov/environmental_services/environmentalplanning.aspx>) and the links from it are valuable reading. For the website with both complete and on-going environmental reviews, see http://www.efw.bpa.gov/environmental_services/nepadocs.aspx <http://www.efw.bpa.gov/environmental_services/nepadocs.aspx> .

I would be happy to assist you through the Request Submittal process, which it is possible to initiate by emailing signed and scanned documents to "interconnection@bpa.gov <<mailto:interconnection@bpa.gov>> " . We recommend including me as a cc to that email. The deposit (the \$10,000 initial deposit and optional \$10,000 deposit in lieu of Site Control) should be submitted per the attached Payment instructions.

Do not hesitate to call or email with any questions .

Sincerely,

Nick

Nick Peck
LGIP Administrator
TPC/TPP-4

12/21/2009

Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183

Fiedler,Paul A - TPC-TPP-4

From: Al Aldrich **EX 6**
Sent: Tuesday, October 20, 2009 3:56 PM
To: Peck,Nick - TPC-TPP-4
Subject: Re: LGIP introductory links - Teanaway Solar

Nick,
Our impulsive salmon fishing trip up to the Skagit River has run longwr than expected today. I will call you in the morning.
Thanks,
Al

Sent using BlackBerry

-----Original Message-----
From: Peck,Nick - TPC-TPP-4 <cnpeck@bpa.gov>
To: Al Aldrich **EX 6**
Sent: Mon Oct 19 16:38:46 2009
Subject: RE: LGIP introductory links - Teanaway Solar

Great, thanks!

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Al Aldrich [mailto:**EX 6**]
Sent: Monday, October 19, 2009 4:19 PM
To: Peck,Nick - TPC-TPP-4
Subject: Re: LGIP introductory links - Teanaway Solar

I will call you tomorrow afternoon, Nick, with an update of what I know. I'm traveling right now.

Thanks,
Al

Sent using BlackBerry

-----Original Message-----
From: Peck,Nick - TPC-TPP-4 <cnpeck@bpa.gov>
To: Al Aldrich **EX 6**
CC: Fiedler,Paul A - TPC-TPP-4 <pafiedler@bpa.gov>
Sent: Mon Oct 19 14:35:36 2009
Subject: FW: LGIP introductory links - Teanaway Solar

Al,

12/21/2009

Following our initial flurry of contact, I am curious if there is any headway we should be expecting soon?

Don't hesitate to call me if you have any outstanding questions.

Sincerely,

Nick

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Al Aldrich [mailto:**EX 6**]
Sent: Thursday, August 06, 2009 1:52 PM
To: Peck,Nick - TPC-TPP-4
Subject: RE: LGIP introductory links - Teanaway Solar

Nick,

Great info and thanks! I will try to find out how soon Howard Trott and his group plan to make the deposit so I can advise you. We also appreciate your willingness to help us through the process. We will stay in touch.

Thanks,

Al

From: Peck,Nick - TPC-TPP-4 [mailto:cnpeck@bpa.gov]
Sent: Wednesday, August 05, 2009 4:38 PM
To: Al Aldrich
Cc: Fiedler,Paul A - TPC-TPP-4; DeClerck,Angela - TSE-TPP-2; Gilliland,Kimberly D - TPC-TPP-3
Subject: LGIP introductory links - Teanaway Solar

Al,

12/21/2009

It was a pleasure to talk to you earlier about the Teanaway Solar project.

The interconnection process is closely regulated, and is governed by the Large Generator Interconnection Procedures (LGIP); the Interconnection Queue, which establishes the priority of rights for interconnection, is referenced later.

Below are some detailed links that may be helpful in compiling and submitting a Large Generator Interconnection Request; and the relevant forms are attached to this email to assist you.

The LGIP in full is Attachment L to our Tariff, linked from <http://www.transmission.bpa.gov/business/default.cfm> <<http://www.transmission.bpa.gov/business/default.cfm>> (The LGIP begins at the 157th page of the pdf, shown as 'Original sheet 191' .) Our Business Practices are also available from that page. I attach a graphical representation of the entire process as a guideline.

I attach electronic copies of the Interconnection Request Form (Appendix 1; I include also its Attachment A - which is welcome but not required at the Request stage); and the W9e and New Vendor form: we will need the W9e information in advance of, or included with any request, to establish your company in our systems before we can begin the processes of validating the request. Unless you are also requesting transmission service, the information sought by these two forms is all we require and you can ignore, at least for the time being, the more stringent requirements listed under 'Becoming a customer'.

At this site, http://www.transmission.bpa.gov/system_planning/planning_studies/default.cfm <http://www.transmission.bpa.gov/system_planning/planning_studies/default.cfm> , you will find instructions on how to obtain existing study reports - these instructions pertain both to the Transmission studies listed on that page and to the LGIP studies referenced from our Interconnection Queue (http://www.transmission.bpa.gov/Business/Reserve_and_Schedule_Transmission/girequests.cfm <http://www.transmission.bpa.gov/Business/Reserve_and_Schedule_Transmission/girequests.cfm> . The LGIP provides you the right to view completed interconnection studies - redacted to protect commercial information.

For an overview of our NEPA compliance requirements and processes, this page (http://www.efw.bpa.gov/environmental_services/environmentalplanning.aspx <http://www.efw.bpa.gov/environmental_services/environmentalplanning.aspx>) and the links from it are valuable reading. For the website with both complete and on-going environmental reviews, see http://www.efw.bpa.gov/environmental_services/nepadocs.aspx <http://www.efw.bpa.gov/environmental_services/nepadocs.aspx> .

I would be happy to assist you through the Request Submittal process, which it is possible to initiate by emailing signed and scanned documents to "interconnection@bpa.gov <<mailto:interconnection@bpa.gov>> " . We recommend including me as a cc to that email. The deposit (the \$10,000 initial deposit and optional \$10,000 deposit in lieu of Site Control) should be submitted per the attached Payment instructions.

Do not hesitate to call or email with any questions .

Sincerely,

Nick

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183

Fiedler,Paul A - TPC-TPP-4

From: Al Aldrich EX 6
Sent: Monday, October 19, 2009 4:19 PM
To: Peck,Nick - TPC-TPP-4
Subject: Re: LGIP introductory links - Teanaway Solar

I will call you tomorrow afternoon, Nick, with an update of what I know. I'm traveling right now.

Thanks,
Al

Sent using BlackBerry

-----Original Message-----
From: Peck,Nick - TPC-TPP-4 <cnpeck@bpa.gov>
To: Al Aldrich EX 6
CC: Fiedler,Paul A - TPC-TPP-4 <pafiedler@bpa.gov>
Sent: Mon Oct 19 14:35:36 2009
Subject: FW: LGIP introductory links - Teanaway Solar

Al,

Following our initial flurry of contact, I am curious if there is any headway we should be expecting soon?

Don't hesitate to call me if you have any outstanding questions.

Sincerely,

Nick

Nick Peck
LGIP Administrator
TPC/TPP-4
Tel: (360) 619-6419
Fax: (360) 619-6070
Cell: (360) 980-2183
Text: 3609802183@vtext.com

From: Al Aldrich [mailto: EX 6
Sent: Thursday, August 06, 2009 1:52 PM
To: Peck,Nick - TPC-TPP-4
Subject: RE: LGIP introductory links - Teanaway Solar

Nick,

12/21/2009

Great info and thanks! I will try to find out how soon Howard Trott and his group plan to make the deposit so I can advise you. We also appreciate your willingness to help us through the process. We will stay in touch.

Thanks,

Al

From: Peck,Nick - TPC-TPP-4 [mailto:cnpeck@bpa.gov]
Sent: Wednesday, August 05, 2009 4:38 PM
To: Al Aldrich
Cc: Fiedler,Paul A - TPC-TPP-4; DeClerck,Angela - TSE-TPP-2; Gilliland,Kimberly D - TPC-TPP-3
Subject: LGIP introductory links - Teanaway Solar

Al,

It was a pleasure to talk to you earlier about the Teanaway Solar project.

The interconnection process is closely regulated, and is governed by the Large Generator Interconnection Procedures (LGIP); the Interconnection Queue, which establishes the priority of rights for interconnection, is referenced later.

Below are some detailed links that may be helpful in compiling and submitting a Large Generator Interconnection Request; and the relevant forms are attached to this email to assist you.

The LGIP in full is Attachment L to our Tariff, linked from <http://www.transmission.bpa.gov/business/default.cfm> <<http://www.transmission.bpa.gov/business/default.cfm>> (The LGIP begins at the 157th page of the pdf, shown as 'Original sheet 191' .) Our Business Practices are also available from that page. I attach a graphical representation of the entire process as a guideline.

I attach electronic copies of the Interconnection Request Form (Appendix 1; I include also its Attachment A - which is welcome but not required at the Request stage); and the W9e and New Vendor form: we will need the W9e information in advance of, or included with any request, to establish your company in our systems before we can begin the processes of validating the request. Unless you are also requesting transmission service, the information sought by these two forms is all we require and you can ignore, at least for the time being, the more stringent requirements listed under 'Becoming a customer'.

At this site, http://www.transmission.bpa.gov/system_planning/planning_studies/default.cfm <http://www.transmission.bpa.gov/system_planning/planning_studies/default.cfm> , you will find instructions on how to obtain existing study reports - these instructions pertain both to the Transmission studies listed on that page and to the LGIP

12/21/2009