


ATTACHMENT 2 – Minimum Approach Distances (MAD) from Energized Conductors

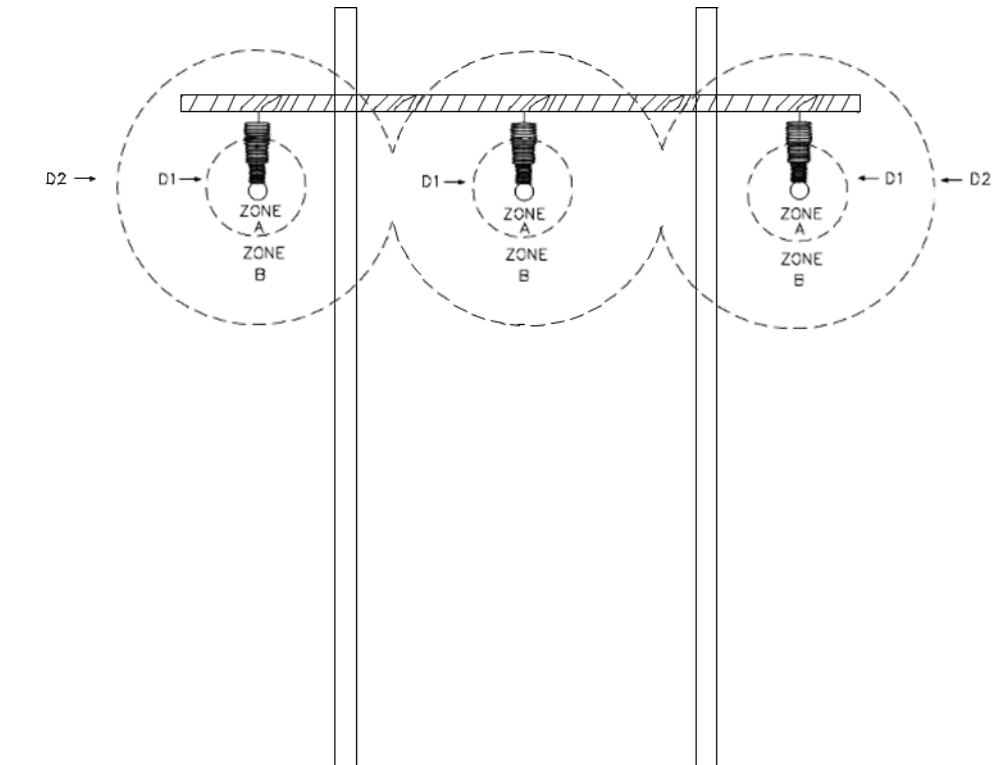

D1 (distance 1): MAD for Qualified Line-Clearance Tree Trimmer (see Table 2 above)

D2 (distance 2): MAD for all other tree workers

Zone A – Inside the MAD. Any trees or work completed in this zone requires an outage (Clearance), and the workers will be QLCTTs or under the direct supervision of QLCTTs.

Zone B – If the tree or trees are in this zone, or if there is any potential of the tree, its branches, or tools entering this zone, the workers will be QLCTTs. A Hold Order may be required for work in this zone (see note below).

Note: A Hold Order is required when falling or removing danger trees if an electrical hazard (or a violation of the MAD) could result. The Contractor has the responsibility of determining hazard trees and the need for a Hold Order.