

BPA Outage Planning and Coordination Policy
B O N N E V I L L E
P O W E R A D M I N I S T R A T I O N



Bonneville Power Administration

Contents

| | |
|---|----|
| Section 1: Introduction | 2 |
| Section 2: Purpose | 2 |
| Section 3: Scope | 3 |
| Section 4: Definitions | 3 |
| Section 5: Policy | 7 |
| 5.1 Outage Notification | 7 |
| 5.2 Coordination and Communication | 7 |
| Section 6: Responsibilities..... | 8 |
| 6.1 BPA Outage Offices (Dittmer or Munro) | 8 |
| 6.2 Outage Requestor | 8 |
| 6.3 Transmission Operations Study Engineers | 8 |
| 6.4 Real-Time System Operating Engineers (RTSOE) | 8 |
| 6.5 BPA Dispatch | 8 |
| 6.6 Chief Operator..... | 9 |
| Section 7: Procedures | 9 |
| 7.1 Scheduling an outage: | 9 |
| 7.2 Review of planned outages: | 9 |
| 7.3 Assess Scheduling Conflicts: | 10 |
| 7.4 Coordinate final outage plan:..... | 10 |
| 7.5 Publish Final Outage Plan: | 10 |
| 7.6 Revisions to the Equipment List: | 10 |
| Section 8: Contact Information | 11 |
| Section 9: References..... | 11 |
| Section 10: Policy Review and Revision Timelines..... | 11 |
| Appendix 1 - Outage Submission and Approval Timelines | 14 |
| Appendix 2 – Equipment List (Long-Range, Mid-Range and Short-Range Equipment) | 23 |
| Appendix 3 – Considerations in requesting outages in the Equipment List (Long-Range, Mid-Range and Short-Range (21 and 14 Day) Equipment) | 24 |
| Appendix 4 – Map of NW Constrained Paths (Major Interties/Flowgates) | 30 |
| Appendix 6 – Additional BPA Reporting Requirements | 32 |

Section 1: Introduction

This document serves as the official BPA Outage Planning and Coordination Policy. The Outage Coordination Process is intended to comply with NERC Reliability Standards, the Reliability Coordinator's (RC) Outage Coordination Process, CAISO's Outage Management Business Practice Manual, and BPA's EIM Tariff. The BPA Outage Planning and Coordination Policy describes the coordination responsibilities of BPA, adjacent facilities, shared facilities, neighboring entities, and other entities within the BPA Balancing Authority (BA) and Transmission Operator (TOP) areas.

Section 2: Purpose

The purpose of the BPA Outage Planning and Coordination Policy document is to:

1. Provide a process for coordination of transmission and generation outages within the BPA TOP and BA areas or impacting the reliability of the Bulk Electric System within the BPA TOP/BA areas;
2. Define equipment under jurisdiction of other TOPs and BAs impacting the reliability of the Bulk Electric System within the BPA TOP/BA areas;
3. Describe the applicable roles and responsibilities of each entity;
4. Provide a mechanism to facilitate compliance with NERC Reliability Standards IRO-010, TOP-003, TOP-001, TOP-002 and IRO-017, or their successors;
5. Minimize outage conditions where schedule curtailments, generation redispatch, and load management actions are likely to occur on the system under BPA jurisdiction and the BES under jurisdiction of other BA/TOP;
6. Minimize late-term cancellation of scheduled outages; and
7. Provide a mechanism to meet CAISO's Outage Management Business Practice Manual and BPA's EIM Tariff.

Proposed transmission and generation outages that may impact the BES must be planned and coordinated among BAs and TOPs and reported to their RCs. This includes any non-BES equipment that may affect the reliability of interconnected operations for the region.

This document provides technical requirements and criteria for BPA transmission operations, maintenance, engineering, hydro operations, customers, and construction staff related to the submission of transmission and generation outages. This document provides requirements for coordination of outages on equipment both inside and outside of BPA's TOP/BA areas.

Section 3: Scope

This policy addresses the roles, methods and procedures that inform BPA Outage Dispatchers of the equipment outages needed to support planned maintenance and construction as well as urgent and emergency work on the power system.

This policy addresses needs for information relating to equipment that impacts the BES and when taken out of service, by itself or in conjunction with other equipment, will require inclusion in a study. This information is conveyed to and utilized by Operations Planning and Real-Time Study Engineers for modeling of the transmission system. This policy also includes requirements to meet CAISO's Outage Management Business Practice Manual and BPA's EIM Tariff.

Equipment covered in this policy is required either as defined BES equipment or as defined in CAISO's Outage Management Business Practice Manual and BPA's EIM Tariff.

This policy does not supersede BPA's Accident Prevention Manual or BPA's Contractor: Clearance, Hold Order, and Work Permit Procedure.

Section 4: Definitions

Advisory Notice of Operating Plan – Generation restrictions resulting from a specific equipment outage.

Bulk Electrical System (BES) – BES transmission and/or generation equipment/facilities (as defined by NERC).

BES transmission/generation Facilities (as defined in the RC's process) include:

1. BES Out of service (outages)
2. Derates (or changes to defined SOL)¹
3. BES/non-BES necessary for voltage control
4. BES Remedial Action Scheme (RAS), non-RAS automatic schemes, or protection systems when functionality is affected (i.e., when normal fault clearing zones are impacted) or Contingency definitions are impacted
5. BES generating unit Automatic Voltage Regulators (AVR), BES Power System Stabilizers (PSS) or BES alternative voltage controlling device²

¹ Derates may also be referred to as outages. Both derates and outages are considered "requests" to perform work.

² AVR and PSS equipment outages are generally communicated real-time.

6. Non-BES transmission or generation Facilities or equipment that is identified by the RC, TOP or BA as having an impact on the reliability of the BES
7. Path or Facility TTC limits if part of an operating plan

Conflict Resolution – Outages can have conflicts independent of other outages, or they can have conflicts with other outages on the system. Any outage (excluding Forced) may not proceed without an Operating Plan that addresses the reliability conflict.

Conflict Resolution Process – The RC uses a first-come, first-served model for conflict resolution. If agreement cannot be reached between TOPs and BAs, the first requesting entity in the Proposed or Confirmed state in WebOMS (Received/Under Review or Approved in iTOA) has priority.

Constrained Path – An intertie or flowgate (a line or group of lines and/or transformers) on which power flow is monitored to ensure reliable operation of the transmission system.

Day – 00:01 – 24:00 Pacific Prevailing Time (PPT).

Energy Management System (EMS) – A suite of computer applications used by operators of electric utility grids to monitor, control, and optimize the performance of the generation and transmission system.

Equipment List- This refers to equipment included in Appendix 2 of this policy. Equipment included in Appendix 2 may impact the BES when taken out of service, by itself or in conjunction with other equipment, or may be required for reliability or market purposes.

Facility Operator- Entity with jurisdiction and physical control over the equipment who is capable of taking the equipment out of service.

Flowgates - A line or group of lines and/or transformers on which power flow is monitored to ensure reliable operation of the transmission system.

Interties – A system of transmission lines permitting a flow of energy between major power systems.

iTOA – BPA's Outage Management System used to request and process outages.

Off-peak Hours – Hours between 2200 PPT and 0600 PPT and all hours on Sundays and holidays.

Operational Planning Analysis (OPA) Lockdown – The OPA Lock-down time is 5 a.m. PPT, one business day prior to the start date of the outage.

Outage Process Participants – All Facility Operators responsible for operating the BES within their jurisdiction.

Outage Request – An application for a period of time when equipment (normally in service) is to be taken out of service.

Outage Types –

Planned Outage – Non-automatic facility/equipment outage, with advance notice, for the purpose of maintenance, construction (including energizing and testing new facilities), inspection, testing or other planned activities.

One-at-a-Time (OAT) Outages – A subset of Planned outages that are available for use by the BA/TOP. The purpose of the OAT is for the BA/TOP to be able to perform work on numerous elements of similar Facilities/equipment at a single station without having to maintain the required Outage Requests that would normally be associated with each element.

1. Generation OAT Requests: Individual unit outages taken sequentially at a single generating Facility where the individual units have similar operating characteristics and are connected at the same voltage level.
2. Transmission OAT Requests: Created to provide real-time situational awareness for activity at a single station. Transmission OAT outages are restricted to non-BES transmission equipment that is not sent to the RC.

Operational Outage – Transmission facility/equipment that is removed from service in the normal course of maintaining optimal or reliable system conditions but remains available if needed upon short notice.

Forced Outage – Facility/equipment that is removed from service in real-time with limited or no notice.

Urgent Outage – Facility/equipment that is known to be operable yet carries an increased risk of a Forced Emergency or Forced Automatic outage occurring. Facility/equipment remains in service until personnel, equipment, and system conditions allow the outage to occur.

Opportunity Outage – A short-duration (one day) facility/equipment outage that can be taken due to a change in system conditions or availability of field personnel. Opportunity outage must not require an Operating Plan and must be submitted prior to the OPA lock-down. Opportunity Outages are not a means to accomplish normal routine planned maintenance or testing. See Appendix 1 for details.

Informational Outage – Facility/equipment outage that is entered for informational reasons including increased situational awareness, for BA/TOP internal purposes or to satisfy the RC Data Specification where WebOMS is the mechanism for communicating the information.

Outage Week – Monday through Sunday.

Peak loading period – Hours when loading on the specific area of the transmission system is consistently highest. Load areas typically have a short significant morning (0800 PPT) and late afternoon (1800 PPT) peak loading period that lasts a couple of hours in the winter. In the summer, the load often doesn't peak until early afternoon and may stay relatively high for 4-6 hours then back off and increase for a short period of time near sunset as lighting load comes on. Thermal generators operate most efficiently with a constant power output. In a geographical area that has large amounts of thermal generation, this output is consumed by local loads during on-peak hours. During Off-peak Hours, the output can be exported to areas where generation can be easily reduced which results in the highest transmission loading during off-peak load conditions.

Revised Outages – Outages are considered to be revised if they are changed after they are in the Proposed or Confirmed state (Received/Under Review or Approved in iTOA). An outage is considered revised if the dates fall outside of the original start and/or stop date or equipment is revised.

Study/Assessments³ -

Study - Mathematical modeling of the transmission system that simulates generation and load levels, topology, equipment ratings, protection schemes, planned maintenance/construction outages, and potential contingencies. A study includes pre- and post-Contingency power flow simulations and analyses using one or more study models. A study also includes necessary transient, post-transient and steady-state stability analyses.

³ Note: The RC's Process requires an Assessment or a Study in certain timelines of outage coordination.

Assessment - An assessment may not include these technical analyses, but rather may rely on system knowledge, experience, prior studies, and operational and engineering judgment. The assessment term may also be more appropriate to describe BA functions. For example, when a BA determines the generation needed to support expected demand patterns, this effort describes a BA “assessment.”

System Operating Limit (SOL) –The value (such as MW, MVar, Amperes, Frequency or Volts) that satisfies the most limiting of the prescribed operating criteria for a specified system configuration to ensure operation within acceptable reliability criteria. System Operating Limits are based upon certain operating criteria. These include, but are not limited to:

1. Facility Ratings (Applicable pre- and post-Contingency equipment or facility ratings)
2. Transient Stability Ratings (Applicable pre- and post-Contingency Stability Limits)
3. Voltage Stability Ratings (Applicable pre- and post-Contingency Voltage Stability)
4. System Voltage Limits (Applicable pre- and post-Contingency Voltage Limits)

Total Transfer Capability (TTC) – The amount of electric power that can be moved or transferred reliably from one area to another area of the interconnected transmission systems by way of all transmission lines (or paths) between those areas under specified system conditions.

WebOMS – RC West / Western EIM (CAISO) Outage Management System.

Section 5: Policy

5.1 Outage Notification

BPA requires notification of Urgent, Emergency, and Planned outages of all transmission or generation equipment which can impact the BES and/or reduce system capacity within its jurisdiction and all additional equipment within BPA’s BA defined by CAISO’s Outage Management Business Practice Manual and BPA’s EIM Tariff.

5.2 Coordination and Communication

BPA will coordinate and communicate outage plans in order to:

1. Operate with a known and studied SOL/TTC on a facility, specific to the outage condition;

2. Recognize opportunities for maintenance and construction work for related equipment;
3. Minimize operation of the system in a constrained condition;
4. Apply for planned outages of Long-Range, Mid-Range, and Short-Range equipment as far in advance as possible; and
5. Meet EIM requirements.

Section 6: Responsibilities

6.1 BPA Outage Offices (Dittmer or Munro)

BPA Outage Offices (Dittmer or Munro) ensure the work requested can be accomplished safely. In addition, they receive and review Outage Requests, assure that equipment nomenclature is accurate, assess conflicting outages, communicate with Outage Requestors and adjacent facilities, and finalize the outage plans. This includes coordinating with impacted parties throughout the process when outages are modified. BPA Outage Offices also submit outages to CAISO to meet RC and EIM requirements.

6.2 Outage Requestor

An Outage Requestor is the Facility Operator who requests an outage to perform planned maintenance, construction, testing, urgent, or emergency work. The Outage Requestor is responsible for providing sufficient information to review and schedule the outage in accordance with the minimum advance notice requirement.

6.3 Transmission Operations Study Engineers

Transmission Operations Study Engineers provide studies that model the potential contingencies, determine limits, and develop operating plans. This includes advising the Outage Office and Dispatch when outages should be cancelled or rescheduled.

6.4 Real-Time System Operating Engineers (RTSOE)

Real-Time System Operating Engineers perform the OPA studies and the Real-Time Contingency Analysis (RTCA). This includes advising the Outage Office and Real-Time Dispatch when outages should be cancelled or rescheduled.

6.5 BPA Dispatch

All real-time outage changes will be communicated to the Chief Operators. When real-time outage changes affect customers with 24-hour

dispatching, BPA Dispatch is responsible for notifying the customer. BPA Dispatch is also responsible for making log entries that the customer and Chief Operator acknowledged notification.

6.6 Chief Operator

All real-time outage changes will be communicated to BPA Dispatch. When real-time outage changes affect customers that do not have 24-hour dispatching, the Chief Operator is responsible for notifying the customer, preferably verbally, and reporting customer acknowledgement to BPA Dispatch.

Section 7: Procedures

7.1 Scheduling an outage:

1. Outage Requests originating within BPA are submitted through iTOA. The Outage Requests are normally submitted through the Chief Substation Operator for the District. The Outage Offices will ensure the outages are submitted to WebOMS.
2. Outage Requests or notifications by Facility Operators other than BPA are submitted via WebOMS in at least a Preliminary State (Submitted in iTOA) and/or communicated (verbally and by email) to/from the impacted Facility Operator.
3. Non-BA/TOP entities may submit outages to BPA via email or through the local districts, and BPA submits those outages to CAISO on their behalf. Non-BA/TOP entities can submit Form b6500.15e to the BPA Outage Office. This form is posted at Proposed Outages (bpa.gov)

7.2 Review of planned outages:

1. BPA Outage Offices (Dittmer or Munro) review submitted Outage Requests to assess which equipment is involved, that all foreign clearances and hold orders are identified, and that the request meets the minimum advance notice requirement.
2. Requests that do not meet minimum timing requirements, are revised, or are incomplete will normally be returned by the Outage Office to the Requestor. BPA will follow the RC Conflict Resolution Process for Outage Requests/notifications inside and outside of BPA's TOP/BA area.
3. Note: BPA's determination of adherence with minimum time requirements (See Appendix 1) based on request type will be made

by applying the time at which the request status becomes “Submitted” in iTOA.

7.3 Assess Scheduling Conflicts:

1. BPA Outage offices (Dittmer or Munro) develop a preliminary outage plan that includes all requested outages for Long-Range, marked by a comment in the COA remark field in iTOA, and Mid-Range equipment. As assessments proceed, equipment can be changed in WebOMS to “Proposed” state (Received/Under Review in iTOA).
2. This preliminary plan will be used to assess impacts to the BES and identify potential outage scheduling conflicts.

7.4 Coordinate final outage plan:

1. BPA will facilitate a coordination meeting with Outage Process Participants to identify and resolve conflicts in order to develop the final outage plans.
2. Outage Process Participants are expected to attend the coordination meeting to identify and resolve conflicts.

7.5 Publish Final Outage Plan:

1. BPA will determine these final outage plans and assure that Outage Process Participants are informed of all agreed upon changes to individual Outage Requests (if any).
2. These plans are then used to perform assessments and studies.

7.6 Revisions to the Equipment List:

1. BPA may modify (add or delete equipment) the Equipment List as needs arise.
2. If the modification involves equipment not owned by BPA, the modification will be coordinated with the facility owner/operator.
3. Additions to the Equipment List will be effective according to the timeline in Appendix 1.

Section 8: Contact Information

BPA Outage Office Contact Information:

DCC Outage Office Phone Number: 360-418-2274

MCC Outage Office Phone Number: 509-822-4540

E-Mail: BPAOutage1@bpa.gov

Section 9: References

RC0630 Reliability Coordinator Procedure – Outage Coordination Process

RC0610 Reliability Coordinator Procedure – System Operating Limits

Methodology for the Operations Horizon

RC0620 – Reliability Coordinator Procedure – Operations Planning Analysis
(Next Day)

NERC Standards

WECC Standards

CAISO's Outage Management Business Practice Manual

BPA's EIM Tariff

Section 10: Policy Review and Revision Timelines

At a minimum, this policy will be reviewed annually.

Version History

| Version | Date Revised | Description of Changes |
|---------|--------------|---|
| 1.0 | 05/09/2014 | BPA Outage Policy Publication |
| 2.0 | 04/10/2015 | Additional definitions; removed reference to OB-19; added Appendix 3 – Considerations for Requesting outages of Tier 1 and Tier 2 Equipment, including additional paths – SOC, NOEL, CI & WI; Appendix 4 – Map of NW Constrained Paths; Appendix 5 –Seasonal & Simultaneous 500 kV Line Outage to Avoid |
| 3.0 | 10/01/2015 | Added Appendix 6 – Additional Information for BPA Equipment Outages |
| 4.0 | 03/09/2016 | Updated Appendix 2 - Tier 1 and Tier 2 equipment. Revised and updated to |

| | | |
|------|------------|--|
| | | reflect process, language and timeline changes to meet Peak's Outage Coordination Process. Clarification of external and internal location of Appendix 2 and Appendix 5 added. Added examples for outage submission timelines. |
| 5.0 | 03/24/2017 | Revised to reflect RC Changes. |
| 6.0 | 12/6/2018 | Revised to add Long-Range Equipment requirements and other edits |
| 7.0 | 3/7/2019 | Renamed 45 day to Mid-Range; 21/14 day to Short-Range. Mid-Range timeline is two months in advance of Outage Month. <u><i>If submission date falls on weekend or federal holiday, outage must be submitted on previous business day.</i></u> |
| 8.0 | 8/26/2019 | Added examples for outage submission timelines. Revised to reflect RC Changes. |
| 9.0 | 7/1/2020 | Added additional information about Tag Holders to Appendix 6 |
| 10.0 | 10/23/2020 | Update to Appendix 6 – Additional BPA Reporting Requirements |
| 11.0 | 05/12/2021 | Removed North of John Day path and updated some best times for outages |
| 12.0 | 05/03/2022 | Added requirements to meet CAISO's Outage Management Business Practice Manual and BPA's EIM Tariff. |
| 13.0 | 5/1/2023 | Added GRZN path to the Appendix 3 and updated map in Appendix 4 |

| | | |
|------|------------|--|
| 14.0 | 10/2/2023 | Added NOPE path to Appendix 3 and updated map in Appendix 4. |
| 14.1 | 6/20/2025 | Minor formatting changes. |
| 15.0 | 11/14/2025 | Section 6 was updated with agreement from TORD/M & TF to clarify coordination responsibilities. Updated Appendix 3, and BPA Outage Office contact information. Minor formatting and editing changes. |

Appendix 1 - Outage Submission and Approval Timelines

Equipment Categories and Timelines

1. Long Range equipment – All 500 kV transmission equipment that may impact the BES or require a capacity reduction to assure reliable operation on a Constrained Path. This includes equipment outages that alone might not affect the electrical system or capacity, but under credible conditions, in combination with other outages, could have a significant impact or capacity reduction. For example, a 500 kV breaker outage may not force out a transmission line or transformer but the outage of that breaker can change the equipment forced out of service due to a breaker failure operation of another 500 kV breaker in that station. Those impacts need to be included when determining transmission impacts and/or system capacity.

It is highly recommended to submit all BES outages for the Long Range to ensure that all outage impacts are considered during this time frame.

Examples:

- Outages in the Puget Sound Area
- Redmond Area
- Some of the Southern Oregon Coast
- Tri-Cities Area
- Lines/equipment connected to Federal Hydro System
- Customer Interruptions

Long Range Equipment requirement: Long-Range equipment outage requests are required to be submitted to BPA's iTOA no later than 3:00 P.M. Pacific Prevailing Time (PPT) on the first business day, **5 months prior to the month** the outage is scheduled to start. If requests are between the Long Range and Mid-Range submittal windows, submitters can mark it as "COA" in iTOA for review prior to the Mid-Range process.

Exclusions:

- 500 kV Motor Operated Disconnect (MOD) mechanism service
- 500/230 kV transformer bank accessory services
- Batteries and battery chargers
- Sequential Even Recorders (SER)
- Digital Fault Recorders
- Meters
- Redundant relay set
- SCADA RTU
- Phasor Measurement Unit (PMU)
- All other 500 kV transmission equipment (Redundant relays, Hold Orders, other equipment with redundancy)

which doesn't impact the BES when removed from service).

2. Mid-Range equipment – Equipment that when taken out of service may impact the BES or require a capacity reduction to assure reliable operation on a Constrained Path. This includes equipment outages that alone might not affect the electrical system or capacity, but under credible conditions, in combination with other outages, could have a significant impact or capacity reduction. For example, a 230 kV Bus Sectionalizing Breaker outage may not force out a transmission line or transformer but the outage of that breaker can change the post-contingency loading patterns at that station which could, in turn, result in overloads or stability issues. Those impacts need to be included when determining transmission impacts and/or system capacity. If a circuit breaker can be bypassed on the same bus section, the Mid-Range timeline can be ignored.

Certain Mid-Range equipment outages by themselves will typically have an impact on the SOL/TTC for the paths/Flowgates noted and are intended to be part of the monthly outage coordination meeting.

Additionally, some Mid-Range equipment outages when combined with other equipment outages may impact the SOL/TTC for the paths/Flowgates noted and are intended to be included in planned outage studies.

Mid-Range Equipment requirement: Mid-Range equipment outage requests are required to be in a Submitted status in BPA's iTOA no later than **two months prior to the month** the outage is scheduled to start by 3:00 P.M. (PPT). Note: If the submission date falls on a weekend or federal holiday, the outage must be submitted on the previous business day.

3. Short-Range (21 Day) equipment – BES equipment outages marked in the equipment list are required to be submitted 21 days prior to the Outage Week (Monday to Sunday) in which the outage is scheduled to start. This includes outages that may require additional time for Study Engineers to prepare Operating Plans. This includes generation derates of 50 MW or greater at the unit or aggregate plant level, outside of BPA's BA and generation outages and derates that are defined by CAISO's Outage Management Business Practice Manual and BPA's EIM Tariff within BPA's BA.

Short-Range (21 Day) Equipment requirement: 21 Day Equipment Outage Requests are required to be in a Submitted status in iTOA no later than 3:00 P.M. (PPT), **21 days prior to the Outage Week** in which the outage is scheduled to start.

4. Short-Range (14 Day) equipment – All other BES Planned outages, unless noted in the exception list (See Appendix 1), are required to be submitted 14 days prior to the Outage Week (Monday to Sunday) in which the outage is scheduled to start. This includes generation derates of 50 MW or greater at the unit or aggregate plant level, outside of BPA's BA and generation outages and derates that are defined by CAISO's Outage Management Business Practice Manual and BPA's EIM Tariff within BPA's BA.

Short-Range (14 Day) Equipment (not listed in the Equipment List):

1. Customer Interruptions
2. Power Circuit Breaker (PCB) bypass
3. Communications equipment. Including, but not limited to telemetering, control equipment, SCADA RTU, ICCP, fiber that is non-redundant
4. Energy Management System (EMS) work that disables any portion of the ISO Grid monitoring, control or protective equipment including EMS equipment and communication circuits
5. EMS work that affects Generator AGC or RIG equipment or communication circuits

Short-Range (14 Day) Equipment requirement: All BES Planned Outage Requests are required to be in a Submitted status in iTOA no later than 3:00 P.M. (PPT), **14 days prior to the Outage Week** in which the outage is scheduled to start.

5. 4 Day equipment:

The equipment and outage categories below may or may not be considered BES. These are required to be submitted in BPA's iTOA system no later than 1200 hours, 4 business days prior to the day the outage is scheduled to start. The list below contains some types of outages that require 4 business days, but is not an all-inclusive list. Contact the BPA Outage Office for submission requirements on equipment not listed below.

1. All Hold Orders not requiring a line outage.
2. Most redundant relays
3. Sequential Event Recorder (SER)
4. SCADA RTU
5. Digital Fault Recorder (DFR)
6. Meters
7. Phasor Measurement Unit (PMU)
8. Motor Operated Disconnect (MOD) Mechanisms
9. Generation Data Acquisition Computer (GDAC)

10. All other equipment (Redundant relays, Hold Orders, other equipment with redundancy which doesn't impact the BES when removed from service).
 11. A relay taken out of service for 30 minutes or less, without having to take the associated high voltage equipment out of service.
6. EIM Requirements for Generators:
- CAISO requires the EIM Entity to provide planned and unplanned outages and de-rate information for all generators that meet the parameters documented in CAISO's Business Practice Manual.

NOTE: This table is for reference purposes only. Please refer to CAISO's Outage Management BPM.

| Planned Outages | EIR (VER) | Hydro | Thermal |
|--|--|--|--|
| Resource PMAX < 10 MW | Report all planned outages > 1 MW | Report all planned outages > 1 MW | Report all planned outages > 1 MW |
| Resource PMAX > 10 MW | Report all planned outages > 1 MW | Report all planned outages > 1 MW | Report all planned outages > 1 MW |
| Resource PMAX > 50 MW and child resource > 50 MW | Report all planned outages > 1 MW at parent level and report all child units that have a complete outage | Report all planned outages > 1 MW at parent level and report all child units that have a complete outage | Report all planned outages > 1 MW at parent level and report all child units that have a complete outage |

| Forced Outages | EIR (VER) | Hydro | Thermal |
|--|--|--|--|
| Resource PMAX < 10 MW | Only report complete resource outage | Only report complete resource outage | Only report complete resource outage |
| Resource PMAX > 10 MW | Report any conditions leading to availability deviation of 1 MW or more | Report any conditions leading to availability deviation of 10 MW or more | Report any conditions leading to availability deviation of 10 MW or more |
| Resource PMAX > 50 MW and child resource > 50 MW | Report any conditions leading to availability deviation of 1 MW or more and report child units that have a complete outage | Report any conditions leading to availability deviation of 1 MW or more and report child units that have a complete outage | Report any conditions leading to availability deviation of 1 MW or more and report child units that have a complete outage |

Conflict Resolution Process:

If BPA determines that the coincidence of planned outages represents an unreasonable risk to reliability, BPA will take steps to negotiate changes to the planned outages to reduce operational risk. If unable to resolve the conflict, BPA will use the RC Conflict Resolution Process which allows the Outage Request submitted first to continue as planned.

Additions/changes to Equipment in Appendix 2:

If BPA determines that equipment must be added to the Equipment List in Appendix 2, BPA will provide 21 days' notice prior to implementing the change.

Equipment removed will take effect immediately.

The Equipment List may not contain every piece of equipment that is required in the Short-Range (21 Day or 14 Day) time period. Refer to the list below for types of outages or equipment that fall into each category.

Outage Requests for Equipment that do not meet the submission timeline:

BPA has the discretion to accommodate late Outage Requests. However, if BPA is unable to accommodate a change to an existing request or a new request, BPA will mitigate using the RC's Conflict Resolution process.

Requests made after the 21 days must not require an Operating Plan or a change to an existing Operating Plan.

Opportunity Outages (Transmission and/or Generation)

Requests made after the RC's Short-Range timeline are considered Opportunity Outages, Transmission or Generation and have the following requirements:

1. Requested a minimum of 4 business days in advance.
2. Cannot be more than one day in length, with some exceptions
3. Cannot require an Operating Plan.
4. Cannot be submitted after the OPA Lockdown window (with some exceptions.)


Opportunity Outages that do not meet the minimum submission timelines will be assessed and approved at the discretion of the Outage Dispatcher or the Real-Time System Dispatcher. Requests made after the OPA Lockdown time must be considered Urgent or Emergency or approved by the Real-Time Dispatcher. Requests made after the OPA lockdown must be studied or assessed by the RTSOE. The RC must also approve the Outage Request.

Real-time or Same Day Opportunity Outages: Must be approved by Real-Time System Dispatcher. The Real-Time System Study Engineer must perform assessment/study. The RC must approve of the outage.

Appendix 1a - Outage Submission Timeline Examples

Long-Range Examples:

Long-Range Submission – 1st of the Month on Business Day

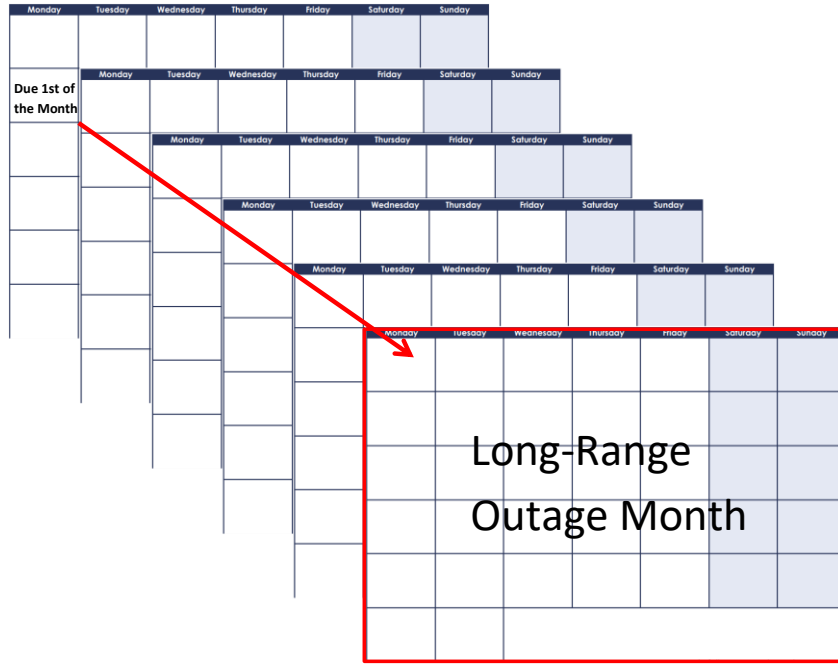

Mid-Range Submission – 1st of the Month on Business Day

Mid-Range Submission – 1st of the Month on Weekend or Holiday

Page 21

Short-Range Examples:

A-Range Submission – 1st of the Month on Weekend or Holiday

| Monday | Tuesday | Wednesday | Thursday | Friday | Saturday | Sunday |
|-----------------------------|---------|-----------|----------|--------|----------|--------|
| Short-Range (21 day) Due | | | | | | |
| Short-Range (14 day) Due | | | | | | |
| | | | | | | |
| Short-Range Outage Week | | | | | | |

Short-Range Submission – Submission day on Holiday

| Monday | Tuesday | Wednesday | Thursday | Friday | Saturday | Sunday |
|-----------------------------|---------|-----------|----------|-----------------------------|----------|--------|
| Short-Range (21 day) Due | | | | Short-Range (14 day) Due | | |
| Holiday | | | | | | |
| | | | | | | |
| Short-Range Outage Week | | | | | | |

Appendix 2 – Equipment List (Long-Range, Mid-Range and Short-Range Equipment)

External parties to BPA:

The BPA Outage Policy, Appendix 2 and Appendix 5 are located in the RC West library

Additionally, BPA will send a list to Facility Operators that are external to BPA.

BPA employees:

BPA employees can access both Appendix 2 and Appendix 5 here:

[Appendix 2 and Appendix 5](#)

Appendix 3 – Considerations in requesting outages in the Equipment List (Long-Range, Mid-Range and Short-Range (21 and 14 Day) Equipment)

Interties:

- NWACI – Northwest AC Intertie (Previously COI)
- ID-NW – Idaho to Northwest Intertie
- MT-NW – Montana to Northwest Intertie
- NI – Northern Intertie to Canada
- RATS – Northwest to Sierra Pacific Power Intertie
- PDCI – Pacific Direct Current Intertie

Flowgates:

- I-5 – Series of Flowgates on I-5 corridor between Raver and Pearl substations
- RP – Raver-Paul
- SOA – South of Allston and Pearl-Keeler
- SOC – South of Custer
- NOEL – North of Echo Lake
- NOH – North of Hanford
- NOPE – North of Pearl
- SOB – South of Boundary
- WOCN – West of Cascades North
- WOCS – West of Cascades South
- WOJD – West of John Day
- WOH – West of Hatwai
- WOLM – West of Lower Monumental
- WOM – West of McNary
- WOS – West of Slatt
- CI – Columbia Injection
- WI – Wanapum Injection
- GRZN – North of Grizzly

Other paths:

- JDAY – John Day Wind
- RKCR – Rock Creek Wind

Other areas that may be noted in Appendix 2:

- BCHT – NW – Canada Total
- BCHW – NW – Canada West
- BGEDY – Big Eddy Load
- COI – California / Oregon Intertie
- COMM – Communications
- COR – Central Oregon
- EWEB – Eugene
- FCRPS – Federal Generation
- FLAT – Flathead
- GEN – Generation

IROL – NW Washington Area Load
LOAD – Load service consideration
OKLA – Okanogan Area Load
REL –Raver-Echo Lake
SCORC – Southwest and Central Oregon Coast
SEIL –SE Idaho Load
SI – Satsop Injection
SIG – Significant
SLAL – Salem / Load
STCON – Standards of Conduct
SWORE – SW Oregon Coast
TCLA – Tri-Cities Load Area
WAWA – Walla Walla Area
WSIDE – Westside

The information below is provided to assist individuals in requesting outages for Long-Range or Mid-Range equipment. Intertie and flowgate usage is considered when developing the final outage plans. Individuals should consider the “Best time to schedule outages” in determining their outage plans and whether they may be able to have an Outage Request approved in less than Long-Range or Mid-Range time frames. This information is to be used as a guide as to the best times to take an outage of Long-Range or Mid-Range equipment; it does not automatically mean an Outage Request will be granted. Keep in mind that flexibility for taking outages of Long-Range or Mid-Range equipment may be available if system conditions permit. When planning outages of Long-Range or Mid-Range equipment, consider both the identified “Best time to schedule outages” and any information under “Other considerations”.

BGEDY (Big Eddy 115 kV Local Area)

Best time to schedule outages: June through December.

Other considerations: Avoid outages that limit 115 kV The Dalles generation (Big Eddy 230/115 kV bank 1 and Big Eddy-The Dalles 115 kV line) February through April.

CI

Best time to schedule outages: October through March.

Other considerations: Avoid the June-August time frame, as well as peak run-off periods from mid-April through May.

FLAT (Flathead)

Best time to schedule outages: August through February.

Other considerations: Avoid outages March through July.

GRZN (North of Grizzly)

Best time to schedule outages: October through April.

Other considerations: During the spring and summer months the Northwest exports heavily to California. It is conceivable for the Northwest to import heavily during winter months (November-February) during off-peak hours.

I-5 (RP, PA, NOPE and SOA)

The series of 500 kV transmission lines on the west side of the Cascade mountains that extend between Raver to the north and Pearl to the south.

Best time to schedule outages: October through May before there are high north to south flows across the Northwest to serve high summer loads in California.

Other considerations: Outages that need to be taken during high north to south transfer periods should avoid the afternoon period when transfers are highest. Outages should be avoided during projected winter cold snap periods.

ID-NW

Best time to schedule outages: September through April when loads on the east side of the WECC system are down.

Other considerations: Daily outages are preferred when outages are taken during periods of high off-peak east to west transfers.

IROL - NW WA Area Net Load

Best time to schedule outages: June through October outside of winter peaking conditions.

Other Considerations: The NW WA Area Net Load (IROL) is limited by imports into the greater Puget Sound Area and Olympic Peninsula. Typically, any 500/230 kV Bk, 500 kV shunt capacitor and/or line above 287 kV in the area is considered significant to the IROL. Heavy imports occur when the load in the area is high, such as during cold snap conditions and when generation in the area is offline, such as during the spring runoff period in the spring.

MT-NW

Best time to schedule outages: March through June for large impact outages and September through

November for small impact outages. If possible, coordinate with maintenance outages of Colstrip generators which often occur in spring.

Other considerations: Daily outages are preferred when outages are taken during periods of high off-peak east to west transfers.

NI

Best time to schedule outages: March 15-April 30 and October 1-November 30.

Other considerations: High exports from the Northwest to Canada are typical during spring run-off conditions (April-June) in the Northwest. High imports to the Northwest from Canada are typical during summer peak load periods (July-September) after the Northwest run-off subsides.

NOH

Best time to schedule outages: October through May.

Other considerations: As spring run-off tapers off and ends (June-September), Canadian exports to California increase the NOH loading. Outages that must be taken during high NOH loading conditions should avoid the higher loading period in the afternoon and early evening if possible.

NWACI (Previously COI)

Best time to schedule outages: October through April.

Other considerations: During the spring and summer months the Northwest exports heavily to California. It is conceivable for the Northwest to import heavily during winter months (November-February) during Off-peak Hours.

PDCI

Best time to schedule outages: October through April.

Other considerations: During the spring run-off (April-June) and summer (July-September) months the Northwest exports heavily to California. It is conceivable for the Northwest to import heavily from California during off-peak conditions during the winter (November-February).

RATS

Best time to schedule outages: October through April when loads in Nevada are lower due to lower temperatures.

SEIL (SE Idaho)

Best time to schedule outages: April through October.

Other considerations: Due to lack of generation, avoid Hooper Springs and source lines in LVE's system outages during October through March.

SOB

Best time to schedule outages: August through September for large impact outages. For Small impact outages October through November and January through February is best.

Other considerations: Heaviest flows on this path are during the spring runoff (mid-April through mid-July).

SOC/NOEL

Best time to schedule outages: March 15-April 30 and October 01-November 15.

Other considerations: Avoid scheduling outages that impact NOEL when Seattle area loads are high during the winter and also during periods of high exports to Canada which typically occur in the late spring. Outages which impact SOC should be avoided in the July to September time period when imports from Canada may be high.

TCLA (Tri-Cities)

Best time to schedule outages: October through April.

Other considerations: No outages during the heavy loading summer timeframe (middle of May through August).

WI

Best time to schedule outages: October through May.

Other considerations: Avoid the July-August time frame, as well as peak run-off periods from mid-April through May.

WOCN

Best time to schedule outages: September-November, between the peak summer and peak winter load periods.

Other considerations: Heaviest flows on this path occur during spring run-off when there are heavy exports to Canada and Westside thermal generation is displaced by hydro and winter peak load periods.

WOCS

Best time to schedule outages: The periods between winter and summer (April-May & September-November).

Other considerations: Heaviest flows on this path occur during winter peak load. Outages may also impact the COI, and PDCI so availability of summer outages is limited.

WOH

Best time to schedule outages: March through April before the spring run-off in western Montana and September through October when western Montana hydro has subsided and prior to winter load periods.

Other considerations: Daily outages are preferred when outages are taken during periods of high off-peak east to west transfers.

WOJD

Best time to schedule outages: Mid-September through November for large impact outages and November through the first week of April for small impact outages.

Other considerations: Daily outages are preferred when outages are taken during periods of high off-peak east to west transfers.

WOLM

Best time to schedule outages: September through the first week of April.

Other considerations: Outages should be avoided during periods of high generation on the Lower Snake that is typically during spring run-off (April-June) and/or heavy exports to California.

WOM

Best time to schedule outages: September through the first week of April.

Other considerations: Outages should be avoided during periods of high generation on the Lower Snake that is typically during spring run-off (April-June) and/or heavy exports to California.

WOS

Best time to schedule outages: Mid-September through the first week of April.


Other considerations: Outages should be avoided during periods of high generation on the Lower Snake that is typically during spring run-off (April-June) and/or heavy exports to California.

OTHER CONSIDERATIONS THAT MAY AFFECT YOUR REQUEST

- Outages that need to be taken during heavy loading conditions on a Constrained Path should be coordinated to minimize curtailments during the peak transmission usage period of the day.
- Take into consideration the impacts weather or fire may have on transfer capability during an outage.
- Generator outages may impact transfer capability or the ability to load a path and should be considered when planning outages.

Appendix 4 – Map of NW Constrained Paths (Major Interties/Flowgates)

For outage scheduling purposes, the transmission system is divided into Interties or flowgates and associated Mid-Range equipment. Appendix 3 can be used to determine the location of the major flowgates in the Bonneville service territory.

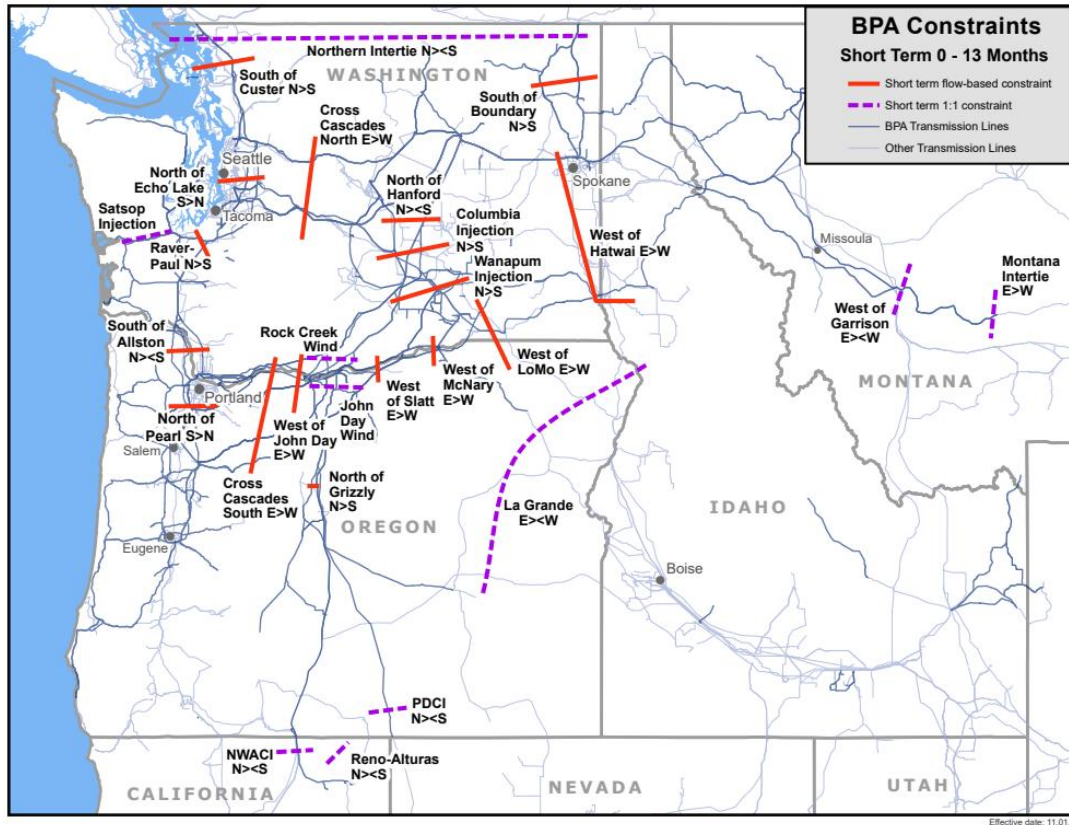

Legend:

| | |
|--|---------------------------------|
| COI – California Oregon Intertie | SOB – South of Boundary |
| PDCI – Pacific Direct Current Intertie | WI – Wanapum Injection |
| RATS – Northwest to Sierra Pacific Power Intertie (Reno – Alturas) | WOCN – West of Cascades North |
| ID-NW – Idaho to Northwest Intertie (LaGrande) | WOCS – West of Cascades South |
| MT-NW – Montana to Northwest Intertie (West of Garrison) | WOJD – West of John Day |
| NI – Northern Intertie to Canada | WOH – West of Hatwai |
| NOPE – North of Pearl | WOLM – West of Lower Monumental |
| RP – Raver-Paul | WOM – West of McNary |
| SOA – South of Allston and Pearl-Keeler | WOS – West of Slatt |
| SOC – South of Custer | RKCR - Rock Creek Wind |
| NOEL – North of Echo Lake | JDAY - John Day Wind |
| NOH – North of Hanford | CI – Columbia Injection |
| GRZN – North of Grizzly | |

Appendix 5 – Seasonal & Simultaneous 500 kV Line Outages to Avoid

A matrix of 500 kV lines is located on RC West's secure portal. Use this matrix as a guide in conjunction with information in Appendix 3 to determine the best time of the year to plan outages on 500 kV lines. It can also be used to identify simultaneous outages of 500 kV lines to avoid in the outage planning process.

External parties to BPA:

The BPA Outage Policy, Appendix 2 and Appendix 5 are located in the RC West Portal at rc.aiso.com.

Additionally, BPA will send a list to Facility Operators that are external to BPA.

BPA employees:

The BPA Outage Policy, Appendix 2 and Appendix 5 are located on the TORO SharePoint site.

[TORO SharePoint](#)

Appendix 6 – Additional BPA Reporting Requirements

- A. Applications for Clearances, Hold Orders and Work Permits for equipment affecting the operation or protection of the BPA power system shall be made with the appropriate Outage Dispatcher as far in advance as possible. See Clearances on Transmission Lines and Line Section BPA-WS-3-8 - System Operating Standards. Outage applications which do not follow WS-3-8 will be returned by the Outage Office.

Urgent or Emergency equipment Outage Requests will be processed by the appropriate Dispatcher under real-time procedures.

- B. Applications for Clearances and Work Permits for equipment outages which do not affect the operation or protection of the BPA power system shall be made with District Substation Operations as far in advance as possible.

When applying for a Clearance or Work Permit, the following information is to be provided to the Outage Dispatcher or Chief Substation Operator:

1. The correct name designation of the line or equipment desired, using System Operations numbers and designations.
 2. The date and time the work or test requiring the Clearance, or Work Permit is scheduled to begin.
 3. The anticipated duration required for the Clearance or Work Permit.
 4. The name of the person who will take the Clearance or Work Permit.
 5. The type of Clearance desired.
 6. A description of the work or test to be performed.
- C. Application for Clearances and Hold Orders from foreign utilities to facilitate BPA's work in proximity to the foreign utility's equipment (VI.5G and VII.3D) shall be made as far in advance as possible.

When applying for Clearances or Hold Orders from a foreign utility, the following information shall be provided to the Outage Dispatcher or Chief Substation Operator:

1. The correct name designation of the line or equipment as identified by the foreign utility.
2. The date and time the work requiring the Clearance or Hold Order is scheduled to begin.
3. The anticipated duration for the Clearance or Hold Order.
4. The name of the person who will take the Clearance or Hold Order.
5. A description of the work to be performed.
6. Whether the recipient will receive/release the Clearance or Hold Order directly through the foreign utility.
7. Contact information of the foreign utility.

For further information on application for Clearances or Hold Orders from a foreign utility, see BPA Work Standard BPA- WS-3-5, Clearances and Hold Orders from Foreign Utilities.

- D. All Craft supervisors shall keep informed of proposed/submitted/Received/Under Review outages through iTOA. Chief Operators shall serve as consultants/coordinators for the details/possibilities/timelines of those outages. The scheduling of maintenance work must be coordinated to minimize the number of outages to BPA lines and equipment and to customers' points of delivery.
- E. Outage Requestors are responsible for ensuring that individuals listed as Tag Holders on the outage form are certified prior to submitting the request. Any changes to the names of the Tag Holders on an outage form will require checking the Permit Directory.