




Remove existing 115-kV line.
Construct new 230-kV
double-circuit line within
existing BPA corridor.

Proposed connection
to existing 230-kV
Olympia-Satsop line.

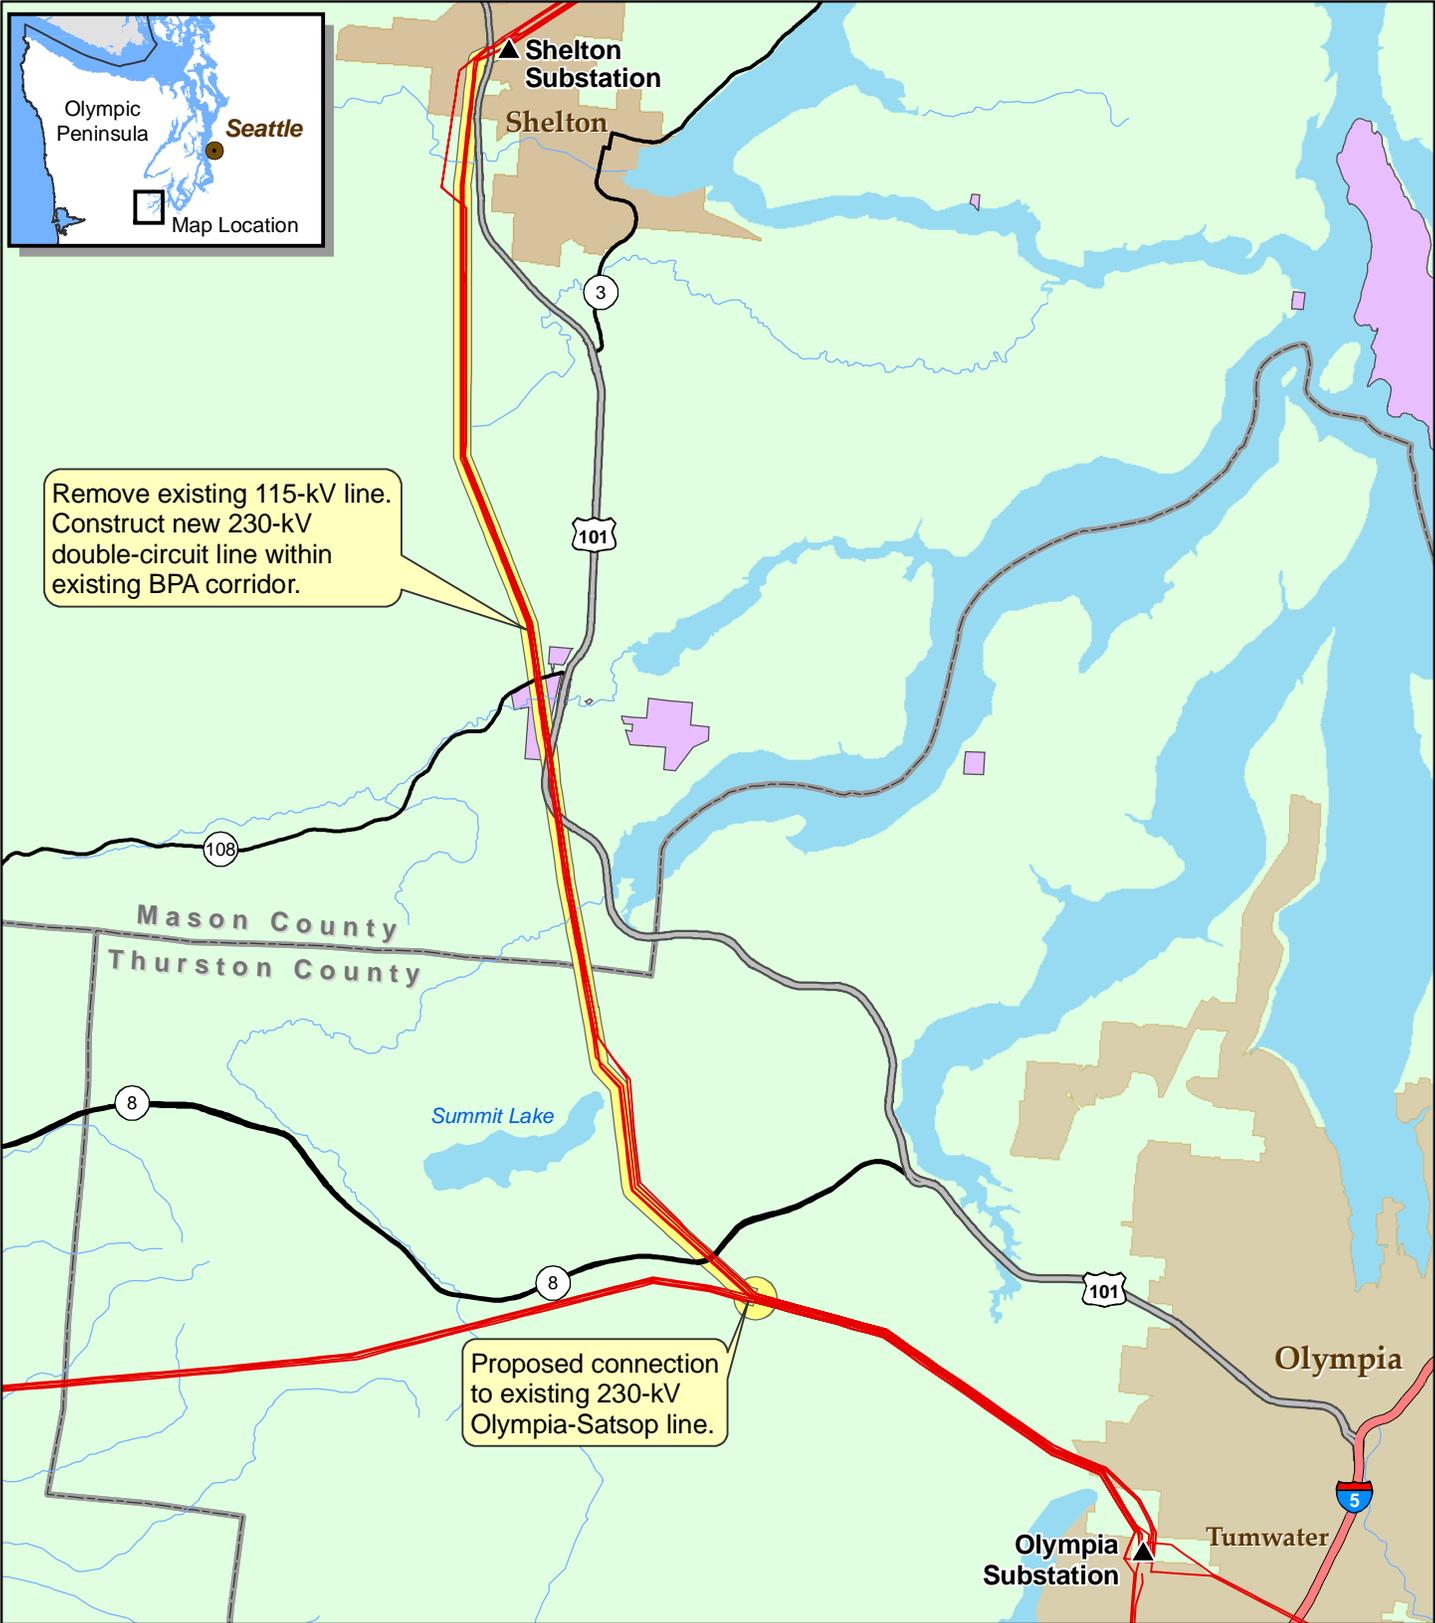

Proposed Olympic Peninsula Reinforcement Project

Legend

-  BPA Transmission Lines
-  Proposed Project Route
-  BPA Substation
-  Squaxin Island Indian Reservation
-  County Boundary
-  Urban Areas

